

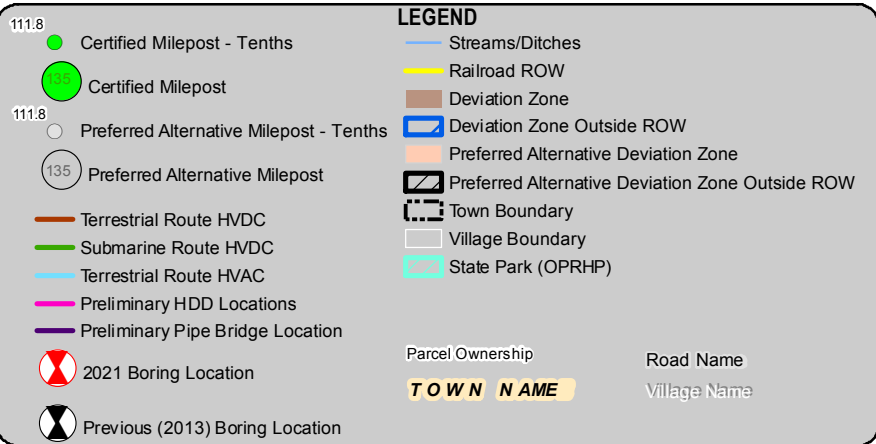


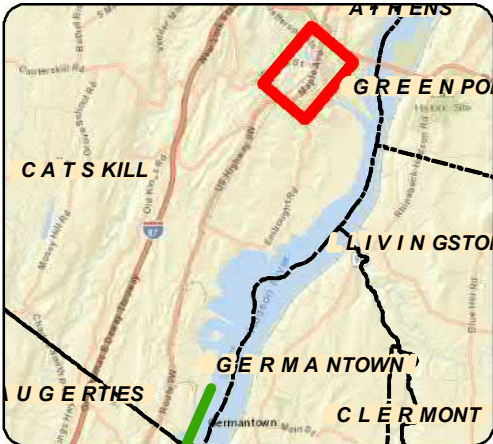

Champlain Hudson Power Express Project
Champlain Hudson Power Express Inc.

BORING LOCATION PLAN
Catskill to Upland
Figure A-11
Sheet 1 of 6

Prepared by: **AECOM** 5/20/2021

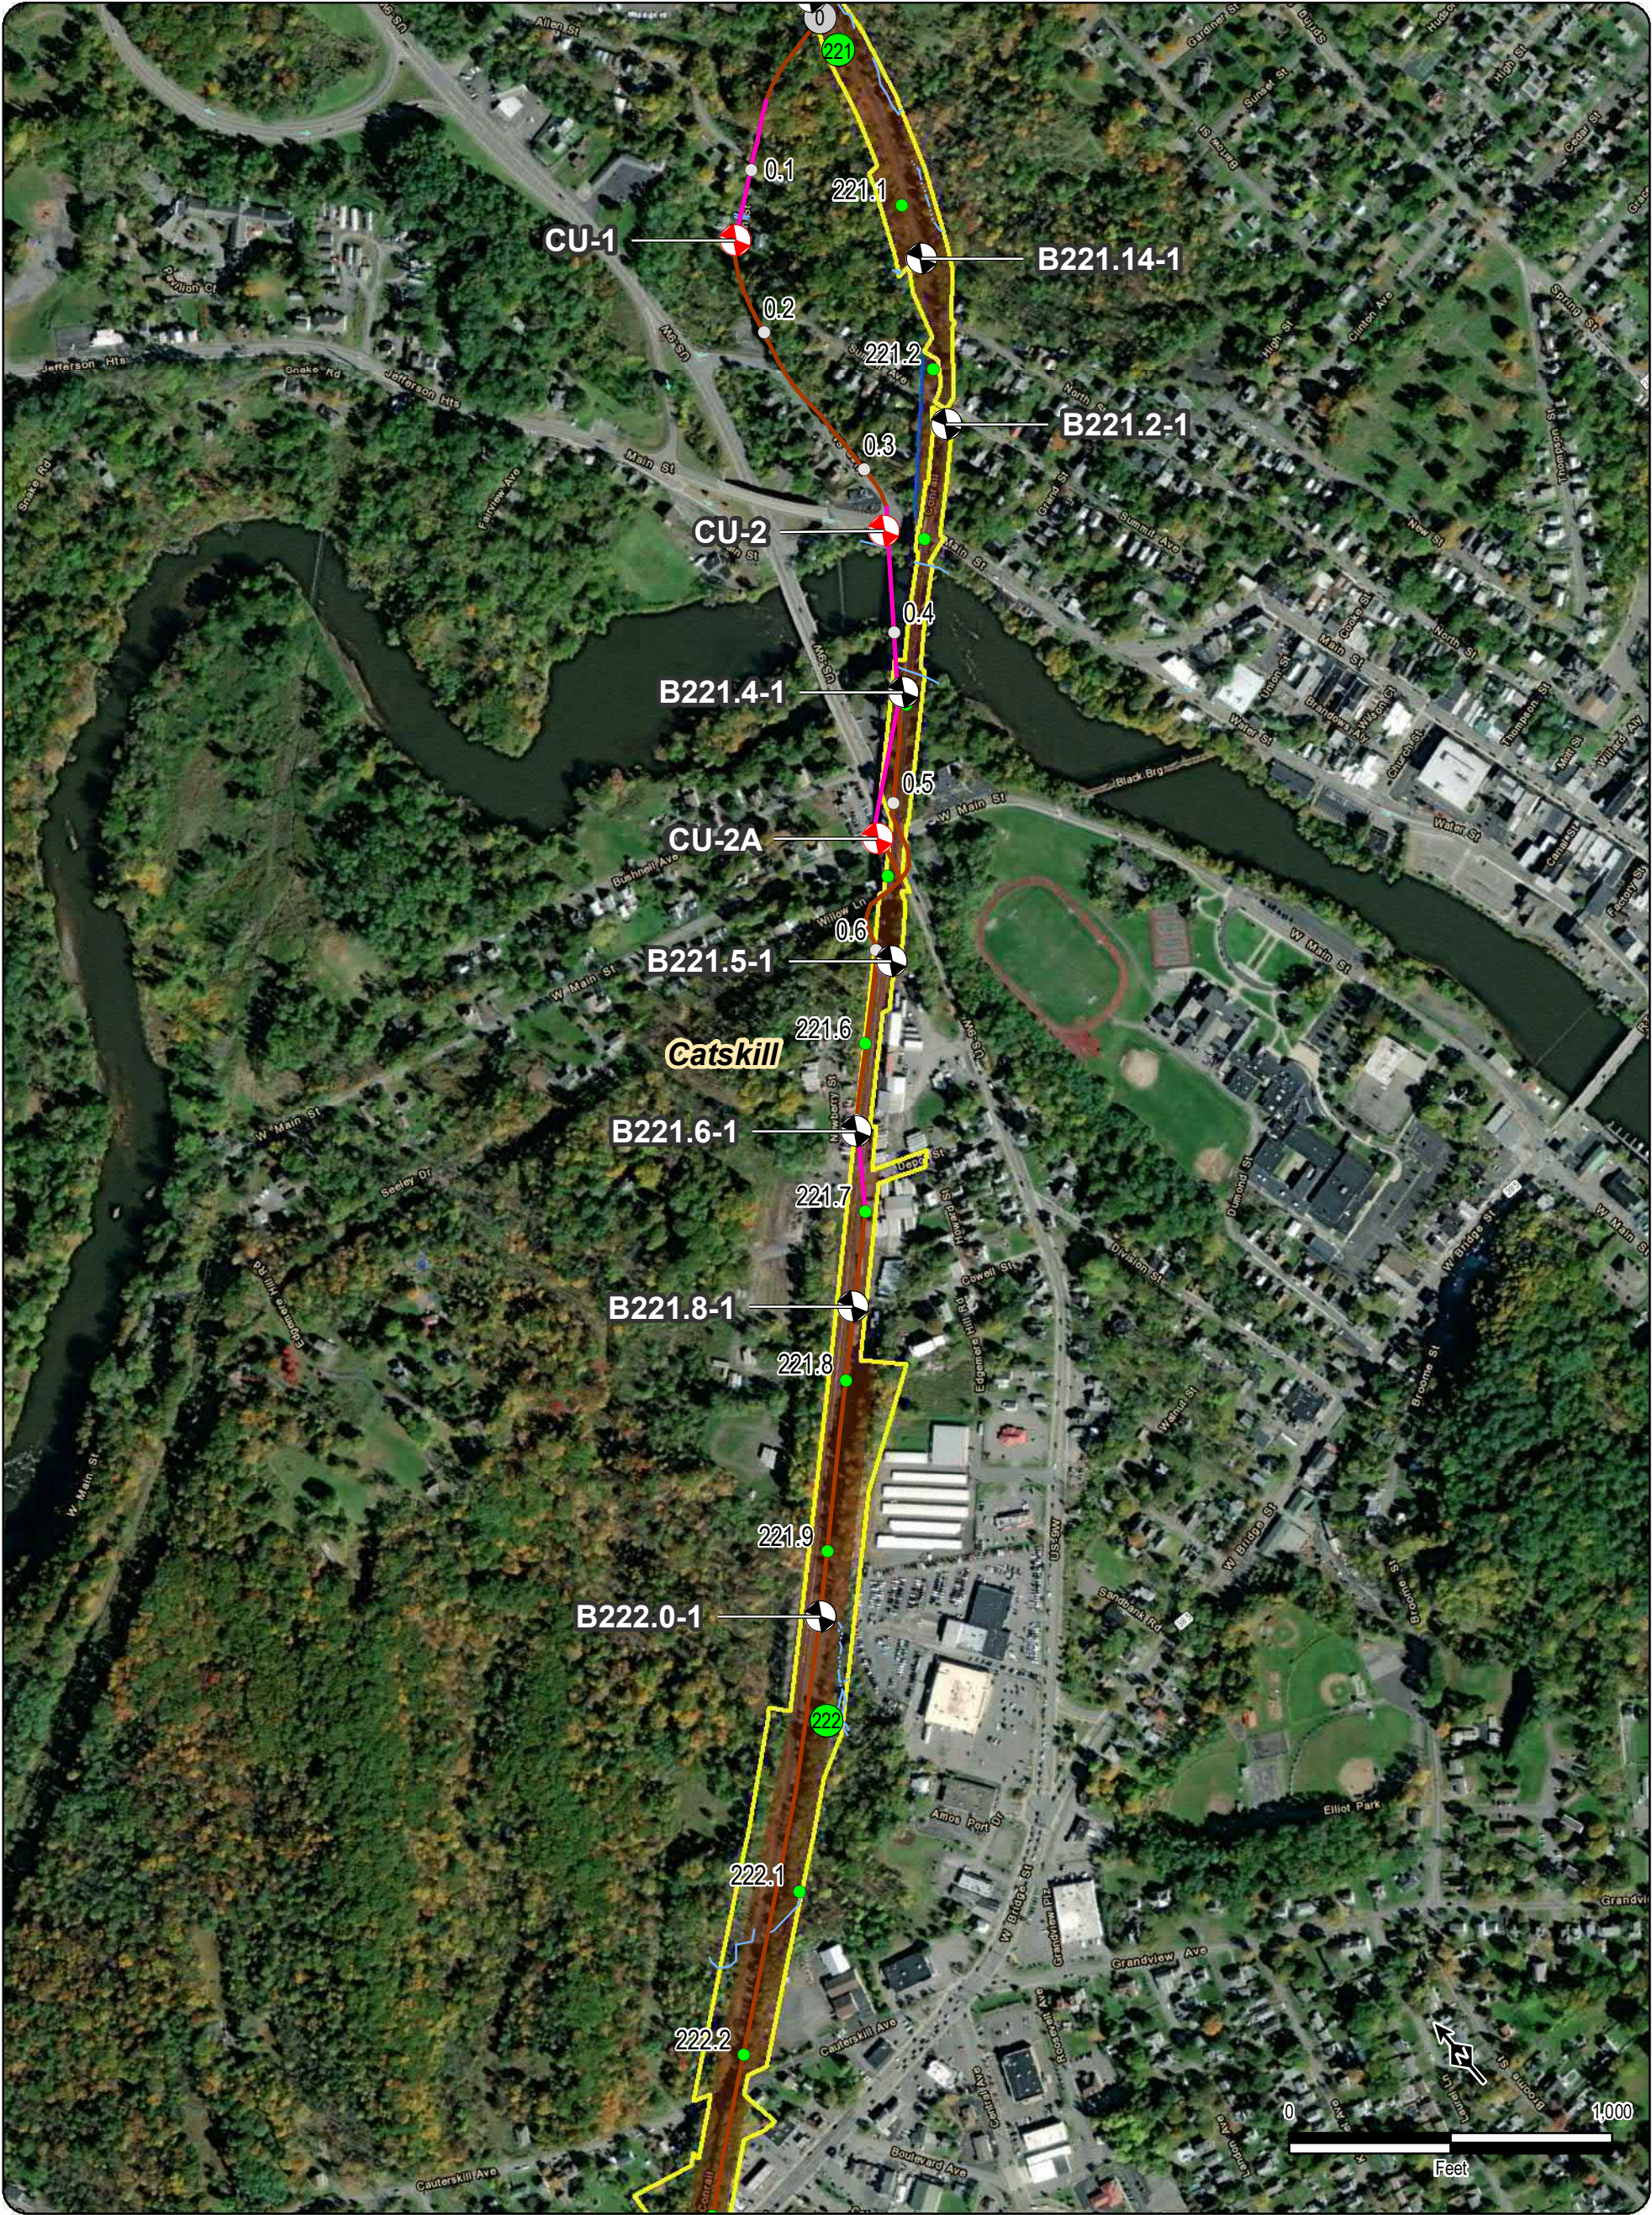

TEST BORING LOG

PROJECT: TDI CHAMPLAIN HUDSON POWER EXPRESS

LOCATION: CSX RAILROAD ROW, NY

BORING B221.8-1

G.S. ELEV. N/A

FILE 195651

SHEET 1 OF 1

GROUNDWATER DATA

FIRST ENCOUNTERED NR			
DEPTH	HOUR	DATE	ELAPSED TIME
15.0'	NR	11/20	0 HR

METHOD OF ADVANCING BOREHOLE

a	FROM	0.0'	TO	10.0'
d	FROM	10.0'	TO	20.0'

DRILLER	R. CARUSO
HELPER	C. SMART
INSPECTOR	C. POPPE
DATE STARTED	11/19/2012
DATE COMPLETED	11/19/2012

DEPTH	A	B	C	DESCRIPTION	Wn	REMARKS
	S-1	32 50/0.1		GRAY F/C GRAVEL-SIZED ROCK FRAGMENTS, SM SILT, SM F/M SAND		
			2.0			
5	S-2	11 4 4 5		BROWN CLAYEY SILT, TR TO SM M/C/F SAND, TR F/ GRAVEL	35.0	
	S-3	5 4 4 5				
	S-4	2 2 3 3			38.2	
10	S-5	4 3 5 4			40.2	
				GRAY SILTY CLAY, TR F/M SAND		
15	S-6	4 3 4			49.5	
20	S-7	3 4 4	20.0	END OF BORING AT 20'		
25						
30						
35						

NEW PROJECTS TEST BORING LOG 195651_TDI_CSX.GPJ SITE BLAUVELT.GDT 3/12/13

DRN. TBT
CKD. PWK




SUMMARY OF LABORATORY TEST DATA

Project Name: TDI Champlain Hudson Power Express – CSX
 Client Name: Transmission Developers, Inc.
 TRC Project #: 195651

SAMPLE IDENTIFICATION			Soil Group (USCS System)	GRAIN SIZE DISTRIBUTION				PLASTICITY				Specific Gravity	Moisture Content (%)	Unit Weight (pcf)	Compressive Strength (tsf)	Organic Content (%)
Boring #	Sample #	Depth (ft)		Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Liquidity Index					
	S-6	13.5-15.0	-	-	-	-	-	-	-	-	-	-	41.0	-	-	-
B221.8-1	S-2	2.0-4.0	CL-ML	3.8	11.4	84.8		-	-	-	-	-	35.0	-	-	-
	S-4	6.0-8.0	-	-	-	-	-	-	-	-	-	-	38.2	-	-	-
	S-5	8.0-10.0	CL	5.5		33.9	60.6	41	20	21	1.0	2.78	40.2	-	-	-
	S-6	13.5-15.0	-	-		-	-	-	-	-	-	-	49.5	-	-	-
B222.0-1	S-2	2.0-4.0	ML	0.4	15.3	84.3		-	-	-	-	-	22.3	-	-	-
	S-3	4.0-6.0														
	S-4	6.0-8.0	-	-	-	-	-	-	-	-	-	-	2.8	-	-	-
	S-5	8.0-10.0	GW-GM	71.1	17.8	11.1		-	-	-	-	-	3.5	-	-	-
	S-6	13.5-15.0														
	S-7	18.5-20.0	-	-	-	-	-	-	-	-	-	-	23.2	-	-	-

LIQUID AND PLASTIC LIMITS TEST REPORT

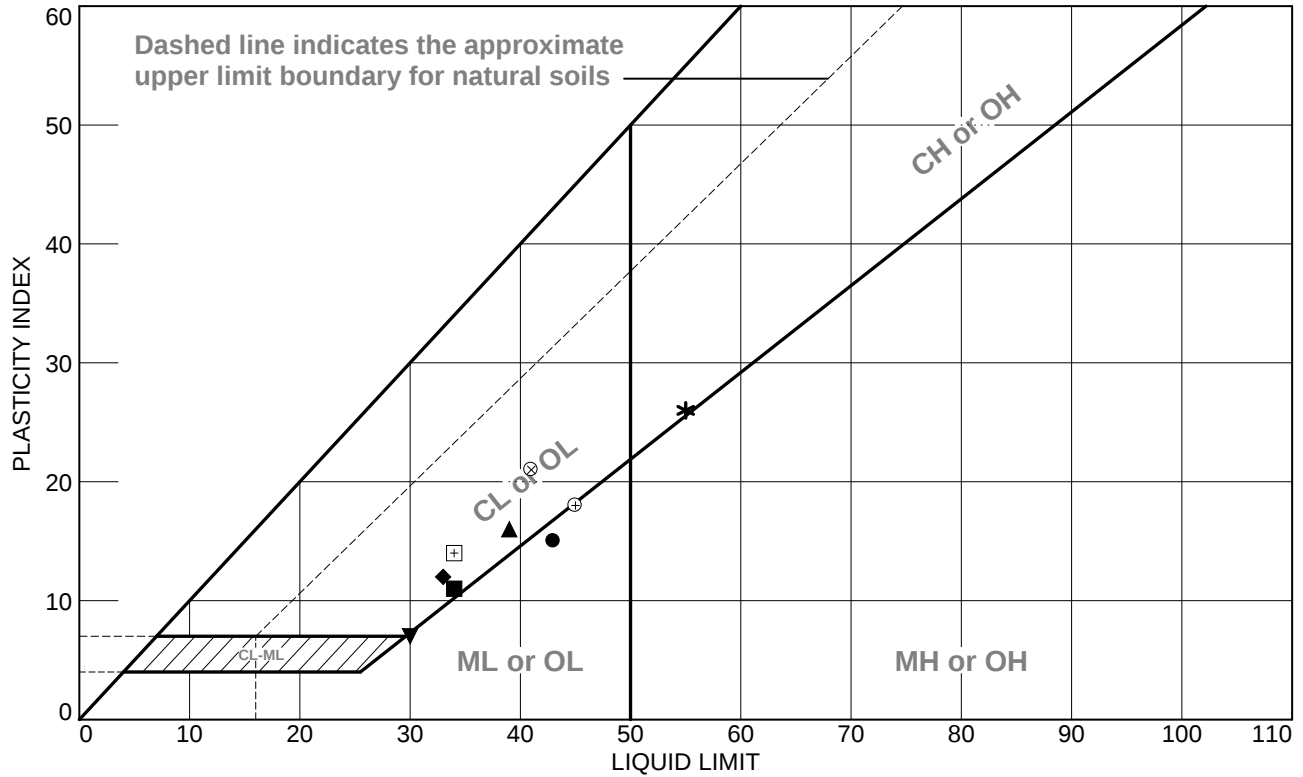

SOIL DATA

	SOURCE	SAMPLE NO.	DEPTH	NATURAL WATER CONTENT (%)	PLASTIC LIMIT (%)	LIQUID LIMIT (%)	PLASTICITY INDEX (%)	USCS
●	A219.05-1	S-6	13.5-15.0 FT	36.0	28	43	15	ML
■	B219.5-1	S-7	18.5-20.0 FT	28.3	23	34	11	CL
▲	B220.3-1	S-6	13.5-15.0 FT	34.8	23	39	16	CL
◆	B220.3-1	S-7 & S-8	18.5-25.0 FT	26.9	21	33	12	CL
▼	B220.7-1	S-4 & S-5	6.0-10.0 FT	15.4	23	30	7	ML
*	B221.5-1	S-4 & S-5	6.0-10.0 FT	34.3	29	55	26	CH
⊕	B221.5-1	S-9	28.5-30.0 FT	38.2	27	45	18	CL/ML
⊞	B221.6-1	S-3, S-4, & S-5	4.0-10.0 FT	38.8	20	34	14	CL
⊗	B221.8-1	S-5	8.0-10.0 FT	40.2	20	41	21	CL


TRC
Engineers, Inc.
Mt. Laurel, NJ

Client: TRANSMISSION DEVELOPERS INC.
Project: TDI CHAMPLAIN HUDSON POWER EXPRESS - CSX

Project No.: 195651

Figure 8

Particle Size Distribution Report

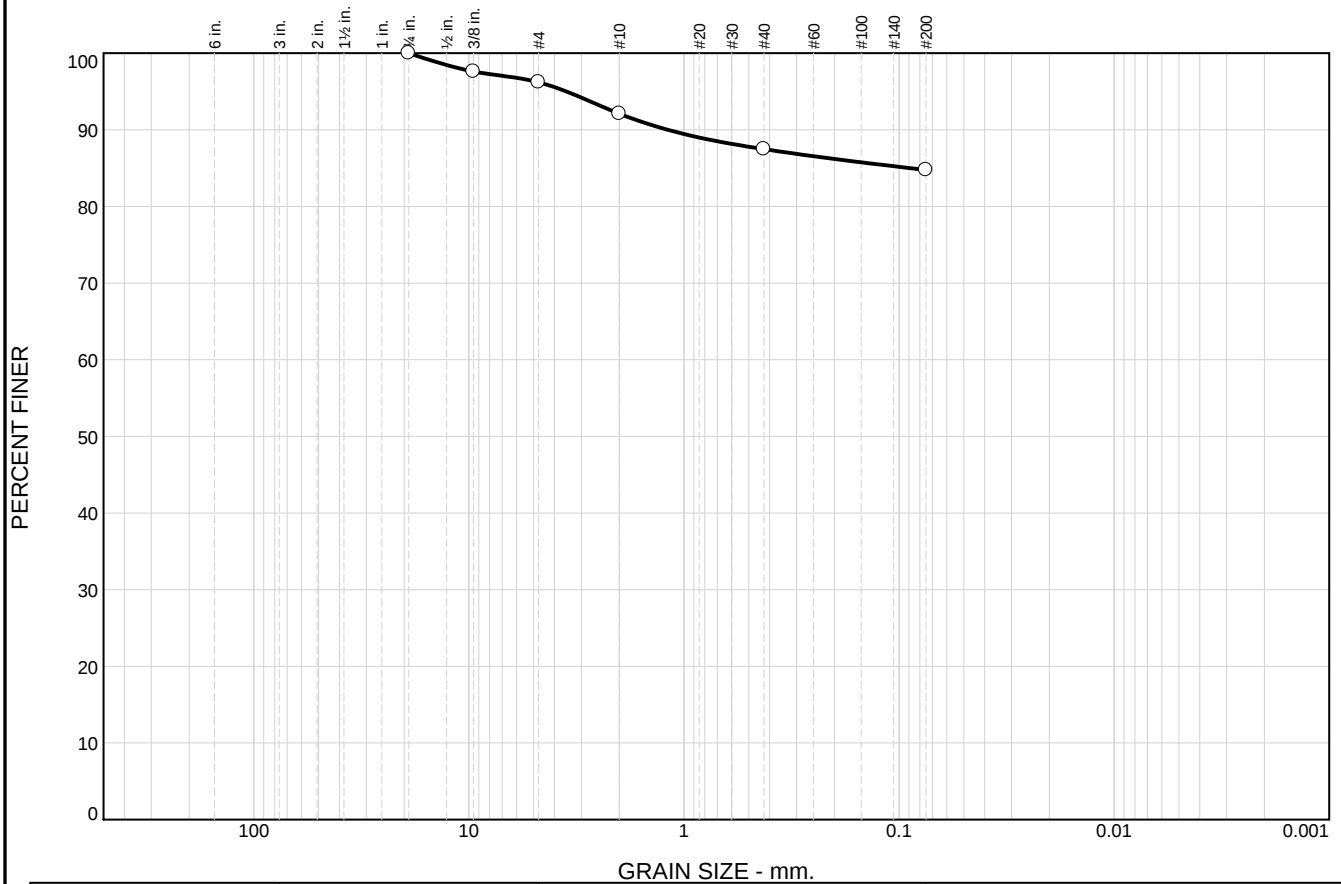


GRAIN SIZE - mm.											
% +3"		% Gravel		% Sand			% Fines				
		Coarse	Fine	Coarse	Medium	Fine	Silt		Clay		
○	0.0		0.0	3.8	4.1	4.6	2.7	84.8			
×	LL	PL	D ₈₅	D ₆₀	D ₅₀	D ₃₀	D ₁₅	D ₁₀	C _c	C _u	
○			0.0887								
Material Description								USCS		AASHTO	
○ BROWN CLAYEY SILT, TR TO SM M/C/F SAND, TR F/ GRAVEL											
Project No. 195651 Client: TRANSMISSION DEVELOPERS INC. Project: TDI CHAMPLAIN HUDSON POWER EXPRESS - CSX ○ Source of Sample: B221.8-1 Depth: 2.0-4.0 FT Sample Number: S-2								Remarks: ○SAMPLE DESCRIPTION BASED ON VISUAL IDENTIFICATION AND LABORATORY ANALYSIS			
TRC Engineers, Inc.								Figure 122			
Mt. Laurel, NJ											

Figure 122

Tested By: TBT 12/19/12 Checked By: JPB 03/12/13


Particle Size Distribution Report

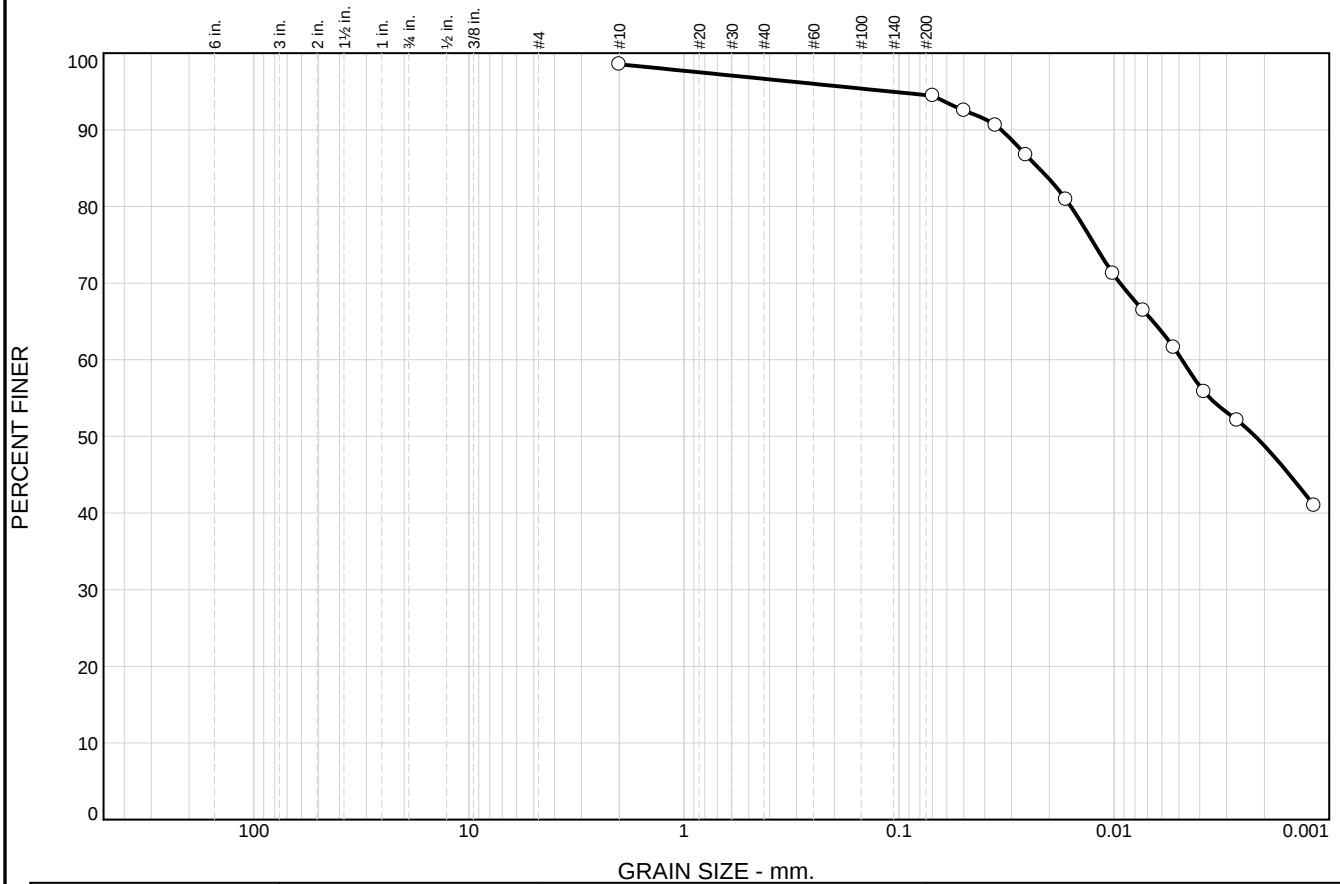

GRAIN SIZE - mm.										
% +3"		% Gravel		% Sand			% Fines			
		Coarse	Fine	Coarse	Medium	Fine	Silt		Clay	
					1.9	2.2	33.9		60.6	
☒	LL	PL	D ₈₅	D ₆₀	D ₅₀	D ₃₀	D ₁₅	D ₁₀	C _c	C _u
☐	41	20	0.0224	0.0048	0.0022					
Material Description								USCS	AASHTO	
☐ GRAY SILTY CLAY, TR F/M SAND								CL	A-7-6(21)	
Project No. 195651 Client: TRANSMISSION DEVELOPERS INC. Project: TDI CHAMPLAIN HUDSON POWER EXPRESS - CSX ☐ Source of Sample: B221.8-1 Depth: 8.0-10.0 FT Sample Number: S-5								Remarks: ☐ SAMPLE DESCRIPTION BASED ON VISUAL IDENTIFICATION AND LABORATORY ANALYSIS		
TRC Engineers, Inc. Mt. Laurel, NJ										

Figure 123

Tested By: TBT 12/20/12 Checked By: JPB 03/12/13

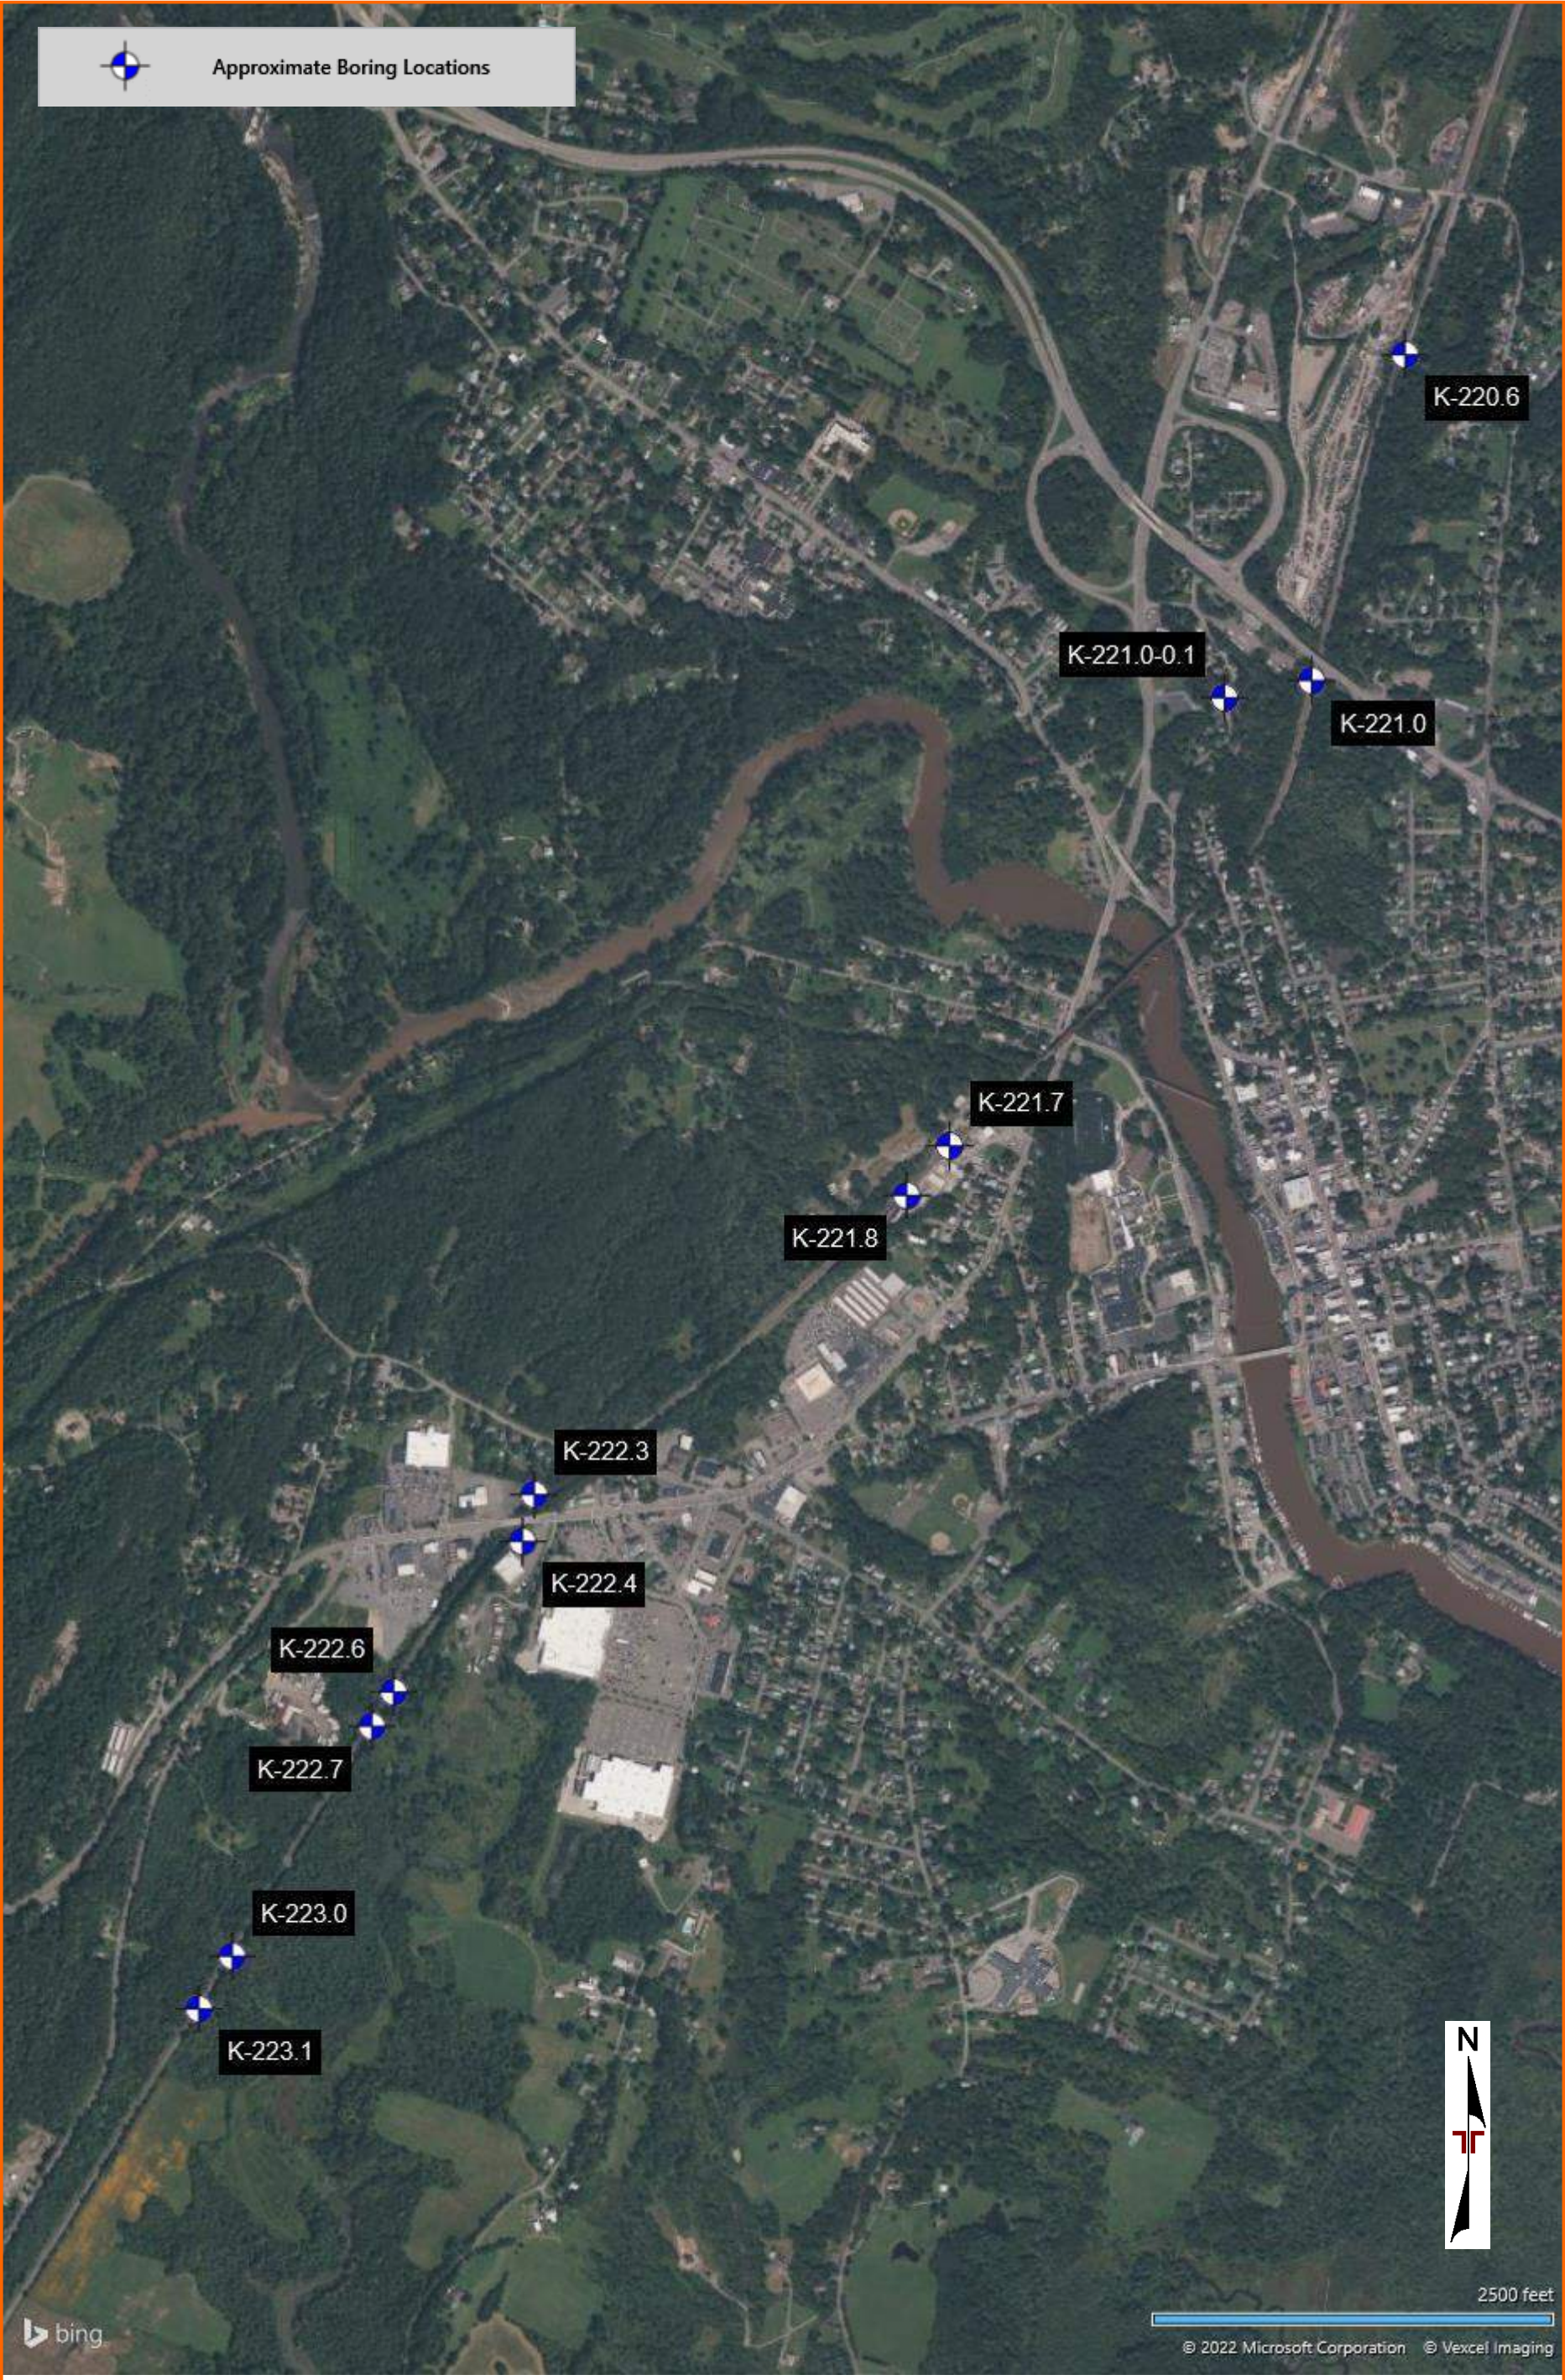

BORING LOG NO. K-221.8






Page 1 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL. JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES
	Latitude: 42.219928° Longitude: -73.875350°								LL-PL-PI	
DEPTH			ELEVATION (Ft.)							
	<u>FILL - BALLAST WITH SAND</u> , black, medium dense					20	6-8-6-12 N=14			
	2.0	97.5				15	9-5-3-3 N=8			
	<u>FILL - CINDERS, CLAY AND SILT</u> , black, medium stiff									
	4.0	95.5				14	1-1-1-3 N=2			
	<u>SILT AND CLAY (CL-ML)</u> , brown, very soft to soft		5			0	WOH-1-2-1			
	8.0	91.5				0	2-1-2-1 N=3	40.2	37-19-18	91
	<u>LEAN CLAY (CL)</u> , brown, soft									
	10.0	89.5	10			24	1-1-1-1 N=2			
	<u>LEAN CLAY WITH SAND (CL)</u> , gray, very soft to soft									
			15			15	1-1-2-1 N=3			
			20			24	WOH-WOH-1-1	36.0		
			25							

Stratification lines are approximate. In-situ, the transition may be gradual.

Hammer Type: Automatic

Advancement Method:
4 1/4 HSA

See [Exploration and Testing Procedures](#) for a description of field and laboratory procedures used and additional data (if any).

Notes:

Logged By MO
Hammer Efficiency Summary:
Energy Transfer Ratio: 86.9% +/-2.2%
Hammer Efficiency Correction (CE):1.52
WOH = Weight of Hammer

Abandonment Method:
Backfilled with bentonite grout upon completion

See [Supporting Information](#) for explanation of symbols and abbreviations.

Elevations were provided by Kiewit.

WATER LEVEL OBSERVATIONS

No measurable groundwater prior to grouting

Terracon
30 Corporate Cir Ste 201
Albany, NY

Boring Started: 03-15-2022

Boring Completed: 03-15-2022

Drill Rig: Mobile B-57

Driller: S. Kahn

Project No.: JB215256D


BORING LOG NO. K-221.8

Page 2 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.


SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES
	Latitude: 42.219928° Longitude: -73.875350°								LL-PL-PI	
DEPTH		ELEVATION (Ft.)								
	LEAN CLAY WITH SAND (CL) , gray, very soft to soft (<i>continued</i>)				X	24	WOH-WOH-WOH-WOH			
			30		X		WOH-WOH-WOH-WOH			
			35		X	1	WOH-WOH-1-2 3" Split Spoon With Ring Samplers	48.3	44-22-22	80
					X	24	WOH-WOH-WOH-WOH			
	40.0	59.5	40							
Boring Terminated at 40 Feet										
Stratification lines are approximate. In-situ, the transition may be gradual.						Hammer Type: Automatic				
Advancement Method: 4 1/4 HSA			See Exploration and Testing Procedures for a description of field and laboratory procedures used and additional data (If any).			Notes: Logged By MO Hammer Efficiency Summary: Energy Transfer Ratio: 86.9% +/-2.2% Hammer Efficiency Correction (CE):1.52 WOH = Weight of Hammer				
Abandonment Method: Backfilled with bentonite grout upon completion			See Supporting Information for explanation of symbols and abbreviations. Elevations were provided by Kiewit.							
WATER LEVEL OBSERVATIONS			 30 Corporate Cir Ste 201 Albany, NY			Boring Started: 03-15-2022		Boring Completed: 03-15-2022		
No measurable groundwater prior to grouting						Drill Rig: Mobile B-57		Driller: S. Kahn		
						Project No.: JB215256D				

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

ATTERBERG LIMITS RESULTS

ASTM D4318

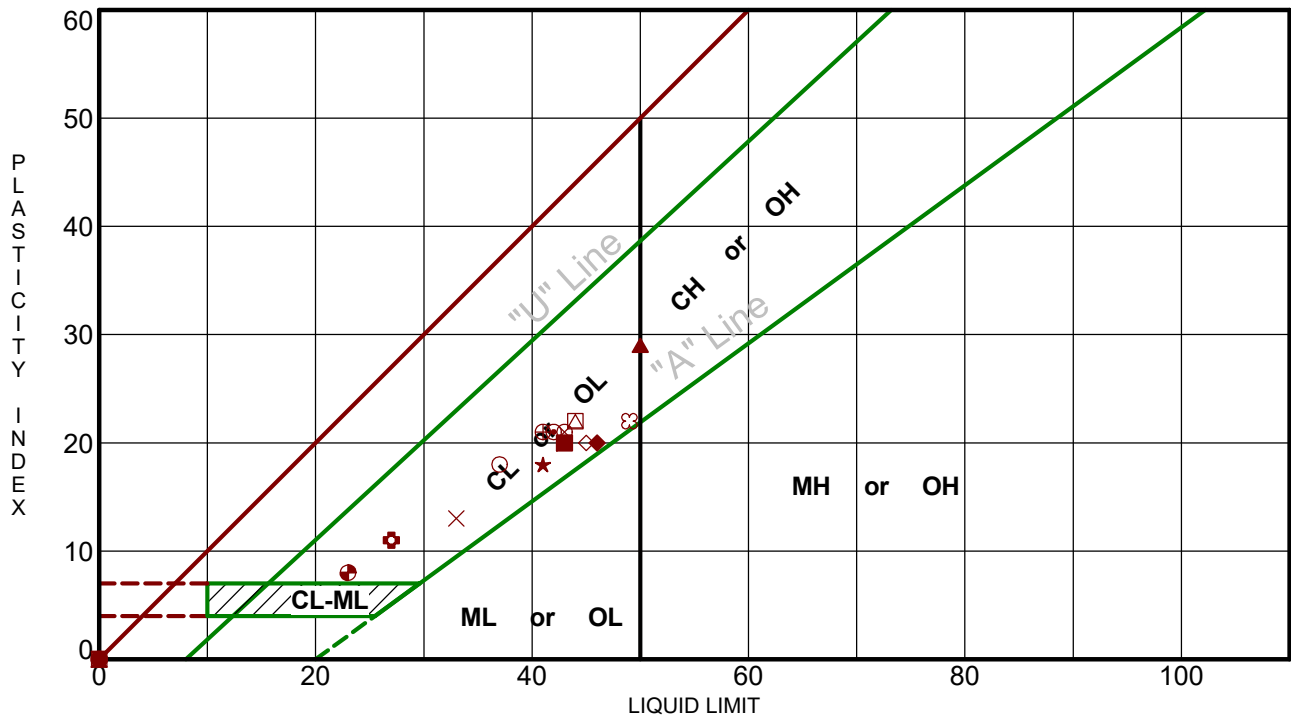

Boring ID	Depth (Ft)	LL	PL	PI	Fines	USCS	Description
● K-220.6	6 - 8	NP	NP	NP	22.1	GM	SILTY GRAVEL with SAND
⊠ K-220.6	13 - 15	NP	NP	NP	11.9	SW-SM	WELL-GRADED SAND with SILT and GRAVEL
▲ K-221.0	8 - 10	50	21	29	73.4	CH	FAT CLAY with SAND
★ K-221.0	23 - 25	41	23	18	89.8	CL	LEAN CLAY
⊙ K-221.7	10 - 12	42	21	21	93.6	CL	LEAN CLAY
⊕ K-221.7	33 - 35	27	16	11	58.8	CL	SANDY LEAN CLAY
○ K-221.8	8 - 10	37	19	18	91.3	CL	LEAN CLAY
△ K-221.8	35 - 37	44	22	22	79.7	CL	LEAN CLAY with SAND
⊗ K-222.3	6 - 8	43	22	21	59.8	CL	SANDY LEAN CLAY
⊕ K-222.3	10 - 12	41	20	21	69.6	CL	SANDY LEAN CLAY
□ K-222.4	10 - 12	44	22	22	87.3	CL	LEAN CLAY
⊕ K-222.6	15 - 17	NP	NP	NP	6.5	GW-GM	WELL-GRADED GRAVEL with SILT and SAND
⊕ K-222.6	35 - 37	23	15	8	86.7	CL	LEAN CLAY
★ K-222.7	10 - 12	NP	NP	NP	25.3	GM	SILTY GRAVEL with SAND
⊗ K-222.7	25 - 27	49	27	22	76.3	CL	LEAN CLAY with SAND
■ K-223.0	10 - 12	43	23	20	58.5	CL	SANDY LEAN CLAY
◆ K-223.0	25 - 27	46	26	20	84.9	CL	LEAN CLAY with SAND
◇ K-223.1	15 - 17	45	25	20	71.3	CL	LEAN CLAY with SAND
× K-223.1	29 - 31	33	20	13	98.3	CL	LEAN CLAY

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

Terracon
30 Corporate Cir Ste 201
Albany, NY


PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. ATTERBERG LIMITS JB215256D CHAMPLAIN-HUDSON GPJ TERRACON DATATEMPLATE.GDT 5/12/22

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

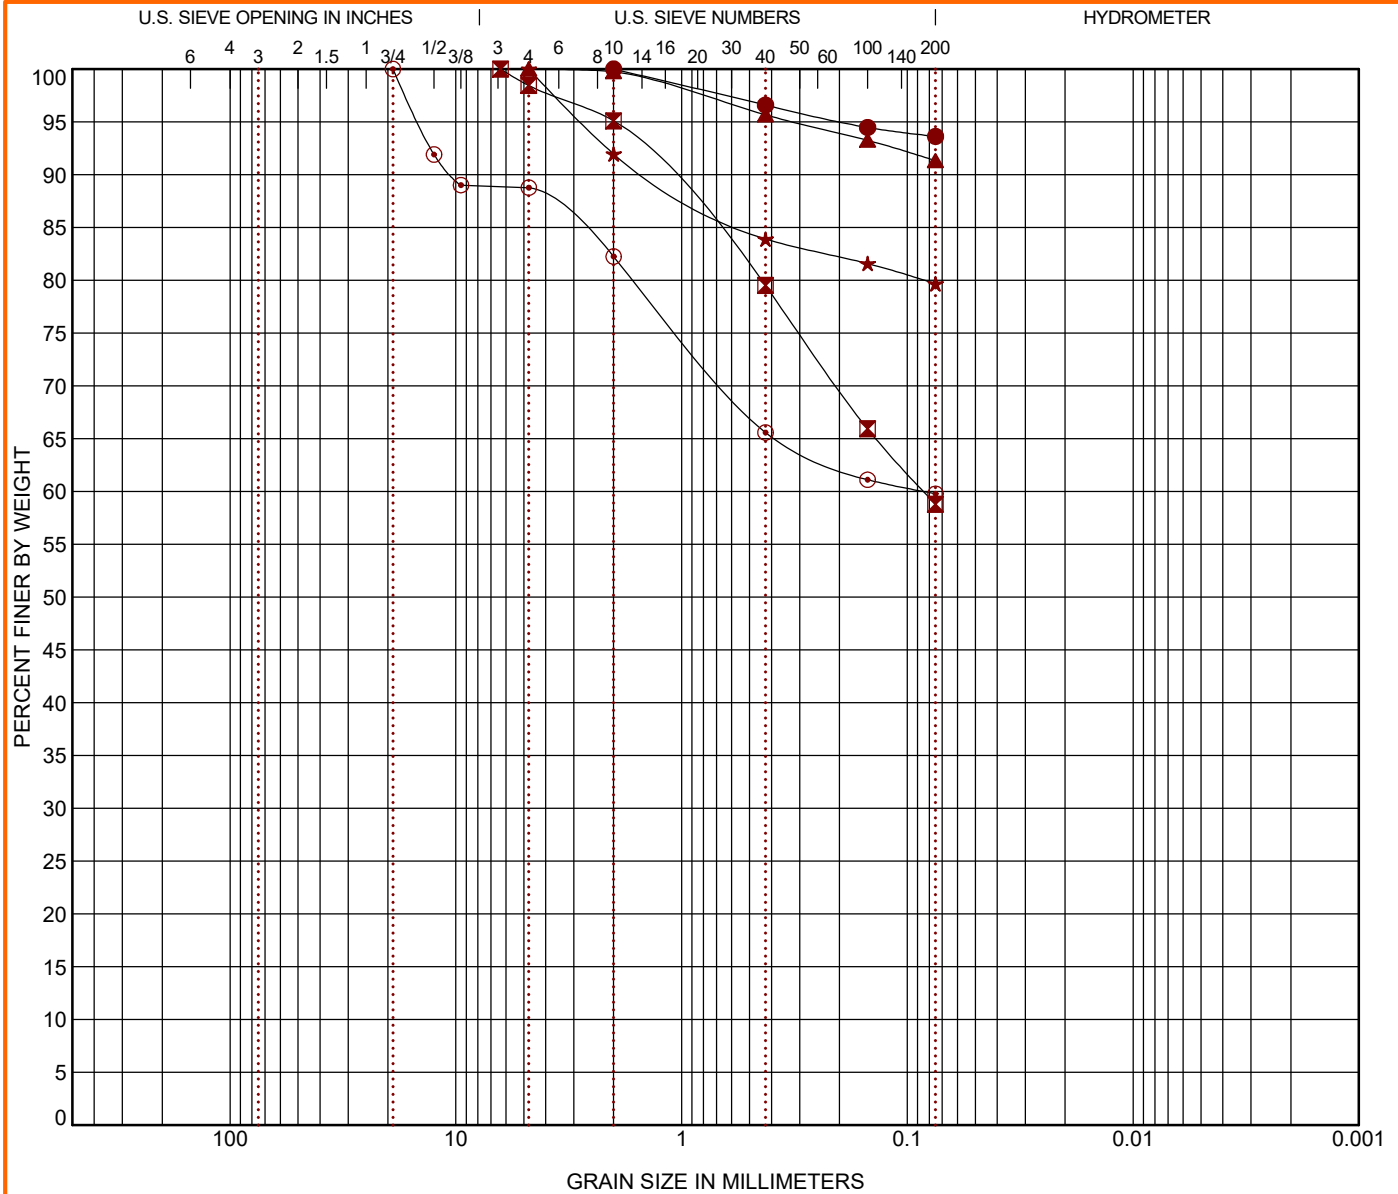

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID	Depth (Ft)	USCS Classification				WC (%)	LL	PL	PI	Cc	Cu
● K-221.7	10 - 12	LEAN CLAY (CL)				41.7	42	21	21		
✠ K-221.7	33 - 35	SANDY LEAN CLAY (CL)				23.8	27	16	11		
▲ K-221.8	8 - 10	LEAN CLAY (CL)				40.2	37	19	18		
★ K-221.8	35 - 37	LEAN CLAY with SAND (CL)				48.3	44	22	22		
⊙ K-222.3	6 - 8	SANDY LEAN CLAY (CL)				25.9	43	22	21		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay
● K-221.7	10 - 12	2				0.0	0.0	6.4		93.6	
✠ K-221.7	33 - 35	6.35	0.084			0.0	1.6	39.6		58.8	
▲ K-221.8	8 - 10	4.75				0.0	0.0	8.7		91.3	
★ K-221.8	35 - 37	4.75				0.0	0.0	20.3		79.7	
⊙ K-222.3	6 - 8	19	0.084			0.0	11.2	29.0		59.8	

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

Terracon
30 Corporate Cir Ste 201
Albany, NY

PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256D CHAMPLAIN-HUDSON.GPJ TERRACON_DATATEMPLATE.GDT 5/12/22



Package 7A Phase 4 Borings

Champlain Hudson Power Express
New York

PROJECT NUMBER 20001480

CREATED BY	Kiewit
DATE	02/17/2023

Legend Key

● Kiewit Borings





Kiewit

EXPLORATORY BORING LOG

Champlain Hudson Power Express
New York

BORING NO: KB-221.8B

PROJECT NUMBER 20001480
START DATE 01/16/2023
FINISH DATE 01/17/2023

LOGGED BY S. Ahmad
DRILLER/RIG Eric / Geoprobe 7822DT
DRILL CONTRACTOR ADT Inc.

COORDINATES N 1234009.68
E 661045.34
GROUND ELEV. 101.0 ft
HAMMER TYPE/EFF. Automatic

Depth (ft)	Elevation (ft)	Graphic Log	Material Description	Sample Type	Core Run No.	Recovery %	RQD	Pocket Pen. (tsf)	Blow Counts (N Value)	Notes	Legend			
											▲	●	—	■
			SILT (ML), gray, soft to very soft, moist		10	100%			0-0-0-0 (0)					
35	66.0		SILT (MH), gray, very soft, moist		11	100%			0-0-0-0 (0)					
40					1	100%			0-0-0-0	3-inch ring sampler				
45	56.0		SILT (ML), gray, very soft, moist		12	100%			0-0-0-0 (0)					
50					13	100%			0-0-0-0 (0)					
55					14	100%			0-0-0-0 (0)					
60														



Kiewit

EXPLORATORY BORING LOG

Champlain Hudson Power Express
New York

BORING NO: KB-221.8B

PROJECT NUMBER 20001480

LOGGED BY S. Ahmad

COORDINATES N 1234009.68
E 661045.34

START DATE 01/16/2023

DRILLER/RIG Eric / Geoprobe 7822DT

GROUND ELEV. 101.0 ft

FINISH DATE 01/17/2023

DRILL CONTRACTOR ADT Inc.

HAMMER TYPE/EFF. Automatic

Depth (ft)	Elevation (ft)	Graphic Log	Material Description	Sample Type	Core Run No.	Recovery %	RQD	Pocket Pen. (tsf)	Blow Counts (N Value)	Notes	Legend			
											▲ SPT N Value	● MC (%)	— PL & LL (%)	☒ Fines Content (%)
			SILT (ML), gray, very soft, moist		15	100%			0-0-0-0 (0)	Boring extended due to soft soils				
65														
70					16	100%			0-0-0-0 (0)					
75														
80					17	100%			0-0-0-0 (0)					
19.0			Boring Terminated at 82ft											
85														
90														

SOIL LEGEND

Explanation of Symbols and Terms Used on Boring and Test Pit
Logs for Sampling and Description of Soils

SAMPLE AND DRILL METHODS		COMMON ABBREVIATIONS AND ACRONYMS			
	Standard Penetration Split-Spoon Sample	MR	Mud Rotary	Bulk	Bulk Sample
	Undisturbed Sample	HSA	Hollow Stem Auger	EOB	End of Boring
	Piston Sampler	SSA	Solid Stem Auger	AR	Auger Refusal
	Grab Sample	SS	Split Spoon Sampler	N-Value	Sum of blows for last two 6-in. increments of SPT
	Bulk Sample	UD	Undisturbed Sample	USCS	Unified Soil Classification System
	Auger Cuttings	WOR	Weight of Rods		
	Rock Core	WOH	Weight of Hammer		
	Modified California Sample	SPT	Standard Penetration Test		
WATER LEVEL SYMBOLS		REC	Recovery		
	Observation at time of drilling	RQD	Rock Quality Designation		
	Observation after drilling	MC	Moisture Content		
	Delayed observation	PI	Plasticity Index		
	Perched water observed at drilling	PL	Plastic Limit		
	Observed Seepage	LL	Liquid Limit		
	Cave-in Depth	CPT	Cone Penetration Test		
		PP	Pocket Penetrometer		

CROSS SECTION LEGEND	
	N(bpf)
	Recovery %
	RQD %
	Material Symbol
% Moisture Content symbol" data-bbox="755 387 770 402"/>	% Moisture Content

RELATIVE DENSITY / CONSISTENCY				
Coarse-grained Soils		Fine-grained Soils		
N-Value	Density	N-Value	Consistency	Pocket Pen (TSF)
0 - 4	Very Loose	0 - 1	Very Soft	0.0 - 0.25
5 - 10	Loose	2 - 4	Soft	0.25 - 0.50
11 - 30	Medium	5 - 8	Firm	0.51 - 1.00
31 - 50	Dense	9 - 15	Stiff	1.01 - 2.00
> 50	Very Dense	16 - 30	Very Stiff	2.01-4.00
		> 30	Hard	> 4.00

RELATIVE PROPORTIONS OF GRAVEL, SAND, AND FINES	
Trace	> 5 %
Few	5 to 10 %
Little	15 to 25 %
Some	30 - 45 %
Mostly	50 to 100 %

SOIL GRAIN SIZE

U.S. Standard Sieve

6"	3"	3/4"	4"	10"	40"	200"		
Boulders	Cobbles	Gravel		Sand		Silt	Clay	
		Coarse	Fine	Coarse	Medium	Fine		
152	76.2	19.1	4.76	2.00	0.420	0.074	0.002	(mm)


CRITERIA FOR DESCRIBING MOISTURE CONDITION		CRITERIA FOR DESCRIBING CEMENTATION	
Description	Criteria	Description	Criteria
Dry	Absence of moisture, dusty, dry to the touch	Weak	Crumbles or breaks with handling or little finger pressure
Moist	Damp but no visible free water	Moderate	Crumbles or breaks with considerable finger pressure
Wet	Visible free water, typically soil is below water table	Strong	Will not crumble or break with finger pressure

CRITERIA FOR DESCRIBING STRUCTURE	
Description	Criteria
Stratified	Alternating layers of varying material or color with layers at least 1/4 in. thick; note thickness
Laminated	Alternating layers of varying material or color with the layers less than 1/4 in. thick; note thickness
Fissured	Breaks along definite planes of fracture with little resistance to fracturing
Slickensided	Fracture planes appear polished or glossy, sometimes striated
Blocky	Cohesive soil that can be broken down into small angular lumps which resist further breakdown
Lensed	Inclusion of small pockets of different soils, such as lenses of sand scattered through a mass of clay; note thickness
Homogeneous	Same color and appearance throughout

SOIL SYMBOLS

USCS SOIL TYPES		
Symbol	Group	Description
	GW	Well-graded gravels, gravel sand mixtures with trace or no fines
	GP	Poorly-graded gravels, gravel-sand mixtures with trace or no fines
	GW-GM	Well-graded gravels, gravel-sand mixtures with silt fines
	GW-GC	Well-graded gravels, gravel-sand mixtures with clay fines
	GP-GM	Poorly-graded gravels, gravel-sand mixtures with silt fines
	GP-GC	Poorly-graded gravels, gravel-sand mixtures with clay fines
	GM	Silty gravels, gravel-silt-sand mixtures
	GC	Clayey gravels, gravel-sand-clay mixtures
	GC-GM	Clayey gravels, gravel-sand-clay-silt mixtures
	SW	Well-graded sands, sand-gravel mixtures with trace or no fines
	SP	Poorly-graded sands, sand-gravel mixtures with trace or no fines
	SW-SM	Well-graded sands, sand-gravel mixtures with silt fines
	SW-SC	Well-graded sands, sand-gravel mixtures with clay fines
	SP-SM	Poorly-graded sands, sand-gravel mixtures with silt fines
	SP-SC	Poorly-graded sands, sand-gravel mixtures with clay fines
	SM	Silty sands, sand-gravel-silt mixtures
	SC	Clayey sands, sand-gravel-clay mixtures
	SC-SM	Clayey sands, sand-gravel-clay-silt mixtures
	ML	Inorganic silts with low plasticity
	CL	Inorganic clays of low plasticity, gravelly or sandy clays, silty clays, lean clays
	CL-ML	Inorganic clay-silts of low plasticity, gravelly clays, sandy clays, silty clays, lean clays
	OL	Organic silts and organic silty clays of low plasticity
	MH	Inorganic silts of high plasticity, elastic silts
	CH	Inorganic clays of high plasticity, fat clays
	OH	Organic clays and organic silts of high plasticity
	PT	Peat, humus, swamp soils with high organic contents

OTHER MATERIALS	
Symbol	Description
	Asphalt
	Concrete
	Crushed Stone/Aggregate Base
	Fill

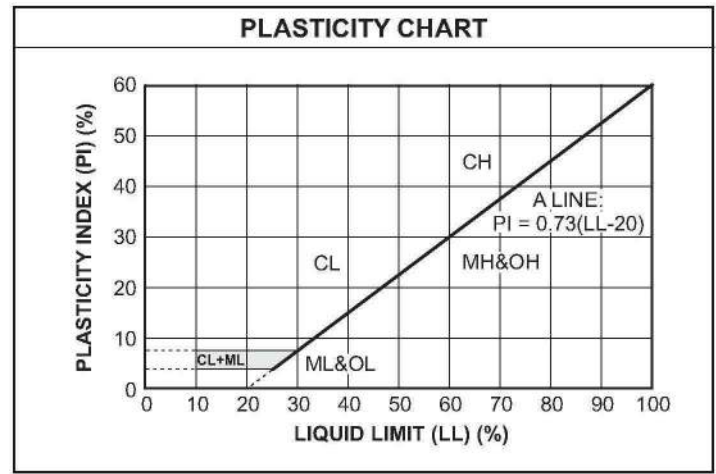


Sheet 1 of 1

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. SMART LAB SUMMARY-PORTRAIT JB215256H LAB TESTING.GPJ TERRACON DATATEMPLATE.GDT 2/14/23

ATTERBERG LIMITS RESULTS

ASTM D4318

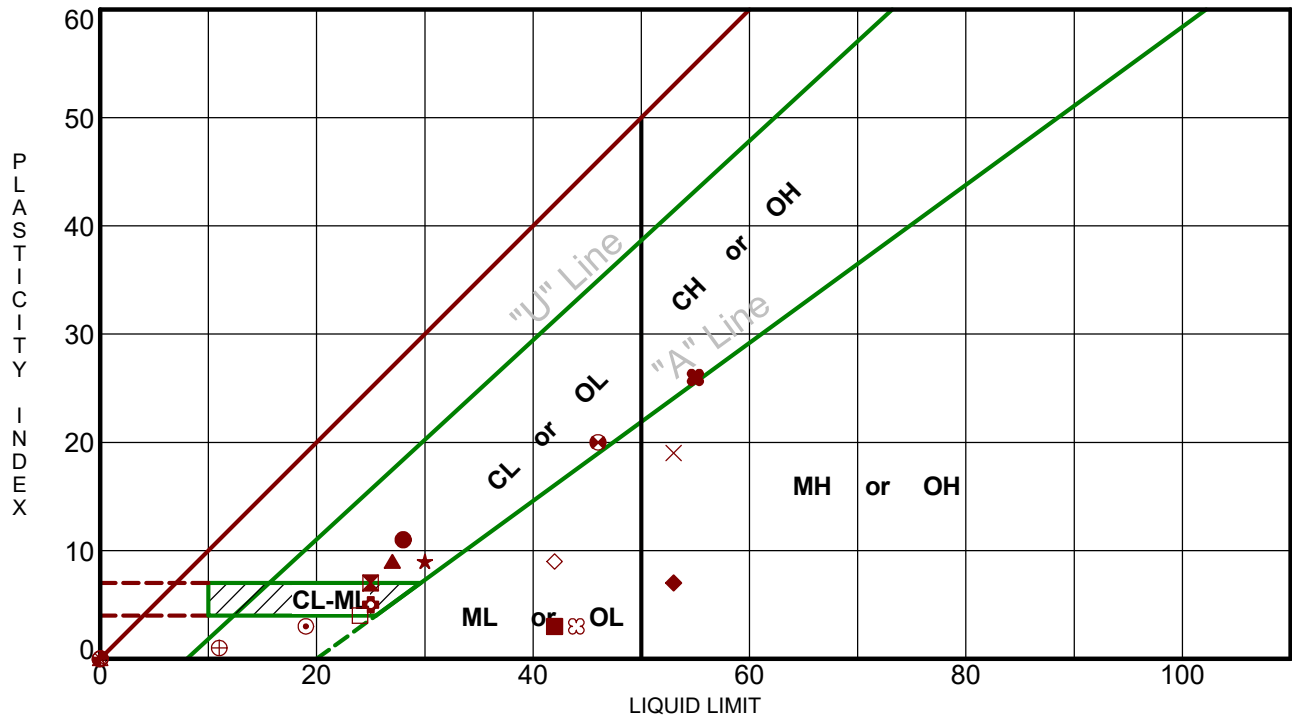

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. ATTERBERG LIMITS JB215256H LAB TESTING.GPJ TERRACON.DATATEMPLATE.GDT 2/14/23

Boring ID	Depth (Ft)	LL	PL	PI	Fines	USCS	Description
● KB-169.0-1.0	20 - 22	28	17	11	93.4	CL	LEAN CLAY
⊠ KB-169.0-1.0	35 - 37	25	18	7	97.1	CL-ML	SILTY CLAY
▲ KB-169.0-1.0	50 - 52	27	18	9	99.4	CL	LEAN CLAY
★ KB-169.0-2.4	20 - 22	30	21	9	73.6	ML	SANDY SILT
⊙ KB-169.0-2.4	35 - 37	19	16	3	87.9	ML	SILT
⊕ KB-169.0-2.5	30 - 32	25	20	5	92.5	CL-ML	SILTY CLAY
○ KB-169.0-2.5	40 - 42	NP	NP	NP	95.7	ML	SILT
△ KB-169.0-3.6	4 - 6	NP	NP	NP	8.8	GP-GM	POORLY GRADED GRAVEL with SILT and SAND
⊗ KB-169.0-3.6	50 - 52	NP	NP	NP	43.6	SM	SILTY SAND
⊕ KB-169.0-3.7	60 - 62	11	10	1	39.1	SM	SILTY SAND
□ KB-221.0B	4 - 6	24	20	4	16.9	SC-SM	SILTY, CLAYEY SAND with GRAVEL
● KB-221.0B	10 - 12	46	26	20	96.3	CL	LEAN CLAY
⊕ KB-221.0B	30 - 32	NP	NP	NP	96.0	ML	SILT
★ KB-221.0B	50 - 52	NP	NP	NP	99.4	ML	SILT
⊗ KB-221.8B	4 - 6	44	41	3	72.3	ML	SILT with GRAVEL
■ KB-221.8B	20 - 22	42	39	3	98.3	ML	SILT
◆ KB-221.8B	35 - 37	53	46	7	95.5	MH	ELASTIC SILT
◇ KB-221.8B	55 - 57	42	33	9	99.6	ML	SILT
× KB-222.8	6 - 8	53	34	19	97.5	MH	ELASTIC SILT
■ KB-222.8	20 - 22	55	29	26	92.8	CH	FAT CLAY

PROJECT: Lab Testing

SITE: Champlain to Hudson Power Express

Terracon
30 Corporate Cir Ste 201
Albany, NY


PROJECT NUMBER: JB215256H

CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-1

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

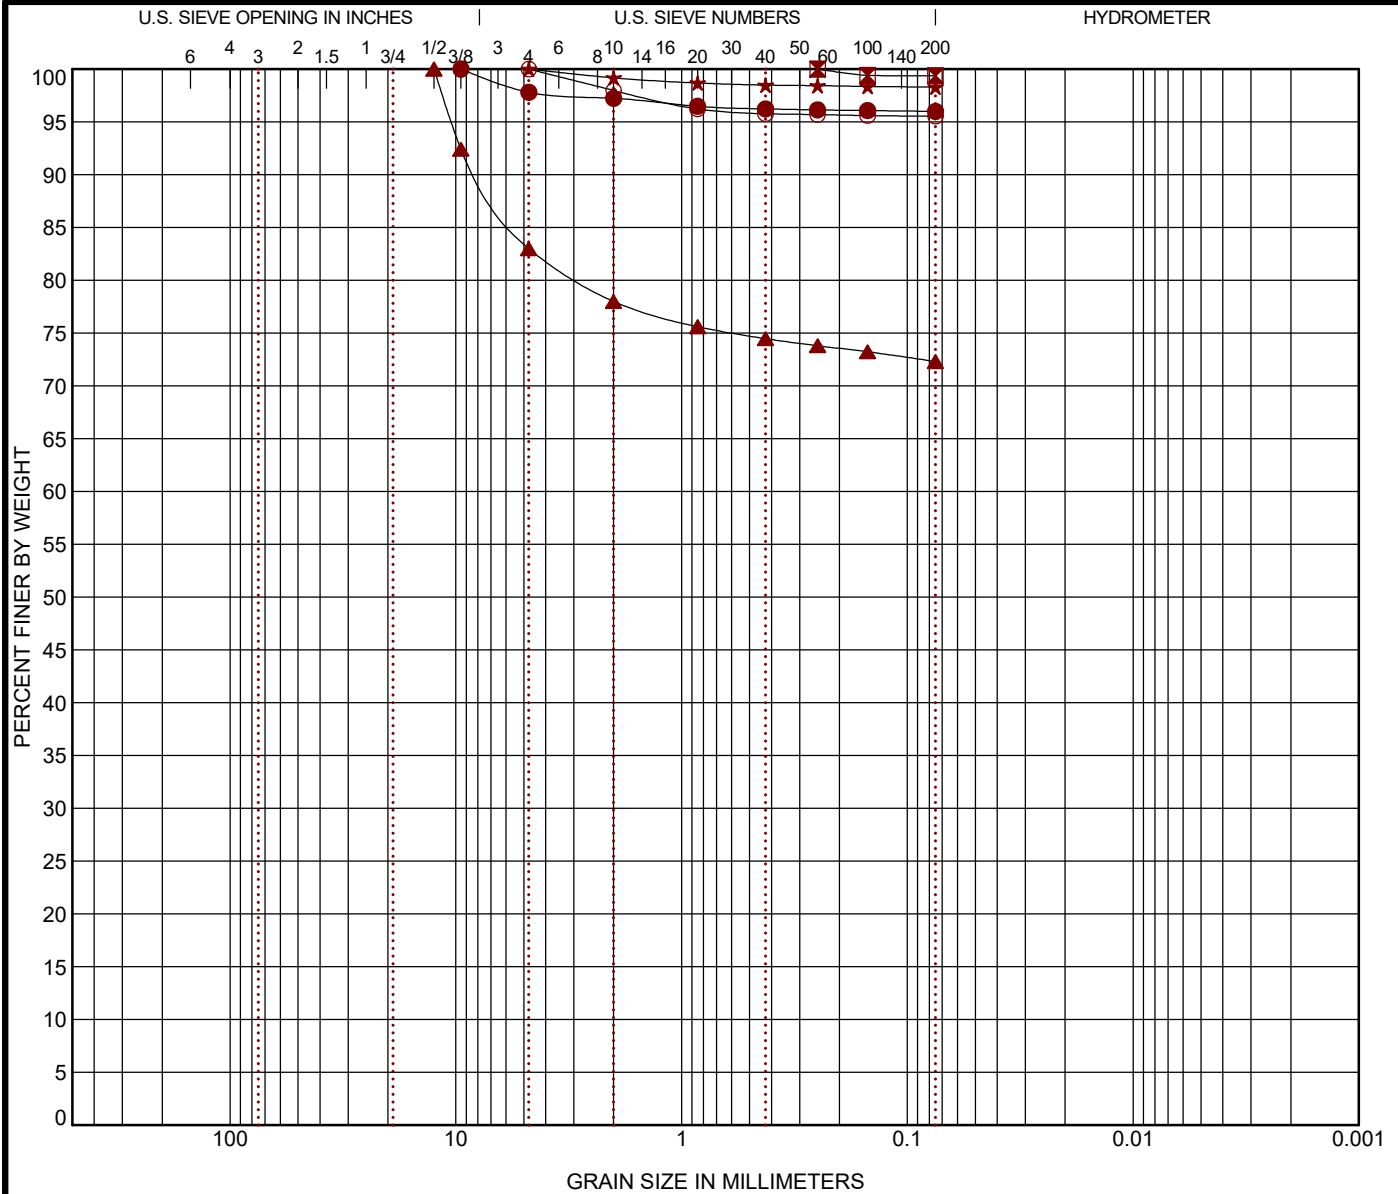

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID	Depth (Ft)	USCS Classification				WC (%)	LL	PL	PI	Cc	Cu
● KB-221.0B	30 - 32	SILT (ML)				37.4	NP	NP	NP		
⊠ KB-221.0B	50 - 52	SILT (ML)				29.6	NP	NP	NP		
▲ KB-221.8B	4 - 6	SILT with GRAVEL (ML)				32.1	44	41	3		
★ KB-221.8B	20 - 22	SILT (ML)				44.4	42	39	3		
⊙ KB-221.8B	35 - 37	ELASTIC SILT (MH)				46.6	53	46	7		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay
● KB-221.0B	30 - 32	9.5				0.0	2.2	1.8		96.0	
⊠ KB-221.0B	50 - 52	0.25				0.0	0.0	0.6		99.4	
▲ KB-221.8B	4 - 6	12.5				0.0	17.0	10.7		72.3	
★ KB-221.8B	20 - 22	4.75				0.0	0.0	1.7		98.3	
⊙ KB-221.8B	35 - 37	4.75				0.0	0.0	4.5		95.5	

PROJECT: Lab Testing

SITE: Champlain to Hudson Power Express

Terracon
30 Corporate Cir Ste 201
Albany, NY

PROJECT NUMBER: JB215256H


CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-6

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256H LAB TESTING.GPJ TERRACON_DATATEMPLATE.GDT 2/14/23

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

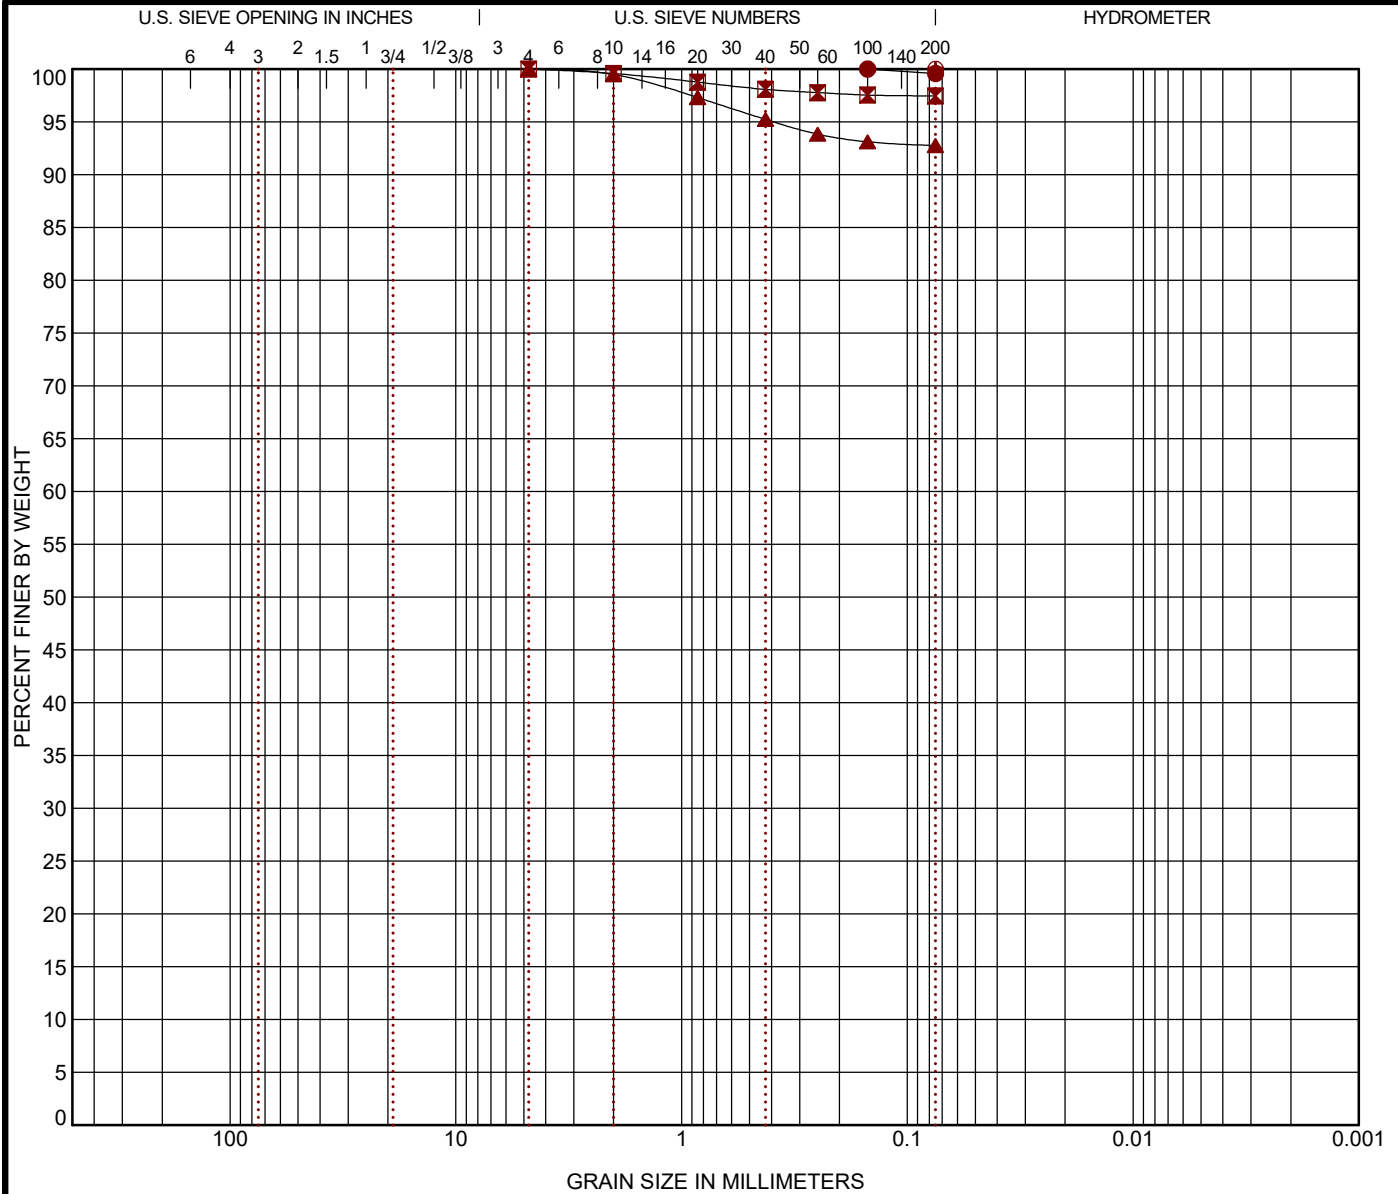

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID	Depth (Ft)	USCS Classification				WC (%)	LL	PL	PI	Cc	Cu
● KB-221.8B	55 - 57	SILT (ML)				39.2	42	33	9		
⊠ KB-222.8	6 - 8	ELASTIC SILT (MH)				33.6	53	34	19		
▲ KB-222.8	20 - 22	FAT CLAY (CH)				43.2	55	29	26		
★ KB-222.8	45 - 47	SILT (ML)				39.4	43	28	15		
⊙ KB-222.8	65 - 67	ELASTIC SILT (MH)				45.0	52	29	23		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay
● KB-221.8B	55 - 57	0.15				0.0	0.0	0.4		99.6	
⊠ KB-222.8	6 - 8	4.75				0.0	0.0	2.5		97.5	
▲ KB-222.8	20 - 22	4.75				0.0	0.0	7.2		92.8	
★ KB-222.8	45 - 47	0.075				0.0	0.0	0.0		100.0	
⊙ KB-222.8	65 - 67	0.075				0.0	0.0	0.0		100.0	

PROJECT: Lab Testing

SITE: Champlain to Hudson Power Express



PROJECT NUMBER: JB215256H

CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-7

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256H LAB TESTING.GPJ TERRACON_DATATEMPLATE.GDT 2/14/23

DATE: December 16, 2022

TO: Zachary Bauer, Tetra Tech Rooney

FROM: Matthew Hawley, P.E.; Kiewit Engineering (NY) Corp. **mkh**
Jaren Knighton; Kiewit Engineering (NY) Corp.

SUBJECT: Geotechnical Data: Segment 11 – Package 7A – HDD Crossing 118 – Revision 1
Champlain Hudson Power Express Project
Catskill, New York

Kiewit Engineering is providing the attached geotechnical data for use in the horizontal direction drill (HDD) design for the Champlain Hudson Power Express project in Upstate New York. This HDD crossing is located west of Catskill, New York. The approximate station for the start of HDD crossing number 118 is STA 70139+50 (42.2156° N, 73.8818° W).

The geotechnical data at this HDD crossing is attached. The available data is taken from the previous investigation by TRC and the recent investigations by Terracon and Kiewit, referenced below.

- TRC, Geotechnical Data Report, Champlain Hudson Power Express, Canadian Pacific Railway Borings MP 177.6-228.2, dated March 15, 2013.
- Terracon Consultants-NY, Inc., Results of Field Exploration, Champlain-Hudson Power Express – Package 7a, Catskill, NY, dated May 23, 2022.
- Kiewit Engineering (NY) Corp., Package 7A Phase 3 Borings, Champlain Hudson Power Express, New York, dated December 8, 2022.

Contact us if you have questions or require additional information.

HDD 118
Borings B222.34-1, K-222.3,
K-222.4, KB-222.2
Segment 11 - Design Package 7A

CHPE Segment 11 - Package 7A

HDD Soil Boring Coordinates and Elevations

Firm	Boring	Northing (feet)	Easting (feet)	Ground Surface Elevation (feet)
TRC*	B221.0-1	1237452.6	663787.2	99.6
	B221.2-1	1236173.4	663261.8	115.0
	B221.4-1	1235622.5	662622.3	22.4
	B221.5-1	1235006.9	662058.8	95.5
	B221.6-1	1234675.8	661633.8	98.3
	B221.8-1	1234265.3	661277.2	99.4
	B222.34-1	1232191.5	659098.9	133.5
	B222.6-1	1231252.6	658182.3	113.7
	B222.9-1	1229751.0	657274.3	121.4
	B225.8-1	1215861.0	650622.7	91.0
	B226.1-1	1214654.4	650328.3	105.9
	B226.2-1	1214120.5	650254.4	108.5
	B226.6-1	1211894.7	649689.7	112.1
AECOM**	CU-1	1237028.6	663123.9	19.7
	CU-2	1236042.7	662897.0	24.8
	CU-2A	1235325.9	662268.9	38.1
	CU-5A	1210523.7	649411.8	118.4
	SC-5	1239310.3	664321.6	110.2
	SC-6	1237781.0	663919.8	101.6

Notes:

- Northings and Eastings are provided in NAD83 New York State Plane East Zone.

- Elevations are referenced to the NAVD88 datum.



* TRC boring coordinates as shown in Table 1-6 in AECOM report (reference below). Boring elevations estimated from November 2021 topographic survey by Williams Aerial.

** AECOM boring coordinates and elevations as shown in Table 1-6 in AECOM report.

*** Kiewit boring coordinates and elevations are noted on the boring logs.

Reference:

AECOM, Geotechnical Data Report, Upland Segments: Putnam Station, Washington County, to Cementon, Green County, NY, Champlain Hudson Power Express, dated May 28, 2021.

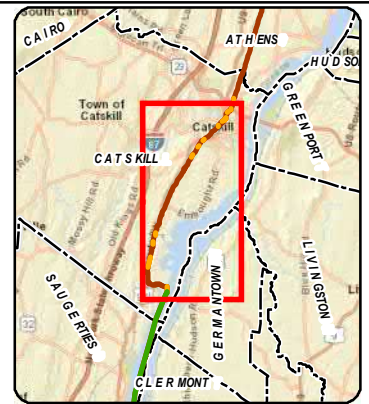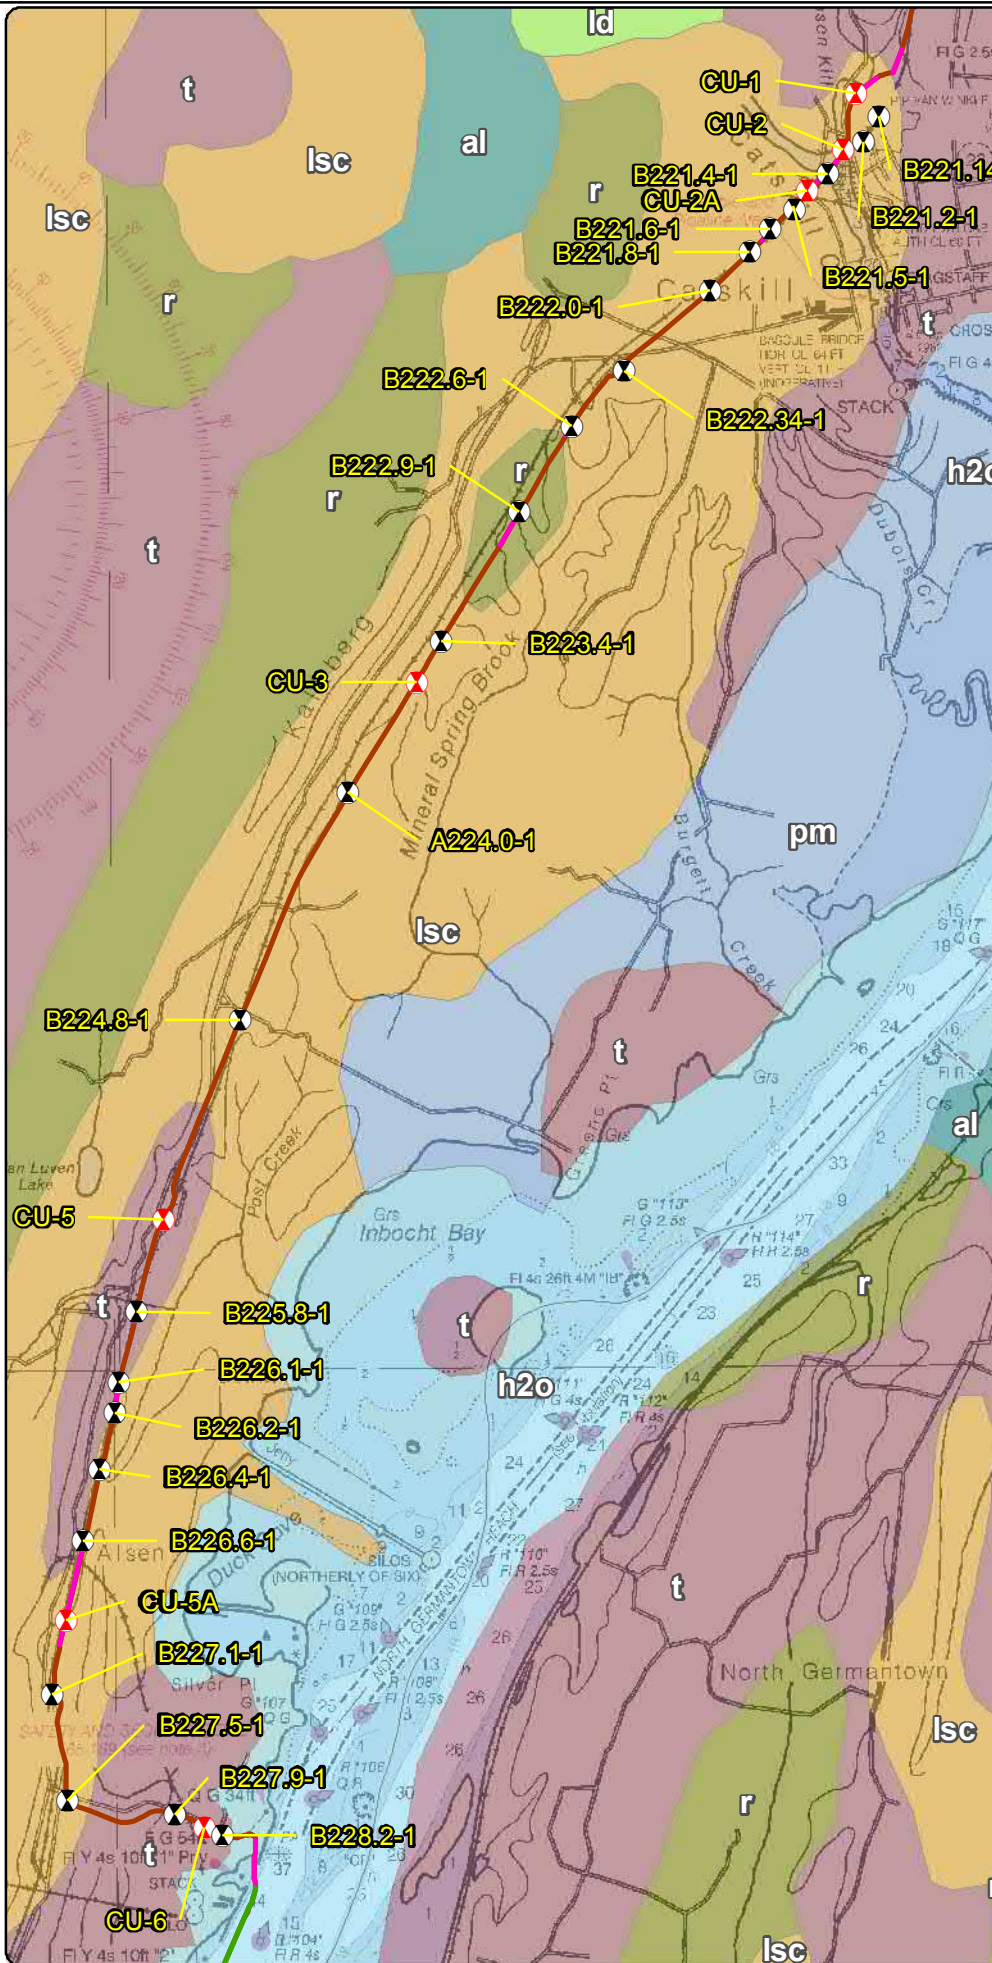

LEGEND

- 2021 Boring Location
- Previous (2013) Boring Location
- Terrestrial Route HVDC
- Submarine Route HVDC
- Terrestrial Route HVAC
- Preliminary HDD Locations
- Preliminary Pipe Bridge Location
- Town Boundary
- County Boundary

Surficial Geology

- al - Recent alluvium
- h2o - Water
- ld - Lacustrine delta
- lsc - Lacustrine silt and clay
- pm - Swamp deposits
- r - Bedrock
- t - Till



0.3 0.15 0 0.3 Miles






Champlain Hudson Power Express Project
Champlain Hudson Power Express Inc.

Surficial Geology and Geotechnical Borings Catskill to Upland Figure 3-11

Prepared on 5/3/2021

by: **AECOM**

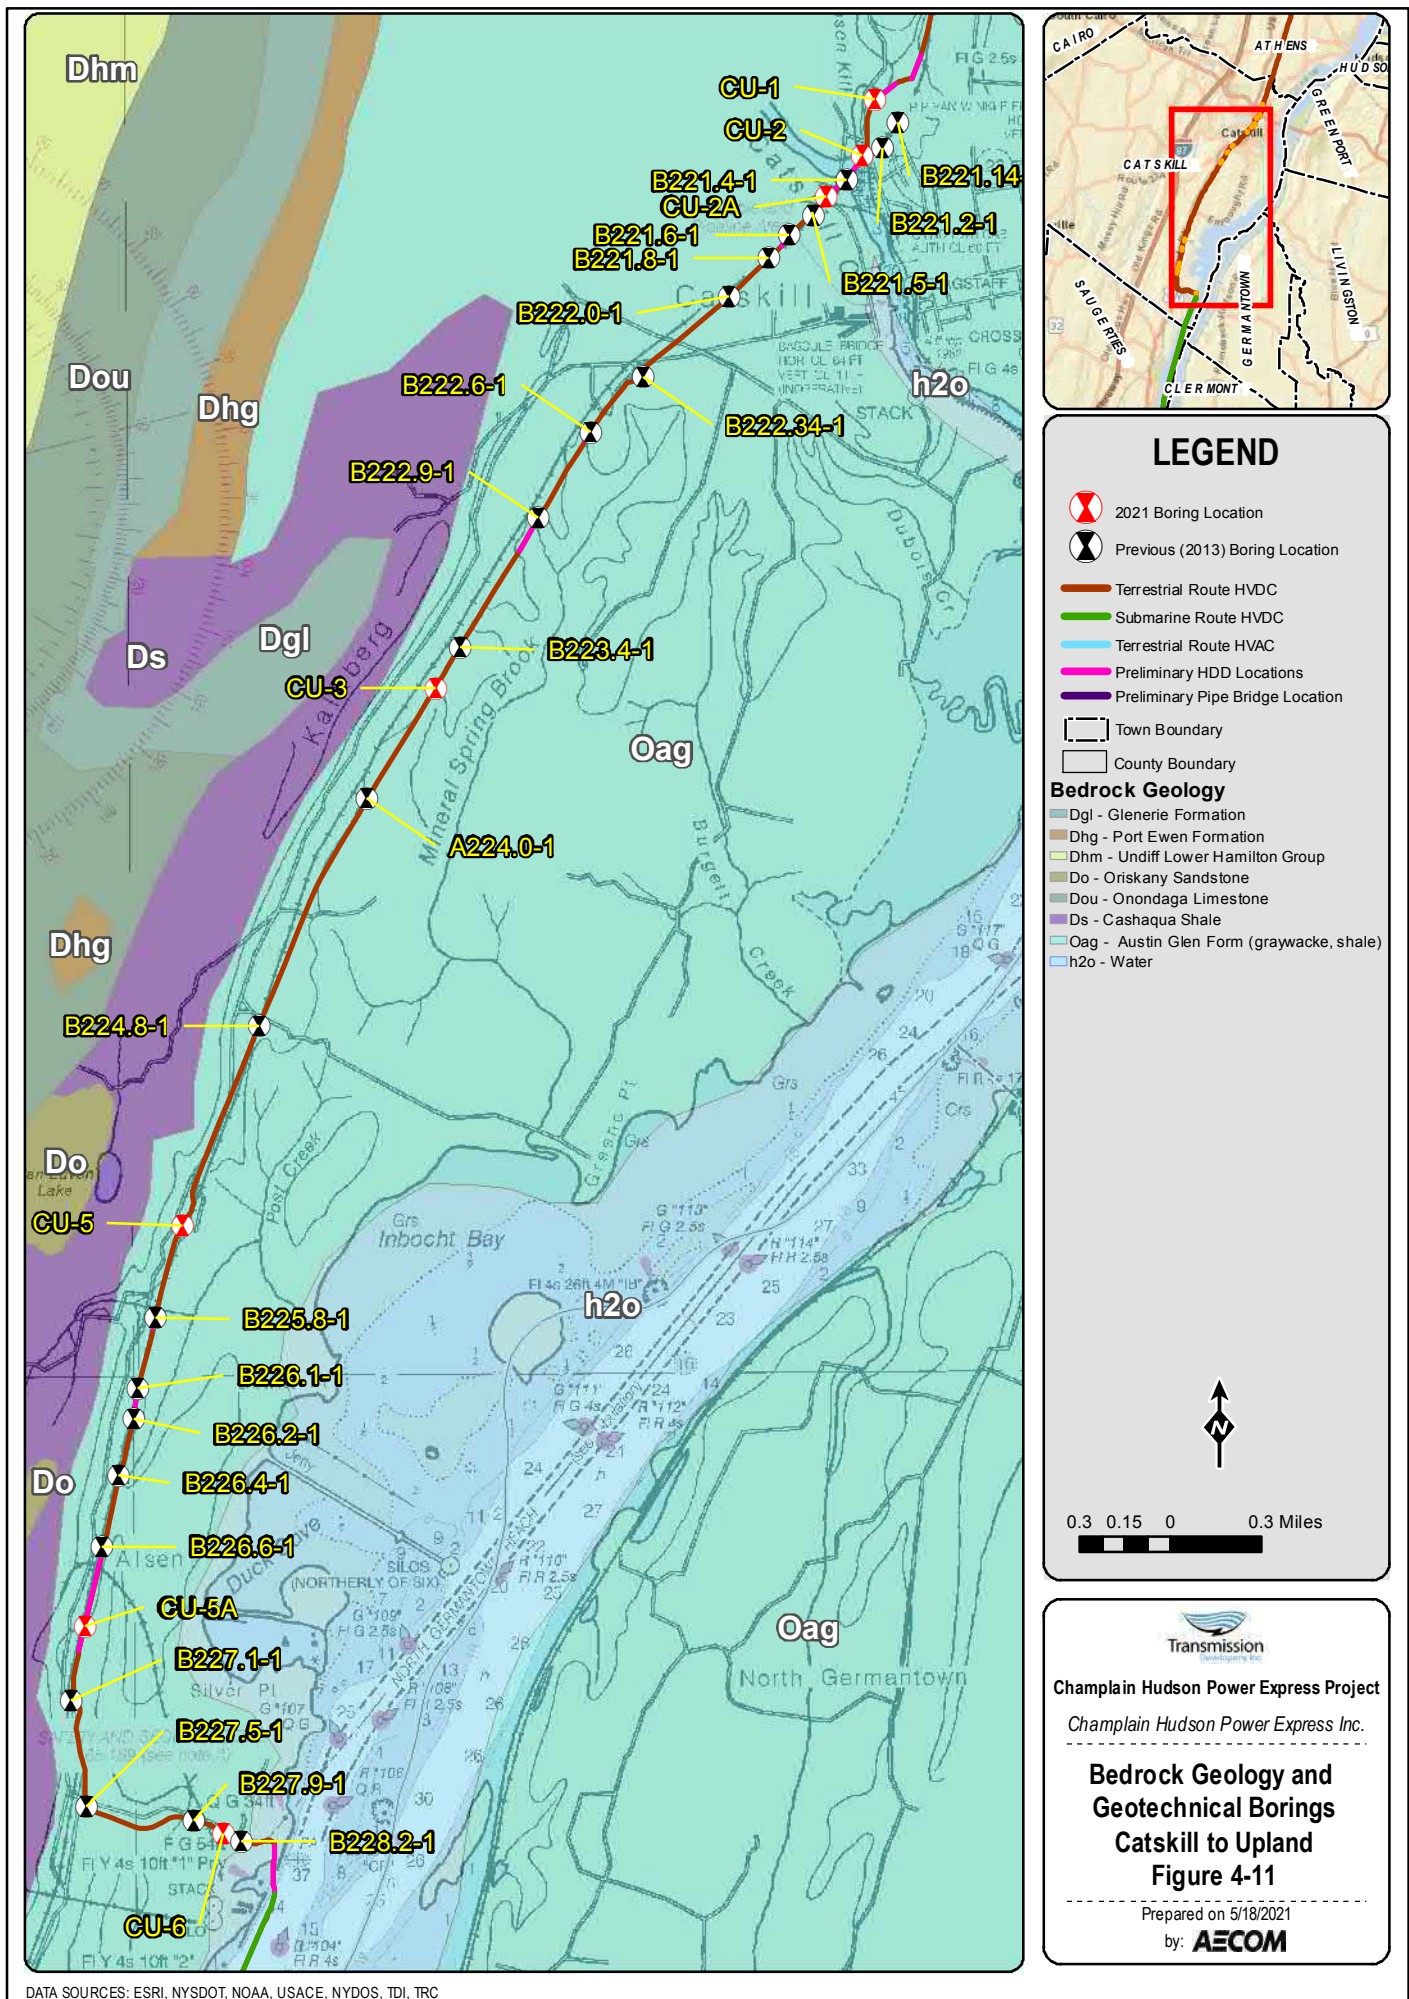

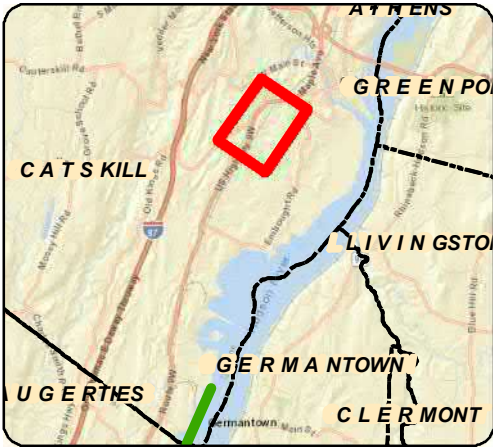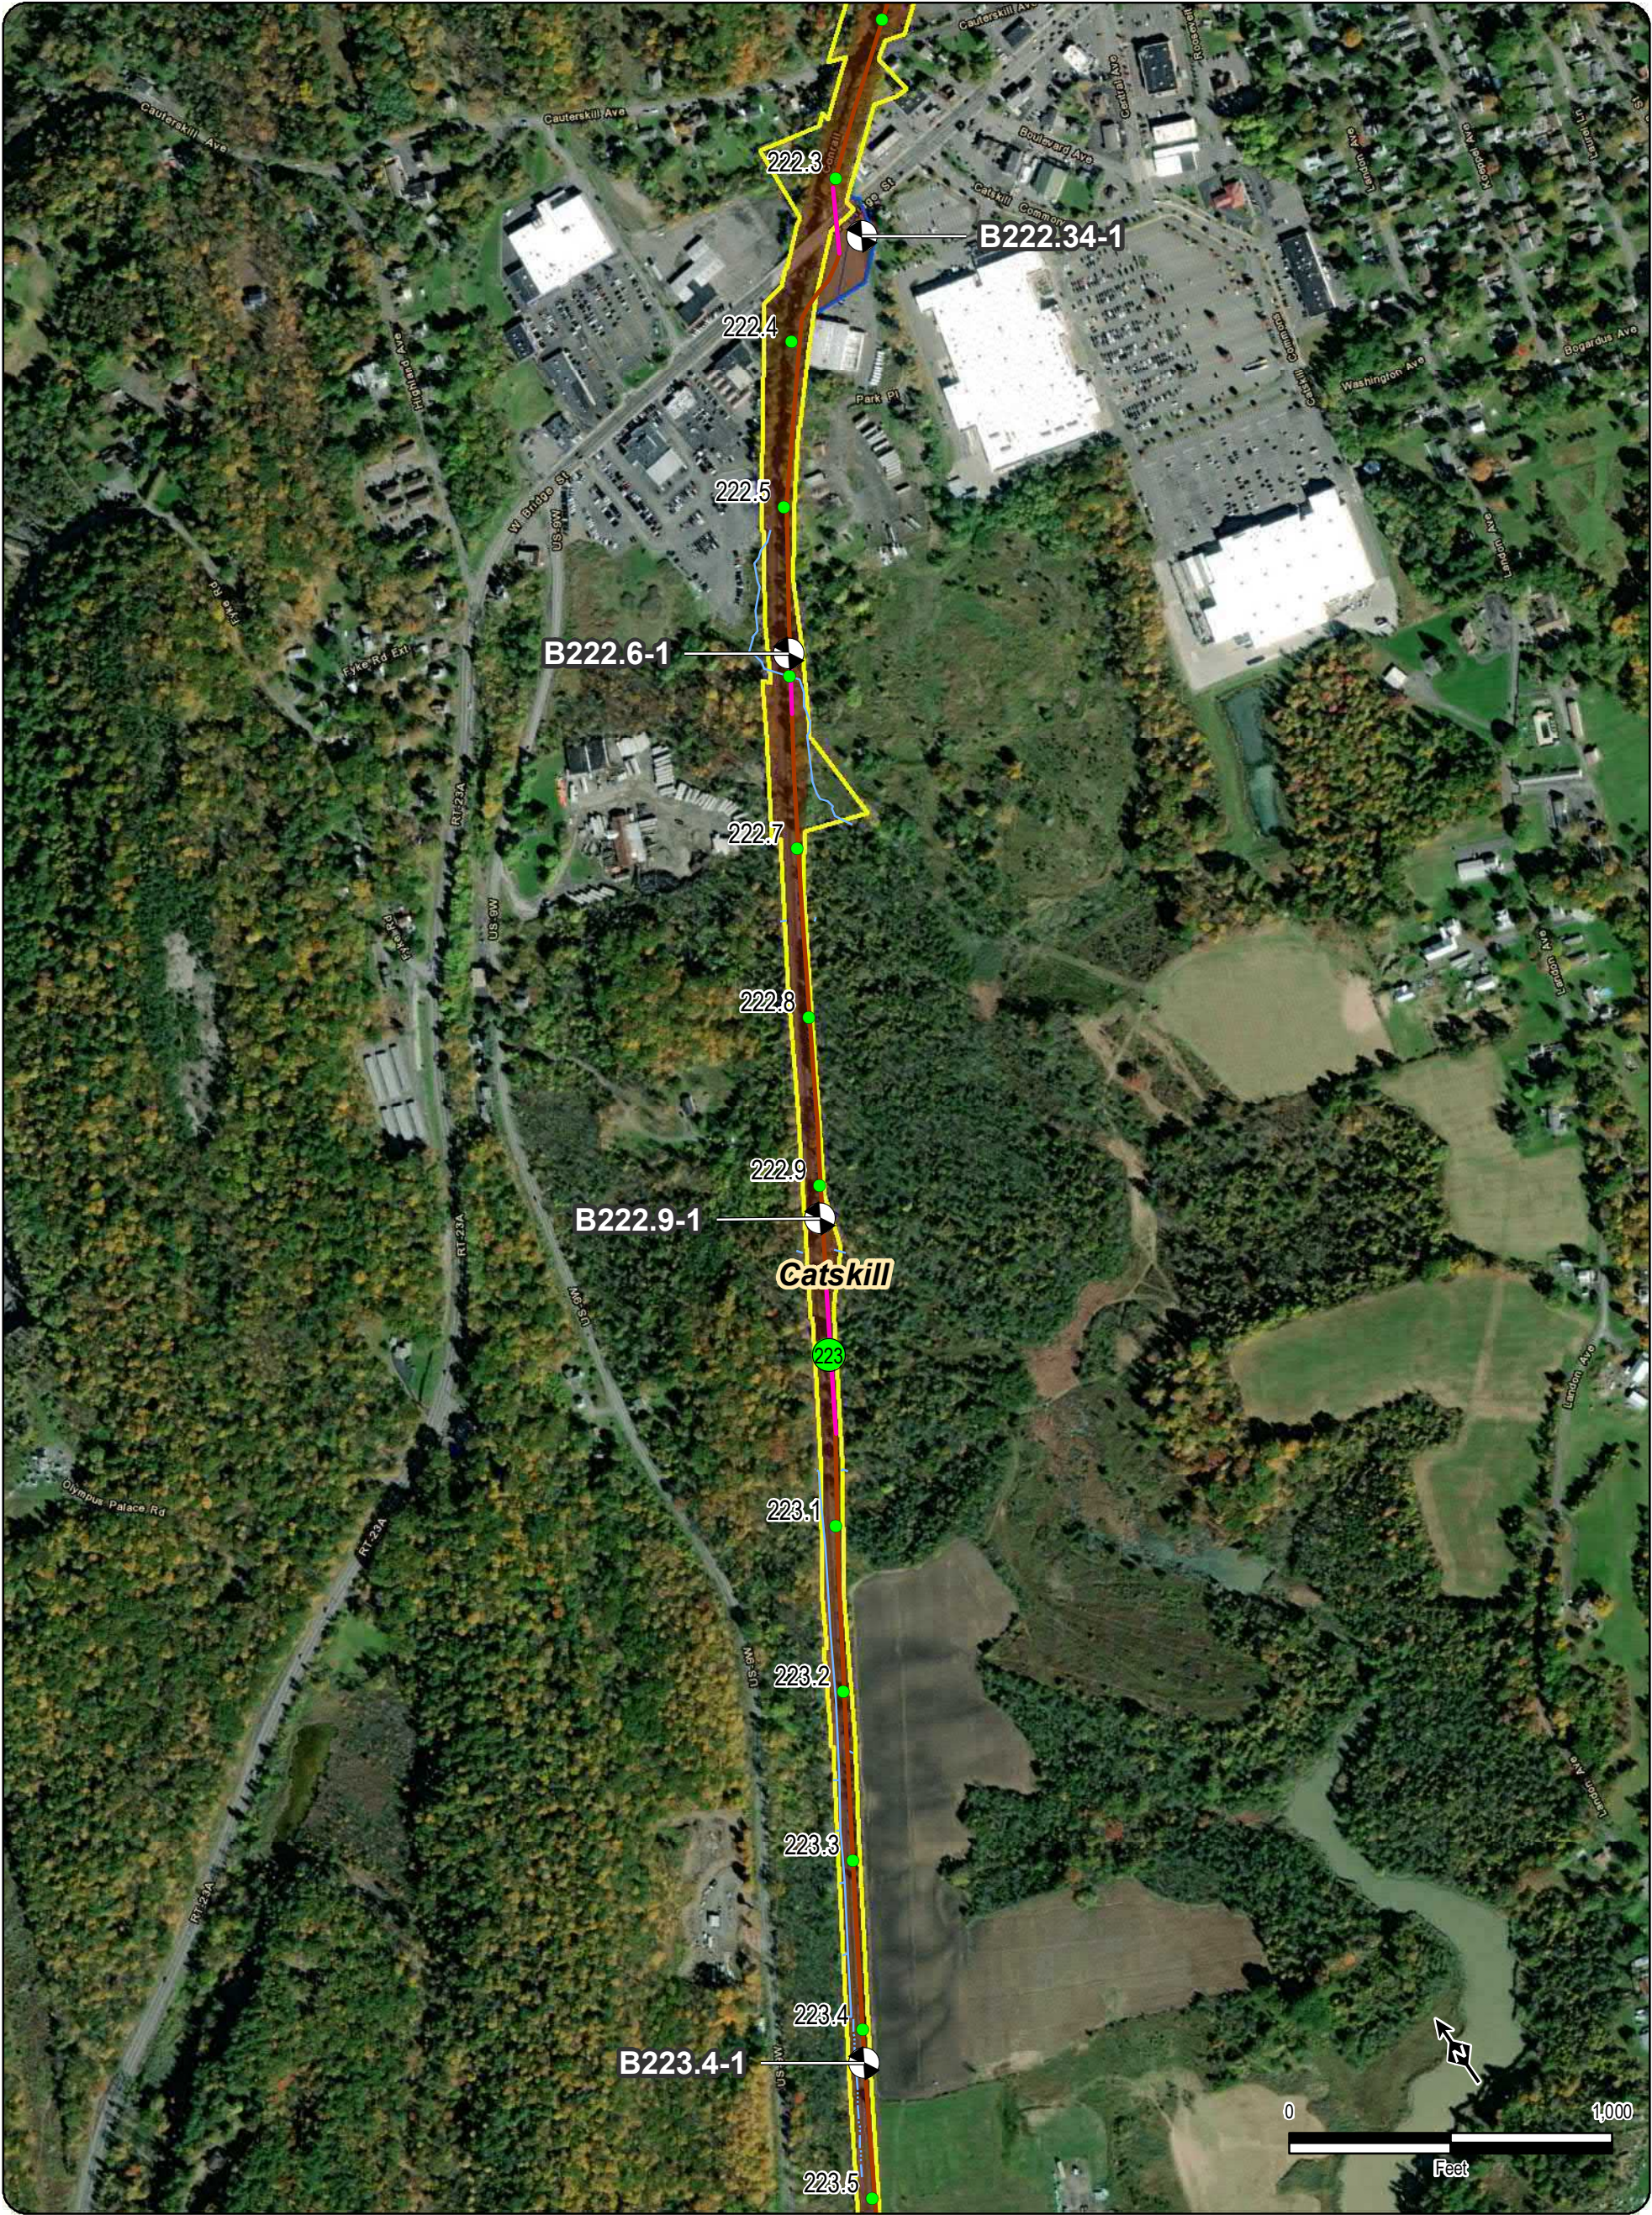

111.8

Certified Milepost - Tenths

111.8

Certified Milepost

135

Preferred Alternative Milepost - Tenths

135

Preferred Alternative Milepost

Terrestrial Route HVDC

Submarine Route HVDC

Terrestrial Route HVAC

Preliminary HDD Locations

Preliminary Pipe Bridge Location

2021 Boring Location

Previous (2013) Boring Location

LEGEND

Streams/Ditches

Railroad ROW

Deviation Zone

Deviation Zone Outside ROW

Preferred Alternative Deviation Zone

Preferred Alternative Deviation Zone Outside ROW

Town Boundary

Village Boundary

State Park (OPRHP)

Parcel Ownership

TOWN NAME

Road Name

Village Name

Transmission

Developers Inc.

Champlain Hudson Power Express Project

Champlain Hudson Power Express Inc.

BORING LOCATION PLAN

Catskill to Upland

Figure A-11

Sheet 2 of 6

Prepared by:

AECOM

5/20/2021

DATA SOURCES: ESRI, NETWORK MAPPING 2010, NYSDOT, OPRHP, TDI, TRC

Y:\Projects\CHPE\Route\Consensus_Alternative_Routes\MXD\A11.5_Routes_DZ_201909\Boring_Locations\Maps_for_May_2021_Report\Catskill_to_Upland_Boring_Locations_Mapset_May_2021_Report.mxd



TEST BORING LOG

PROJECT: TDI CHAMPLAIN HUDSON POWER EXPRESS

LOCATION: CSX RAILROAD ROW, NY

BORING **B222.3-1**

G.S. ELEV. N/A

FILE 195651

SHEET 1 OF 1

Note: Boring Log is named as B222.34-1 elsewhere

GROUNDWATER DATA

FIRST ENCOUNTERED DRY			
DEPTH	HOUR	DATE	ELAPSED TIME

METHOD OF ADVANCING BOREHOLE

a	FROM	0.0'	TO	4.0'
d	FROM	4.0'	TO	25.0'

DRILLER P. PLANTIER

HELPER M. NAGEY

INSPECTOR C. POPPE

DATE STARTED 02/15/2013

DATE COMPLETED 02/15/2013

DEPTH	A	B	C	DESCRIPTION	Wn	REMARKS
				DARK BROWN F/M SANDY SILT		BORING RELOCATED AND DRILLED AT MP 222.34-1
	S-1	2 2 2 5	2.0			
	S-2	5 6 6 7		LIGHT BROWN CLAY	31.3	
5	S-3	6 9 10 15	6.0			
	S-4	4 7 8 10			35.2	
10	S-5	5 8 11 9			36.2	
15	S-6	5 4 5		GRAY AND BROWN CLAY	34.8	
20	S-7	2 4 6				
25	S-8	5 6 5	25.0	END OF BORING AT 25'		
30						
35						

DRN. JPB
CKD. PWK

NEWPROJECTS TEST BORING LOG 195651_TDI_CSX.GPJ SITE BLAUVELT.GDT 3/12/13




SUMMARY OF LABORATORY TEST DATA

Project Name: TDI Champlain Hudson Power Express – CSX
 Client Name: Transmission Developers, Inc.
 TRC Project #: 195651

SAMPLE IDENTIFICATION			Soil Group (USCS System)	GRAIN SIZE DISTRIBUTION				PLASTICITY				Specific Gravity	Moisture Content (%)	Unit Weight (pcf)	Compressive Strength (tsf)	Organic Content (%)
Boring #	Sample #	Depth (ft)		Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Liquidity Index					
B222.34-1	S-2	2.0-4.0	-	-	-	-	-	-	-	-	-	-	31.3	-	-	-
	S-4	6.0-8.0	CH	-	-	-	-	58	29	29	0.2	-	35.2	-	-	-
	S-5	8.0-10.0	-	-	-	-	-	-	-	-	-	-	36.2	88.2	-	-
	S-6	13.5-15.0	CH/MH	-	-	-	-	56	30	26	0.2	-	34.8	-	-	-
B222.6-1	S-3	4.0-6.0	SM	0.0	6.6	93.4		-	-	-	-	-	19.6	-	-	-
	S-4	6.0-8.0	-	17.1	18.6	64.3		-	-	-	-	-	30.0	-	-	14.4
	S-5	8.0-10.0														
	R-2	15.6-16.0	-	-	-	-		-	-	-	-	-	-	166.7	665	-
	R-3	22.6-23.0	-	-	-	-		-	-	-	-	-	-	169.0	436	-
B222.9-1	S-2	2.0-4.0	-	-	-	-	-	-	-	-	-	-	29.7	-	-	-
	S-3	4.0-6.0	-	-	-	-	-	-	-	-	-	-	33.0	-	-	-

LIQUID AND PLASTIC LIMITS TEST REPORT

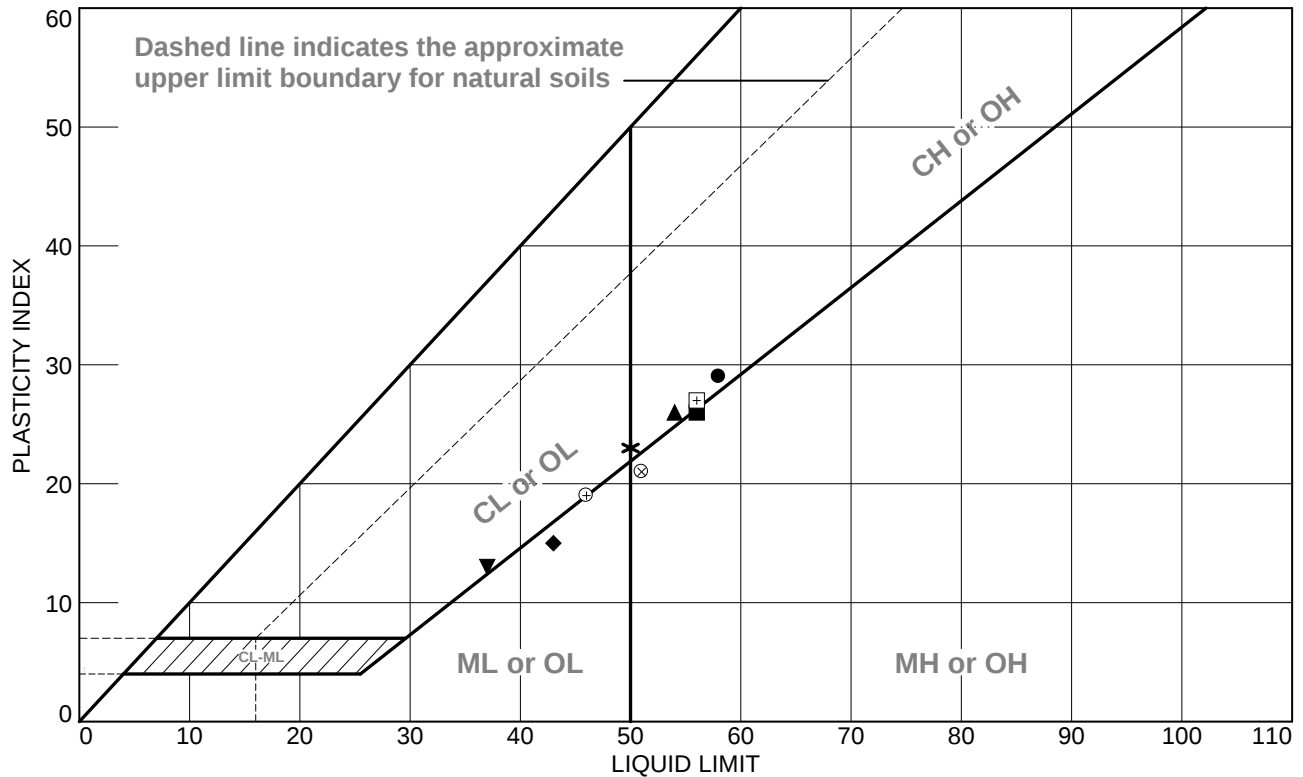

SOIL DATA


	SOURCE	SAMPLE NO.	DEPTH	NATURAL WATER CONTENT (%)	PLASTIC LIMIT (%)	LIQUID LIMIT (%)	PLASTICITY INDEX (%)	USCS
●	B222.34-1	S-4	6.0-8.0 FT	35.2	29	58	29	CH
■	B222.34-1	S-6	13.5-15.0 FT	34.8	30	56	26	CH/MH
▲	B222.9-1	S-5	8.0-10.0 FT	33.4	28	54	26	CH
◆	B223.4-1	S-7	18.5-20.0 FT	31.6	28	43	15	ML
▼	B224.8-1	S-8 & S-9	23.5-30.0 FT	33.3	24	37	13	CL
*	B226.1-1	S-6	13.5-15.0 FT	36.9	27	50	23	CH
⊕	B226.1-1	S-8	23.5-25.0 FT	39.0	27	46	19	CL
⊞	B226.6-1	S-3 & S-4	4.0-8.0 FT	38.8	29	56	27	CH
⊗	B226.6-1	S-6 & S-7	13.5-20.0 FT	53.7	30	51	21	MH

TRC
Engineers, Inc.
Mt. Laurel, NJ

Client: TRANSMISSION DEVELOPERS INC.
Project: TDI CHAMPLAIN HUDSON POWER EXPRESS - CSX


Project No.: 195651

Figure 9

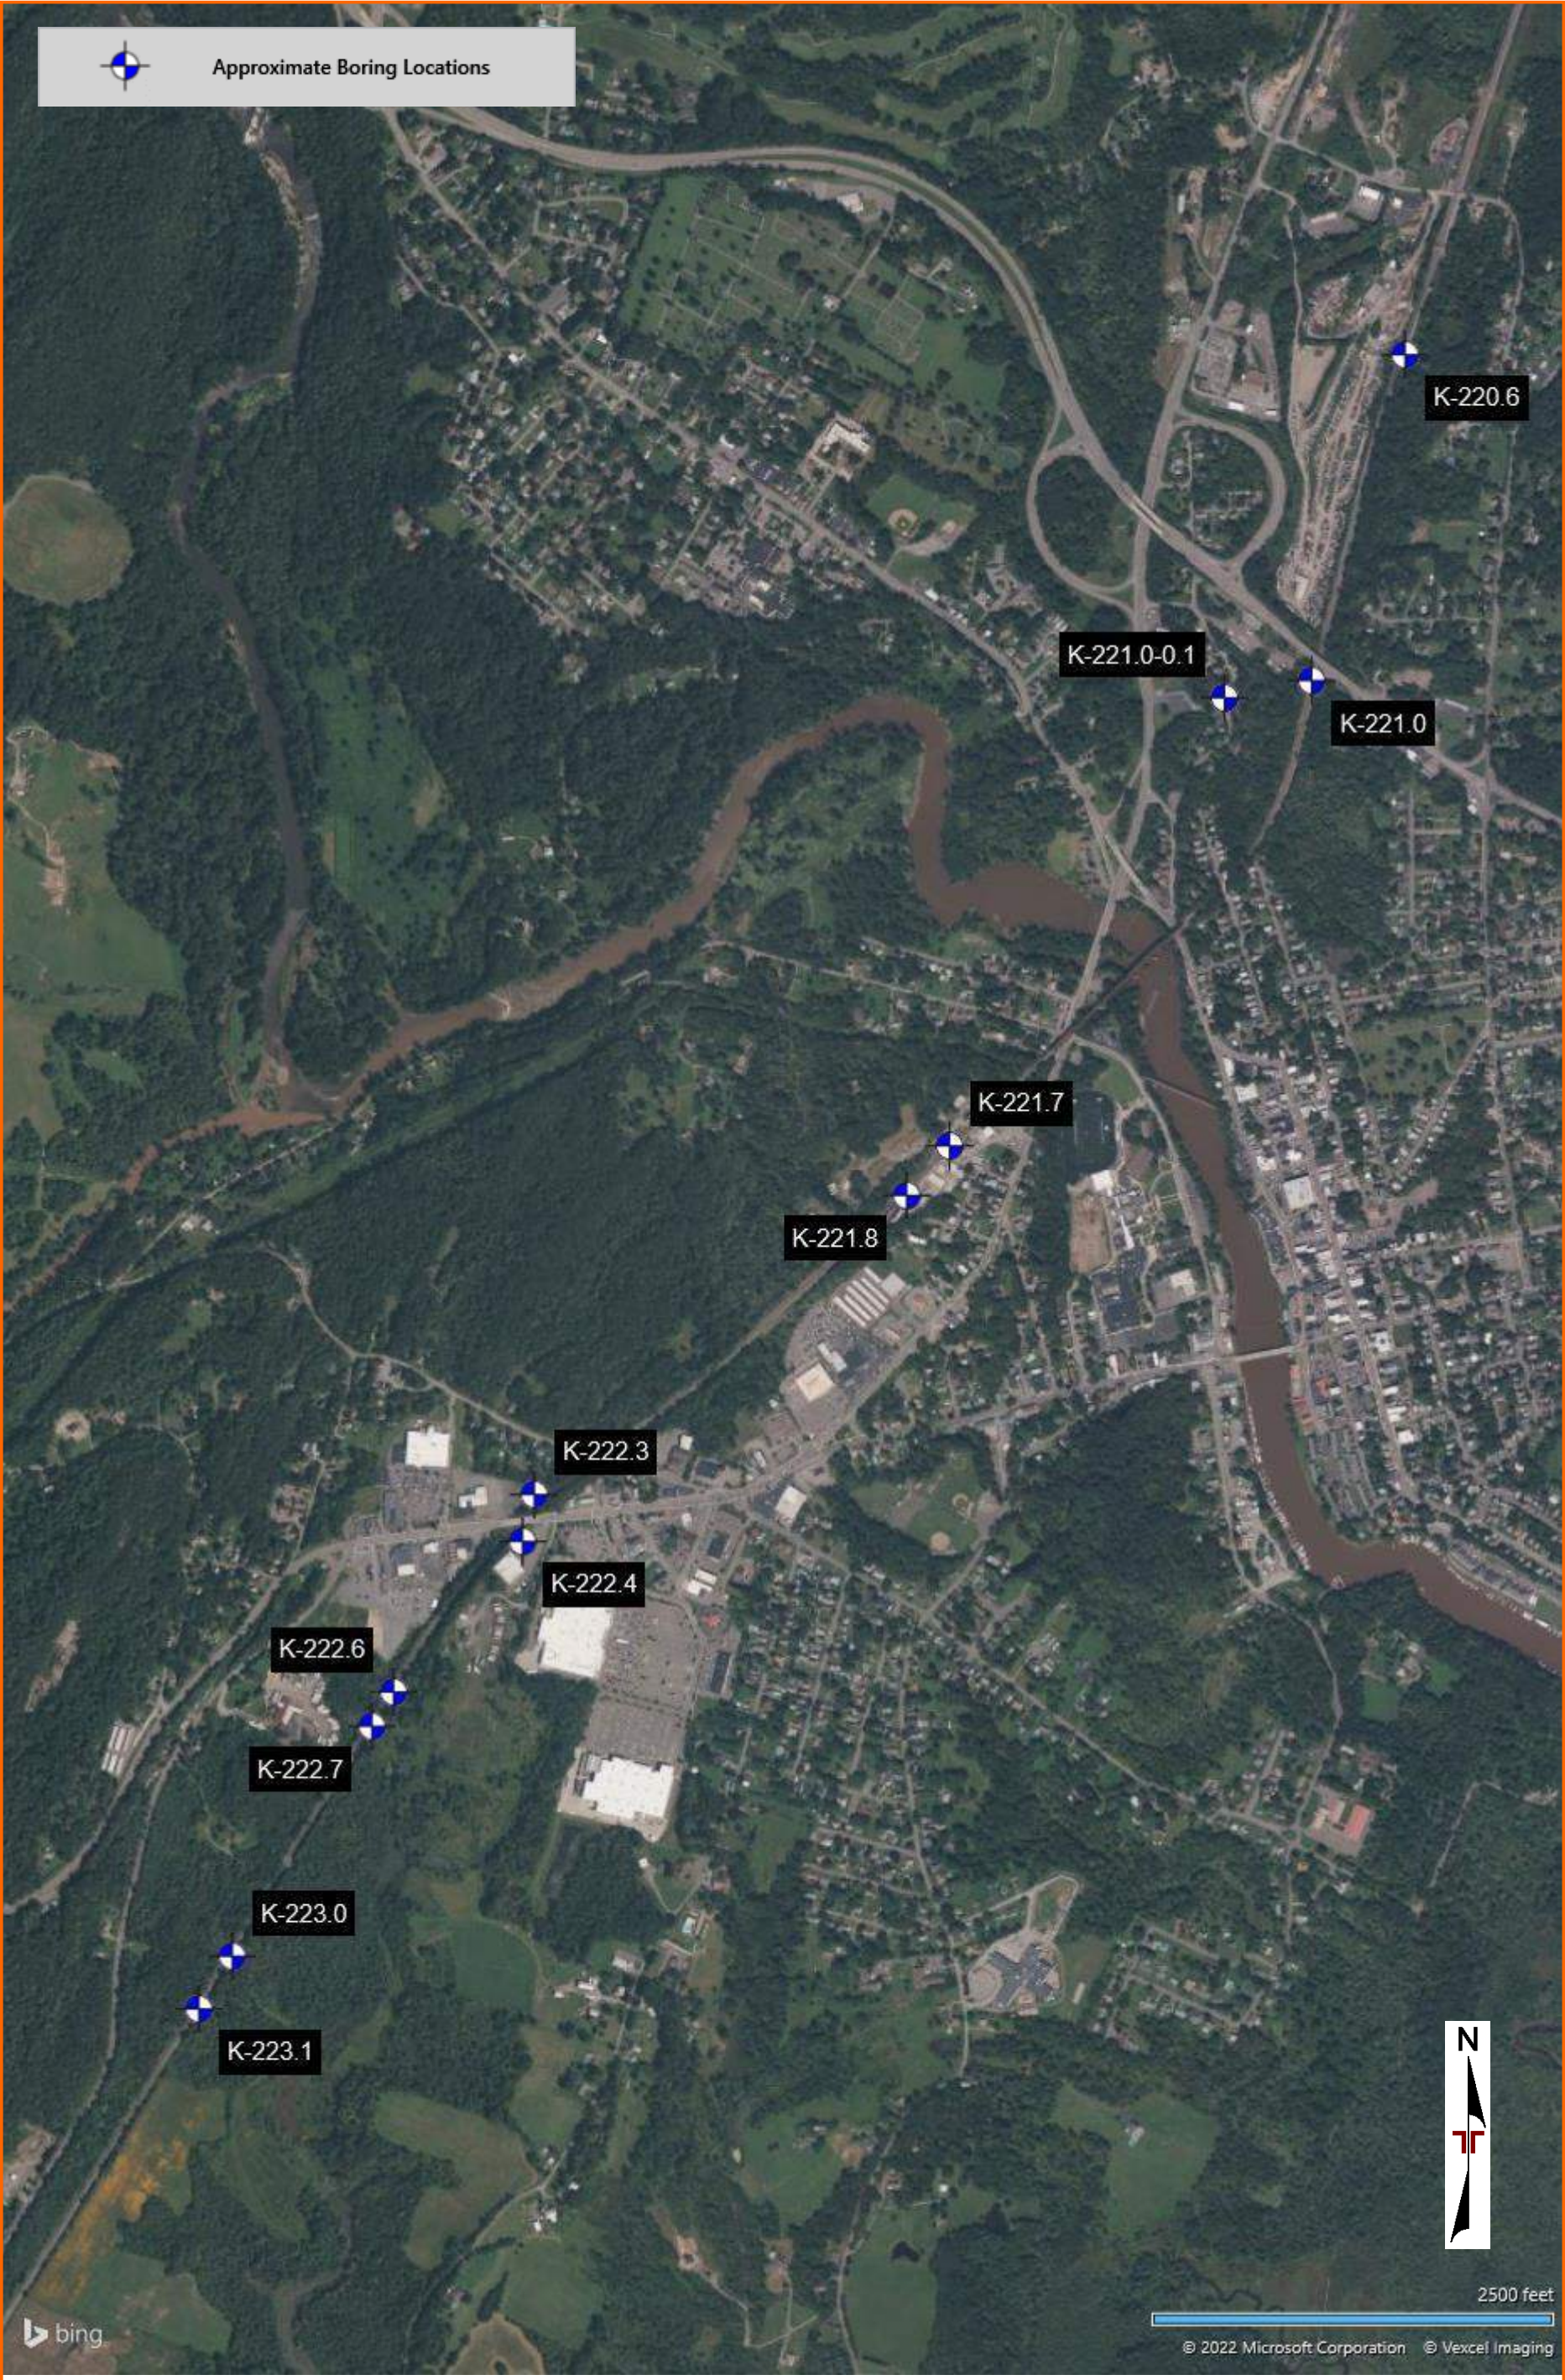

Page 1 of 2

CLIENT: Kiewit Engineering (NY) Corp.

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (in.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES
	Latitude: 42.214811° Longitude: -73.883942°	LL-PL-PI								
	DEPTH	Surface Elev.: 135.28 (Ft.) ELEVATION (Ft.)								
	<u>FILL - SILT AND CLAY</u> , gravel noted, brown, stiff	133.5	5			12	29-8-7-11 N=15			
	<u>SILT AND CLAY (CL-ML)</u> , brown, stiff to very stiff	129.5				15	4-6-6-12 N=12			
	<u>SANDY LEAN CLAY (CL)</u> , brown, stiff to very stiff	122.5				16	8-8-12-14 N=20			
			10			22	11-11-11-13 N=22	25.9	43-22-21	60
						24	11-12-12-12 N=24			
						8	5-5-6-8 N=11	28.3	41-20-21	70
	<u>WEATHERED ROCK</u> , gray, very dense	120			8	5-50/4"				
	<u>GRAYWACKE</u> , slightly weathered, close fractured, good RQD, gray	115	20			REC =98% RQD= 83%				
	<u>GRAYWACKE</u> , moderately weathered, with highly weathered veins, close to moderate fractured, fair RQD, gray					REC =100% RQD= 73%				
			25							

Hammer Type: Automatic

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON.GPJ TERRACON DATATEMPLATE.GDT 5/20/22

BORING LOG NO. K-222.3

Page 2 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES
	Latitude: 42.214811° Longitude: -73.883942°								LL-PL-PI	
DEPTH	ELEVATION (Ft.)									
	25.5	110								
	<u>GRAYWACKE</u> , slightly to moderately weathered, close to wide fractured, fair RQD, gray						REC =100% RQD= 69%			
	30.5	105	30							
	<u>GRAYWACKE</u> , highly weathered, with highly weathered veins, very close fractured, poor RQD, gray						REC =93% RQD= 28%			
	35.5	100	35							
	<u>GRAYWACKE</u> , highly weathered, with highly weathered veins, very close fractured, poor RQD, gray						REC =100% RQD= 46%			
	40.5	95	40							
	Boring Terminated at 40.5 Feet									

Stratification lines are approximate. In-situ, the transition may be gradual.

Hammer Type: Automatic

Advancement Method:
4 1/4 HSA

See [Exploration and Testing Procedures](#) for a description of field and laboratory procedures used and additional data (If any).

Notes:

Logged by LC
Hammer Efficiency Summary:
Energy Transfer Ratio: 89.2% +/-2.4%
Hammer Efficiency Correction (CE):1.49
WOH = Weight of Hammer

Abandonment Method:
Backfilled with bentonite grout upon completion

See [Supporting Information](#) for explanation of symbols and abbreviations.

Elevations were provided by Kiewit.

WATER LEVEL OBSERVATIONS

No measurable groundwater prior to grouting

Terracon
30 Corporate Cir Ste 201
Albany, NY

Boring Started: 03-23-2022

Boring Completed: 03-23-2022

Drill Rig: Diedrich D-70

Driller: J. Raushcer

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

BORING LOG NO. K-222.4

Page 1 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS		PERCENT FINES
	Latitude: 42.214008° Longitude: -73.884214°								LL-PL-PI		
DEPTH		Surface Elev.: 133.13 (Ft.) ELEVATION (Ft.)									
	FILL - ASPHALT, CINDERS AND BRICKS , black, medium dense					12	29-8-7-11 N=15				
	2.0		131				15	4-6-6-12 N=12			
	LEAN CLAY (CL) , brown, stiff					16	8-8-12-14 N=20				
			5			22	11-11-11-13 N=22	31.4			
						24	11-12-12-12 N=24				
			10			8	5-5-6-8 N=11	30.0	44-22-22	87	
	15.0		118								
	15.8	WEATHERED ROCK , black, very dense	117.5			8	5-50/4"				
	GRAYWACKE , unweathered, close to wide fractured, excellent RQD, gray						REC =96% RQD= 91%				
	20.8		112.5								
	GRAYWACKE , unweathered, close to wide fractured, excellent RQD, gray						REC =96% RQD= 96%				

Stratification lines are approximate. In-situ, the transition may be gradual.

Hammer Type: Automatic

Advancement Method:
4 1/4 HSA

See [Exploration and Testing Procedures](#) for a description of field and laboratory procedures used and additional data (If any).

Notes:

Logged By MO
Hammer Efficiency Summary:
Energy Transfer Ratio: 86.9% +/-2.2%
Hammer Efficiency Correction (CE):1.52

Abandonment Method:
Backfilled with bentonite grout upon completion

See [Supporting Information](#) for explanation of symbols and abbreviations.

Elevations were provided by Kiewit.

WATER LEVEL OBSERVATIONS

No measurable groundwater prior to grouting

Terracon
30 Corporate Cir Ste 201
Albany, NY

Boring Started: 03-16-2022

Boring Completed: 03-16-2022

Drill Rig: Mobile B-57

Driller: S. Kahn

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL. JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

BORING LOG NO. K-222.4

Page 2 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES	
	Latitude: 42.214008° Longitude: -73.884214°								LL-PL-PI		
DEPTH			ELEVATION (Ft.)								
	25.8	107.5									
	<u>GRAYWACKE</u> , unweathered, moderate to wide fractured, excellent RQD, gray						REC =100% RQD= 91%				
	30.8	102.5					30				REC =96% RQD= 88%
	35.8	97.5					35				REC =100% RQD= 100%
	40.8	92.5					40				
Boring Terminated at 40.8 Feet											

Stratification lines are approximate. In-situ, the transition may be gradual.

Hammer Type: Automatic

Advancement Method:
4 1/4 HSA

See [Exploration and Testing Procedures](#) for a description of field and laboratory procedures used and additional data (If any).

Notes:

Logged By MO
Hammer Efficiency Summary:
Energy Transfer Ratio: 86.9% +/-2.2%
Hammer Efficiency Correction (CE):1.52

Abandonment Method:
Backfilled with bentonite grout upon completion

See [Supporting Information](#) for explanation of symbols and abbreviations.

Elevations were provided by Kiewit.

WATER LEVEL OBSERVATIONS

No measurable groundwater prior to grouting

Terracon
30 Corporate Cir Ste 201
Albany, NY

Boring Started: 03-16-2022

Boring Completed: 03-16-2022

Drill Rig: Mobile B-57


Driller: S. Kahn

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON GRU TERRACON DATATEMPLATE.GDT 5/20/22

ATTERBERG LIMITS RESULTS

ASTM D4318

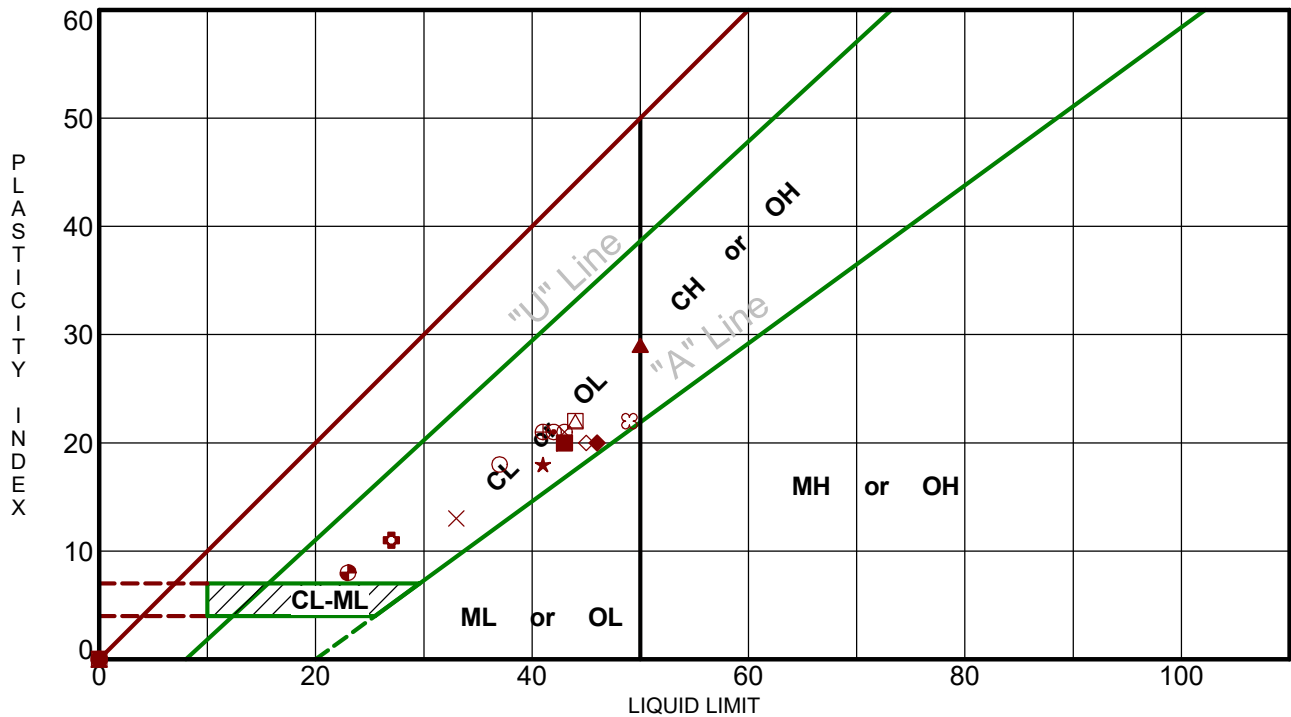

Boring ID	Depth (Ft)	LL	PL	PI	Fines	USCS	Description
● K-220.6	6 - 8	NP	NP	NP	22.1	GM	SILTY GRAVEL with SAND
⊠ K-220.6	13 - 15	NP	NP	NP	11.9	SW-SM	WELL-GRADED SAND with SILT and GRAVEL
▲ K-221.0	8 - 10	50	21	29	73.4	CH	FAT CLAY with SAND
★ K-221.0	23 - 25	41	23	18	89.8	CL	LEAN CLAY
⊙ K-221.7	10 - 12	42	21	21	93.6	CL	LEAN CLAY
⊕ K-221.7	33 - 35	27	16	11	58.8	CL	SANDY LEAN CLAY
○ K-221.8	8 - 10	37	19	18	91.3	CL	LEAN CLAY
△ K-221.8	35 - 37	44	22	22	79.7	CL	LEAN CLAY with SAND
⊗ K-222.3	6 - 8	43	22	21	59.8	CL	SANDY LEAN CLAY
⊕ K-222.3	10 - 12	41	20	21	69.6	CL	SANDY LEAN CLAY
□ K-222.4	10 - 12	44	22	22	87.3	CL	LEAN CLAY
⊕ K-222.6	15 - 17	NP	NP	NP	6.5	GW-GM	WELL-GRADED GRAVEL with SILT and SAND
⊕ K-222.6	35 - 37	23	15	8	86.7	CL	LEAN CLAY
★ K-222.7	10 - 12	NP	NP	NP	25.3	GM	SILTY GRAVEL with SAND
⊗ K-222.7	25 - 27	49	27	22	76.3	CL	LEAN CLAY with SAND
■ K-223.0	10 - 12	43	23	20	58.5	CL	SANDY LEAN CLAY
◆ K-223.0	25 - 27	46	26	20	84.9	CL	LEAN CLAY with SAND
◇ K-223.1	15 - 17	45	25	20	71.3	CL	LEAN CLAY with SAND
× K-223.1	29 - 31	33	20	13	98.3	CL	LEAN CLAY

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

Terracon
30 Corporate Cir Ste 201
Albany, NY


PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. ATTERBERG LIMITS JB215256D CHAMPLAIN-HUDSON GPJ TERRACON DATATEMPLATE.GDT 5/12/22

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

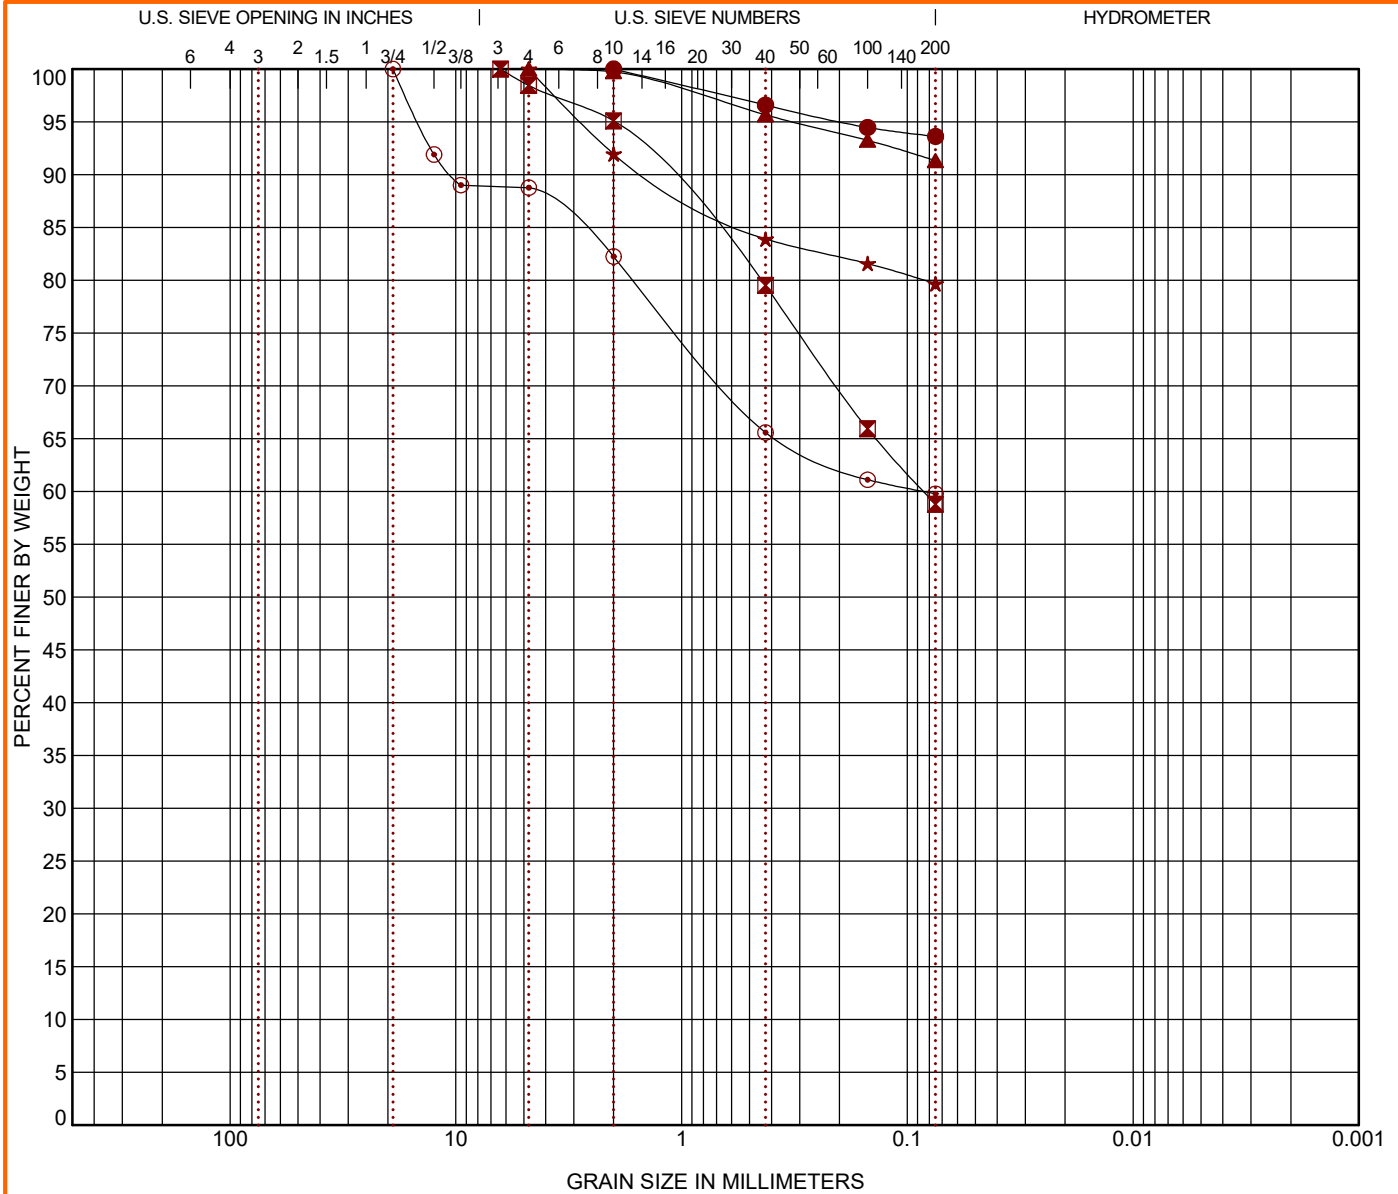

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID	Depth (Ft)	USCS Classification				WC (%)	LL	PL	PI	Cc	Cu
● K-221.7	10 - 12	LEAN CLAY (CL)				41.7	42	21	21		
⊠ K-221.7	33 - 35	SANDY LEAN CLAY (CL)				23.8	27	16	11		
▲ K-221.8	8 - 10	LEAN CLAY (CL)				40.2	37	19	18		
★ K-221.8	35 - 37	LEAN CLAY with SAND (CL)				48.3	44	22	22		
⊙ K-222.3	6 - 8	SANDY LEAN CLAY (CL)				25.9	43	22	21		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay
● K-221.7	10 - 12	2				0.0	0.0	6.4		93.6	
⊠ K-221.7	33 - 35	6.35	0.084			0.0	1.6	39.6		58.8	
▲ K-221.8	8 - 10	4.75				0.0	0.0	8.7		91.3	
★ K-221.8	35 - 37	4.75				0.0	0.0	20.3		79.7	
⊙ K-222.3	6 - 8	19	0.084			0.0	11.2	29.0		59.8	

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

Terracon
30 Corporate Cir Ste 201
Albany, NY


PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256D CHAMPLAIN-HUDSON.GPJ TERRACON_DATATEMPLATE.GDT 5/12/22

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

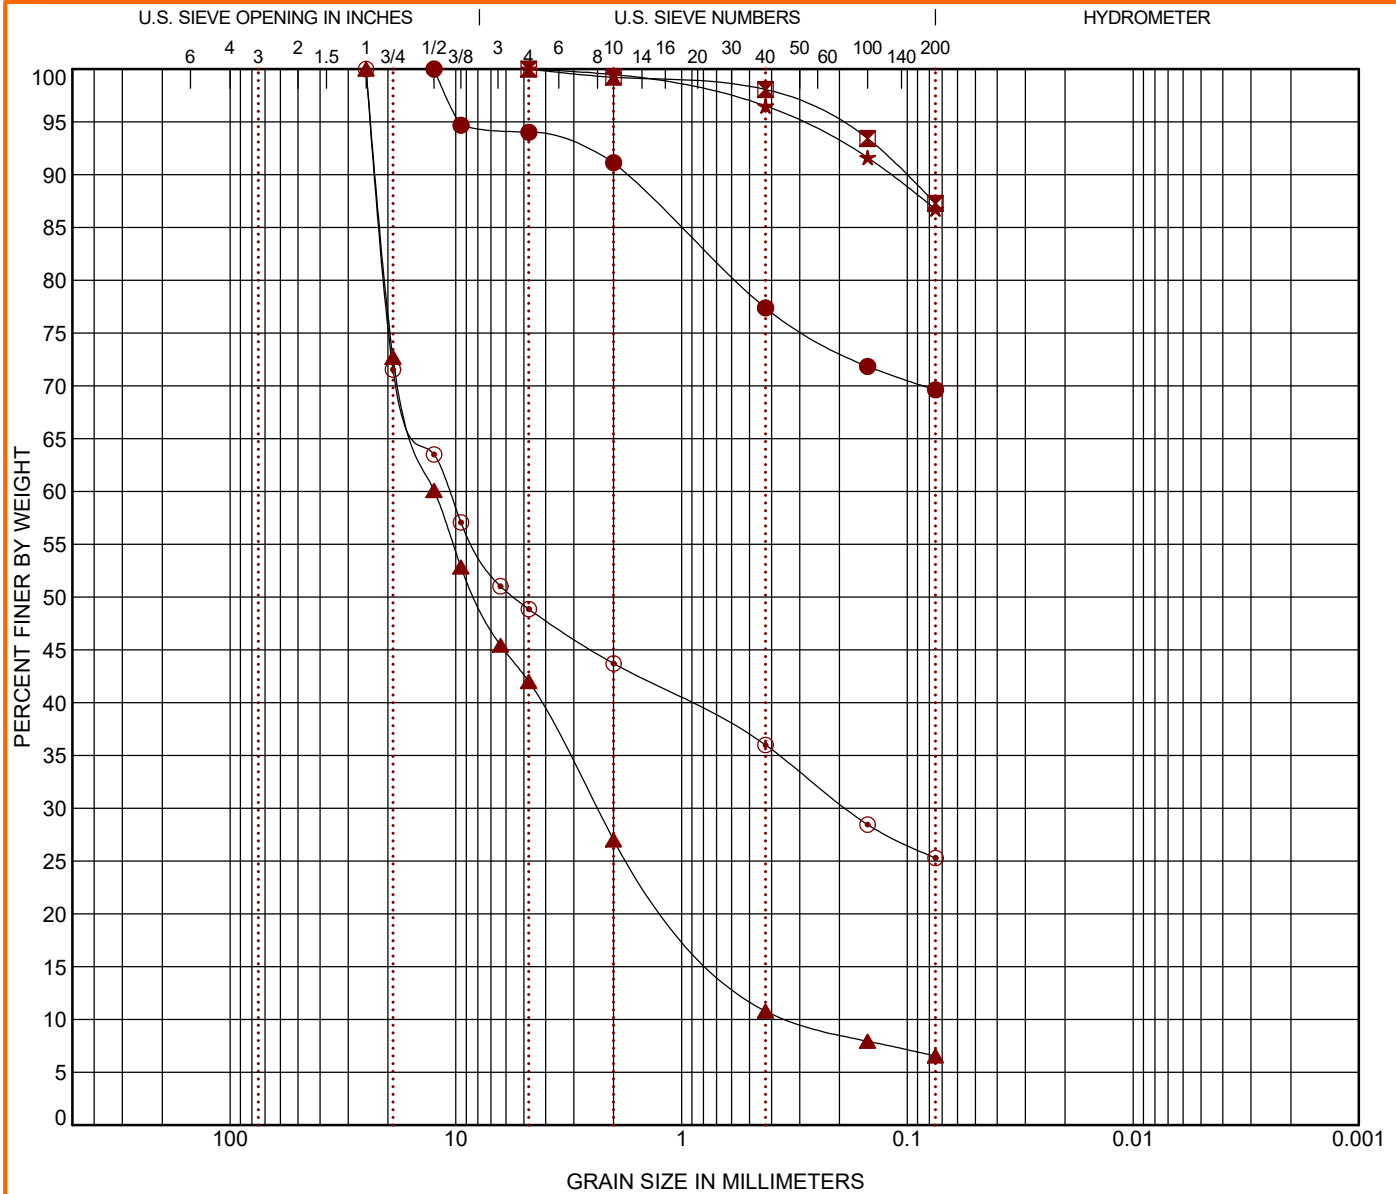

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID		Depth (Ft)	USCS Classification					WC (%)	LL	PL	PI	Cc	Cu
●	K-222.3	10 - 12	SANDY LEAN CLAY (CL)					28.3	41	20	21		
☒	K-222.4	10 - 12	LEAN CLAY (CL)					30.0	44	22	22		
▲	K-222.6	15 - 17	WELL-GRADED GRAVEL with SILT and SAND (GW-GM)					9.2	NP	NP	NP	1.42	39.06
★	K-222.6	35 - 37	LEAN CLAY (CL)					25.5	23	15	8		
⊙	K-222.7	10 - 12	SILTY GRAVEL with SAND (GM)					11.5	NP	NP	NP		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay		
●	K-222.3	10 - 12	12.5			0.0	6.0	24.4		69.6			
☒	K-222.4	10 - 12	4.75			0.0	0.0	12.7		87.3			
▲	K-222.6	15 - 17	25	12.459	2.379	0.319	0.0	58.0	35.5		6.5		
★	K-222.6	35 - 37	4.75			0.0	0.0	13.3		86.7			
⊙	K-222.7	10 - 12	25	10.764	0.186	0.0	51.1	23.6		25.3			

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

Terracon
30 Corporate Cir Ste 201
Albany, NY

PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256D CHAMPLAIN-HUDSON_GP.J TERRACON_DATATEMPLATE.GDT 5/12/22



Client:	Terracon Consultants, Inc.				
Project:	Champlain-Hudson Power Express				
Location:				Project No:	GTX-315284
Boring ID:	K-222.4	Sample Type:	cylinder	Tested By:	tjm
Sample ID:	---	Test Date:	04/29/22	Checked By:	smd
Depth :	25.8-30.8 ft	Test Id:	664261		
Test Comment:	---				
Visual Description:	---				
Sample Comment:	---				

Abrasiveness of Rock Using the Cerchar Method by ASTM D7625

Boring ID	Sample ID	Depth	Stylus No	Reading 1	Reading 2	Average	Comments
K-222.4	---	25.8-30.8 ft	1	0.6	0.5	0.55	
			2	0.8	0.4	0.60	
			3	0.7	0.6	0.65	
			4	0.3	0.6	0.45	
			5	0.9	0.6	0.75	
			Average CAIs			0.6	
			Average CAI *			1.07	
CERCHAR Abrasiveness Index Classification					Medium abrasiveness		

Notes

Test Surface: Saw Cut
 Moisture Condition: As Received
 Apparatus Type: Original CERCHAR
 Stylus Hardness: Rockwell Hardness 54/56 HRC
 Stylus Displacement Relative to Rock Fabric:
 Styli 1-3: Normal; Styli 4-5: Parallel
 * CAI = (0.99 * CAIs) + 0.48
 CAIs = CERCHAR index for smooth (saw cut) surface
 CAI = CERCHAR index for natural surface
 Comments:




Client
Kiewit Engineering Corp

Project
Champlain-Hudson Power Express Project

Project No. JD215256

ASTM D7012 Stress/ Strain Curve

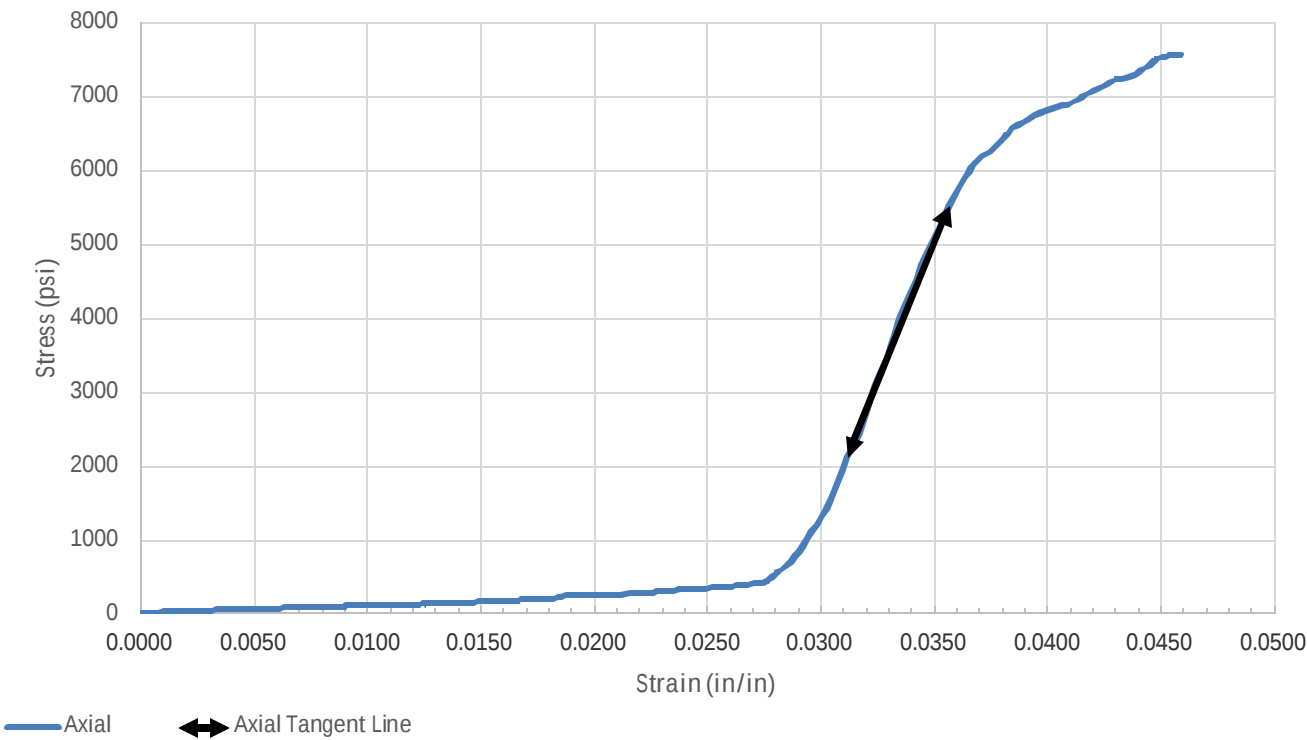

SAMPLE LOCATION			
Site:	Kiewit Engineering Power Express		
Description:	Calcareous Meta Sandstone		
Boring:	K-222.4	Depth (feet):	25.8-30.8
SPECIMEN INFORMATION			
Sample No.:		Mass (g):	569.52
Length (in.):	4.13	Diameter (in.):	2
L/D Ratio:	2.065	Density (pcf):	167.219
TEST RESULTS			
Failure Load (lbs):		23795	
Failure Strain (in/in):		0.052	
Unconfined Compressive Strength (psi):		7,574	
Elastic Modulus, E, (ksi):		756	
Time of Failure (min):		03:19	
Rate of Loading (in/sec):		0.04	
Moisture Content Post-break:		0.88%	

Rock Core D7012 Method C

Client	Project
Kiewit Engineering Corp	Champlain-Hudson Power Express Project

Project No. JD215256

Equipment:	TICCS ID:
Calipers	W-44049
Scale	B-71466
Dial Indicator	C-70608
Compression (spherically seated)	C-48999

Samples were prepared and tested in accordance with ASTM D4543 and D7012. Deviations, if any, are noted below:
Notes:

Per ASTM D4543, this specimen has not met the requirements for perpendicularity, by exceeding 0.250°.
Per ASTM D4543, this specimen has not met the requirements for flatness, by exceeding 0.001 inches.
Per ASTM D4543, this specimen has not met the requirements for parallelism, by exceeding 0.25°.

According to ASTM D7012 Section 8.2.1, this specimen, although not meeting all requirements of ASTM D4543 is acceptable for testing. However, the results reported may differ from results obtained from a test specimen that meets the requirements of D4543.

Client	Project
Kiewit Engineering Corp	Champlain-Hudson Power Express Project

Project No. JD215256

Boring	K-222.4	Material Description			Calcareous Meta Sandstone
Sample No		Equipment Used			Tinius Olsen (120,000lbs)
Depth (ft)	25.8-30.8	TICCS ID/Serial No.			C-48999, 118285
Lab No	2979	Calibration Date			11/2/2021
Splitting Tensile Strength of Intact Rock Core Specimens, ASTM D3967					
	TENSILE STRENGTH				
Lab No.	1	2	3	4	5
Diameter (in)	1.94	1.99	1.95	1.97	1.96
Length (in)	0.6	0.64	0.68	0.75	0.66
Length Diameter Ratio	0.31	0.32	0.35	0.38	0.34
Rate of Loading	0.006	0.0064	0.0068	0.0075	0.0066
Moisture Condition	0.83%	0.83%	0.83%	0.83%	0.83%
Maximum Applied Load (lbf)	3925	4718	3321	4178	3471
Splitting Tensile Strength (psi)	2147.8	2359.5	1595.2	1801.1	1709.1
	TENSILE STRENGTH				
Lab No.	6	7	8	9	10
Diameter (in)	1.97	1.99	1.99	1.97	1.97
Length (in)	0.59	0.68	0.64	0.63	0.6
Length Diameter Ratio	0.30	0.34	0.32	0.32	0.30
Rate of Loading	0.0059	0.0068	0.0064	0.0063	0.006
Moisture Condition	0.83%	0.83%	0.83%	0.83%	0.83%
Maximum Applied Load (lbf)	2958	1745	4540	4638	3787
Splitting Tensile Strength (psi)	1621.0	821.4	2270.5	2380.3	2040.7



Package 7A Phase 3 Borings
Champlain Hudson Power Express
New York

PROJECT NUMBER 20001480

CREATED BY Kiewit
DATE 12/08/2022

Legend Key
● Kiewit Borings (Phase 3)





Kiewit

EXPLORATORY BORING LOG

Champlain Hudson Power Express
New York

BORING NO: KB-222.2

PROJECT NUMBER 20001480
START DATE 09/13/2022
FINISH DATE 09/14/2022

LOGGED BY J. Knighton
DRILLER/RIG T. Van Ness / CME-75
DRILL CONTRACTOR ADT Inc.

COORDINATES N 1232655.66
E 659566.12
GROUND ELEV. 123.1 ft
HAMMER TYPE/EFF. Automatic

Depth (ft)	Elevation (ft)	Graphic Log	Material Description	Sample Type	Core Run No.	Recovery %	RQD	Pocket Pen. (tsf)	Blow Counts (N Value)	Notes	Legend			
											▲	●	—	■
	123.0		2" Topsoil											
			FILL: Silty SAND with Gravel, loose, fine to coarse gravel, wet			30%			4-5-3-3 (8)	Boring advanced with 3-7/8" Mud Rotary				
	120.1		SILT (MH), brown, firm to stiff, moist, high plasticity			50%	0.8		4-4-5-4 (9)					
5						100%	2.5		1-3-4-5 (7)					
						100%	2.5		7-6-7-7 (13)					
10						100%	2.0		2-3-3-5 (6)	Set 4" casing to 10 ft				
								1.0						
15			Gray clay in spoon at 15 - 16 ft			100%			1-3-4-4 (7)					
			Brown at 16 - 17 ft				1.8							
20														
	102.1		LEAN CLAY (CL), gray, firm to very soft, wet, medium plasticity			100%	2.2		2-3-4-3 (7)					
25														
						100%	0.8		1-1-2-2 (3)					
30														



Kiewit

EXPLORATORY BORING LOG

Champlain Hudson Power Express
New York

BORING NO: KB-222.2

PROJECT NUMBER 20001480
START DATE 09/13/2022
FINISH DATE 09/14/2022

LOGGED BY J. Knighton
DRILLER/RIG T. Van Ness / CME-75
DRILL CONTRACTOR ADT Inc.

COORDINATES N 1232655.66
E 659566.12
GROUND ELEV. 123.1 ft
HAMMER TYPE/EFF. Automatic

Depth (ft)	Elevation (ft)	Graphic Log	Material Description	Sample Type	Core Run No.	Recovery %	RQD	Pocket Pen. (tsf)	Blow Counts (N Value)	Notes	Legend			
											▲	●	—	■
			LEAN CLAY (CL), gray, firm to very soft, wet, medium plasticity			100%	0.5		0-0-1-2 (1)					
35						100%	0.5		1-2-2-3	3-inch ring sampler				
40						100%			0-0-0-2 (0)					
45						100%			0-0-1-2 (1)					
74.1			Weathered rock			38%			34-18-20-26	3-inch ring sampler				
70.1			Graywacke, gray, very closely to moderately spaced discontinuities, good RQD, moderately weathered							Driller noted increased resistance at 53 ft Set 3" casing to 55 ft Cut with tricone bit to 55 ft UCS = 12,091 psi				
55					1	95%	79							
60														



Kiewit

EXPLORATORY BORING LOG

Champlain Hudson Power Express
New York

BORING NO: KB-222.2

PROJECT NUMBER 20001480
START DATE 09/13/2022
FINISH DATE 09/14/2022

LOGGED BY J. Knighton
DRILLER/RIG T. Van Ness / CME-75
DRILL CONTRACTOR ADT Inc.

COORDINATES N 1232655.66
E 659566.12
GROUND ELEV. 123.1 ft
HAMMER TYPE/EFF. Automatic

Depth (ft)	Elevation (ft)	Graphic Log	Material Description	Sample Type	Core Run No.	Recovery % RQD	Pocket Pen. (tsf)	Blow Counts (N Value)	Notes	Legend			
										▲ SPT N Value	● MC (%)	— PL & LL (%)	☒ Fines Content (%)
										20	40	60	80
			Graywacke, gray, very closely to moderately spaced discontinuities, good RQD, moderately weathered		2	98% 97							
65													
			Very closely spaced discontinuities, occasional calcite veins and shale lenses		3	92% 65							
70	53.1		Boring Terminated at 70 ft										
75													
80													
85													
90													

Champlain Hudson Power Express
Kiewit Engineering (NY) Corp.

KB-222.2 - Runs 1 through 3



Summary of Laboratory Results


Sheet 1 of 2

Sheet 1 of 2		
BORING ID	Depth (Ft.)	Water Content (%)
KB-183.6	8	11.5
KB-183.8	4-6	12.7
KB-184.0	4-6	19.9
KB-184.0	10-12	14.1
KB-187.5	10-12	15.9
KB-187.5	20-22	9.2
KB-187.5	30-32	14.1
KB-187.5	40-42	12.2
KB-187.5	45-47	10.9
KB-187.5	60-62	7.5
KB-187.7	10-12	6.3
KB-187.7	20-22	24.3
KB-187.7	35-37	7.2
KB-187.7	55-57	6.6
KB-190.8	4-6	10.9
KB-190.8	15-17	22.7
KB-191.7	4-6	24.0
KB-191.7	10-12	28.2
KB-191.7	25-27	33.6
KB-192.8A	8-10	29.1
KB-192.8A	20-22	30.3
KB-192.8A	40-42	19.6
KB-193.9	4-6	30.2
KB-193.9	10-12	35.1
KB-193.9	15-17	36.0
KB-193.9	35-37	56.2
KB-194.0	4-6	37.9
KB-194.0	15-17	49.1
KB-194.0	25-27	49.4
KB-194.0	35-37	11.2
KB-220.5	8-10	14.2
KB-221.0A	4-6	30.5
KB-221.0A	8-10	9.0
KB-221.0A	15-17	6.1
KB-221.0A	25-27	6.1
KB-221.0A	35-37	6.8
KB-221.3	8	17.8
KB-221.4	4-6	14.8
KB-221.4	8-10	10.5
KB-222.2	7-9	37.9
KB-222.2	25-27	36.9
KB-222.2	40-42	38.2
PROJECT: LAB Testing		Terracon 30 Corporate Cir Ste 201 Albany, NY
SITE: Champlain- Hudson Power Express		
		PROJECT NUMBER: JB215256H
		CLIENT: Kiewit Engineering (NY) Corp Lone Tree, CO
		EXHIBIT: B-1

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. SMART LAB SUMMARY-PORTRAIT_JB215256H LAB TESTING.GPJ TERRACON_DATATEMPLATE.GDT 11/16/22

ATTERBERG LIMITS RESULTS

ASTM D4318

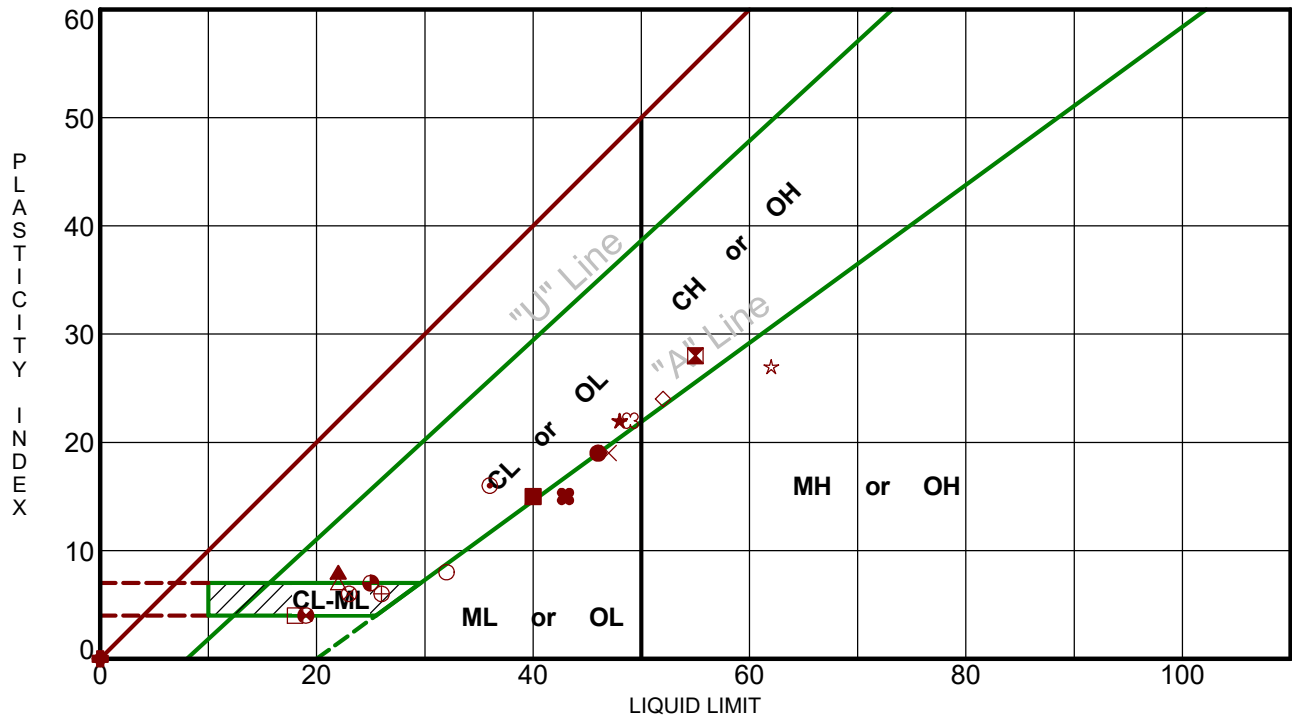

Boring ID	Depth (Ft)	LL	PL	PI	Fines	USCS	Description
● KB-193.9	15 - 17	46	27	19	70.4	CL	LEAN CLAY with SAND
⊠ KB-193.9	35 - 37	55	27	28	96.8	CH	FAT CLAY
▲ KB-194.0	4 - 6	22	14	8	81.9	CL	LEAN CLAY with SAND
★ KB-194.0	15 - 17	48	26	22	85.2	CL	LEAN CLAY
⊙ KB-194.0	25 - 27	36	20	16	97.0	CL	LEAN CLAY
⊕ KB-194.0	35 - 37	NP	NP	NP	14.7	SM	SILTY SAND with GRAVEL
○ KB-220.5	8 - 10	32	24	8	26.2	SM	SILTY SAND with GRAVEL
△ KB-221.0A	4 - 6	22	15	7	89.6	CL-ML	SILTY CLAY
⊗ KB-221.0A	8 - 10	23	17	6	11.7	GP-GC	POORLY GRADED GRAVEL with SILTY CLAY and SAND
⊕ KB-221.0A	15 - 17	26	20	6	11.8	GP-GC	POORLY GRADED GRAVEL with SILTY CLAY and SAND
□ KB-221.0A	25 - 27	18	14	4	25.9	GC-GM	SILTY, CLAYEY GRAVEL with SAND
⊕ KB-221.0A	35 - 37	19	15	4	21.0	SC-SM	SILTY, CLAYEY SAND with GRAVEL
⊕ KB-221.3	8	25	18	7	13.7	GC-GM	SILTY, CLAYEY GRAVEL with SAND
★ KB-222.2	7 - 9	62	35	27	100.0	MH	ELASTIC SILT
⊗ KB-222.2	25 - 27	49	27	22	94.8	CL	LEAN CLAY
■ KB-222.2	40 - 42	40	25	15	90.4	CL	LEAN CLAY
◆ KB-222.6A	15 - 17	NP	NP	NP	7.4	GP-GM	POORLY GRADED GRAVEL with SAND and SILT
◇ KB-222.6A	35 - 37	52	28	24	87.3	CH	FAT CLAY
✕ KB-222.6A	50 - 52	47	28	19	96.5	ML	SILT
⊕ KB-222.6A	65 - 67	43	28	15	99.3	ML	SILT

PROJECT: LAB Testing

SITE: Champlain- Hudson Power Express

Terracon
30 Corporate Cir Ste 201
Albany, NY

PROJECT NUMBER: JB215256H


CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-2

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. ATTERBERG LIMITS JB215256H LAB TESTING.GPJ TERRACON.DATATEMPLATE.GDT 11/16/22

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

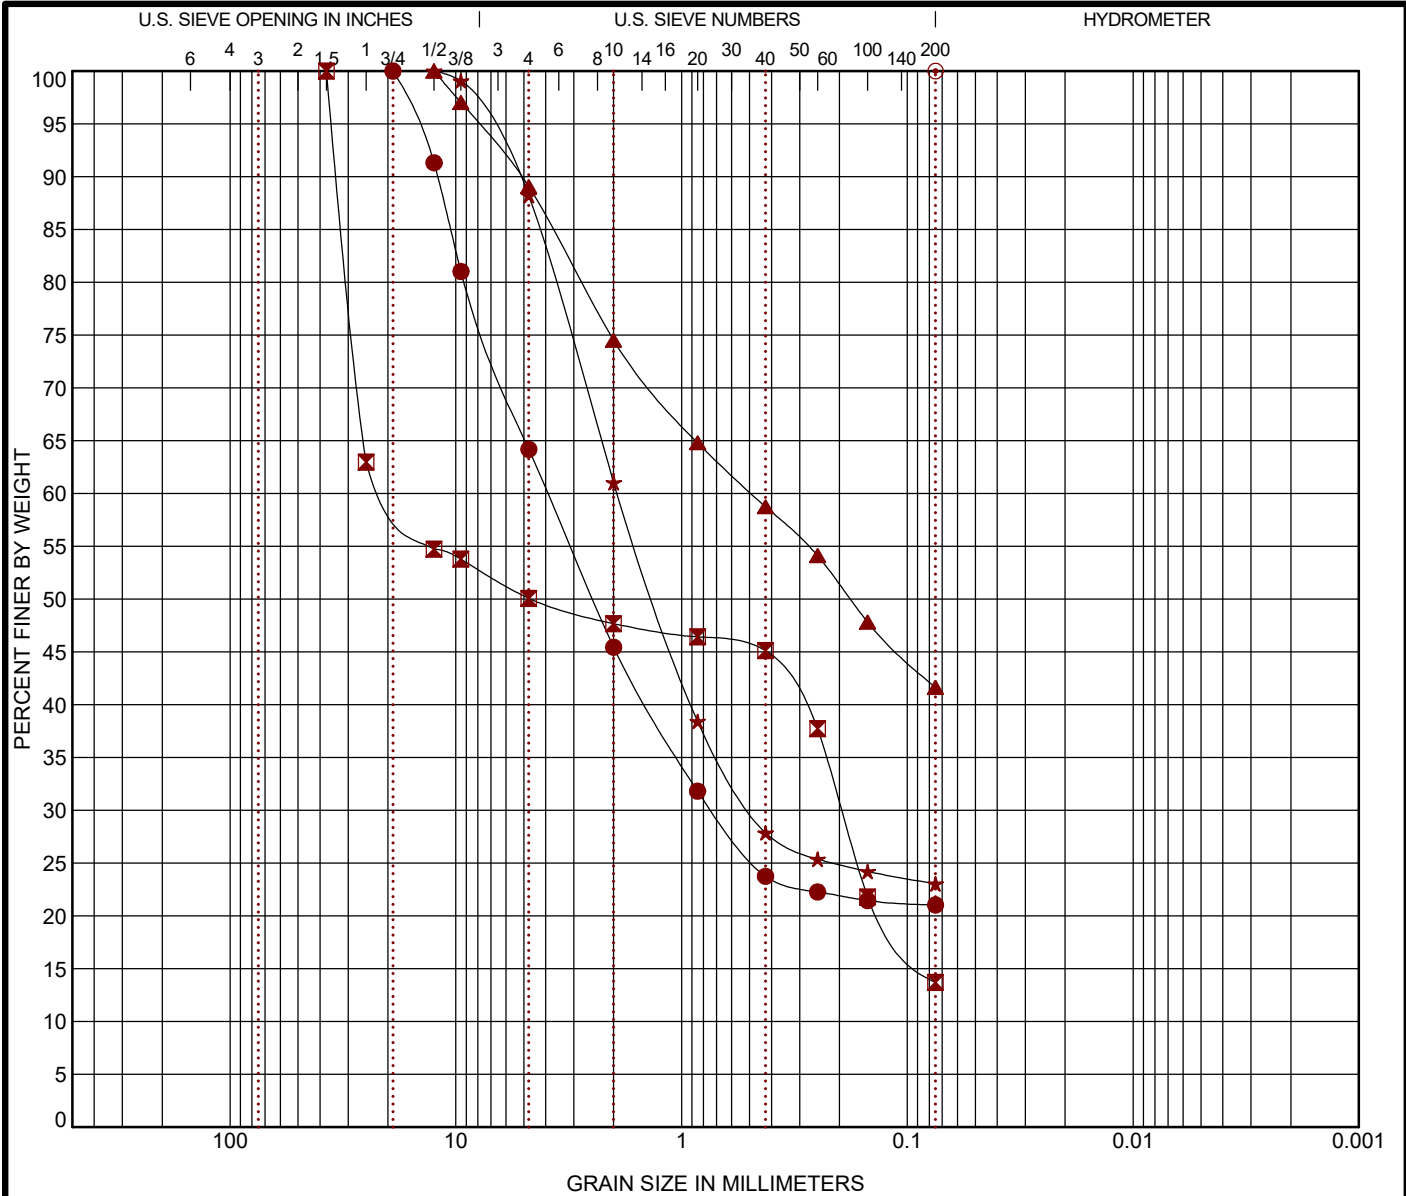

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID		Depth (Ft)	USCS Classification					WC (%)	LL	PL	PI	Cc	Cu
●	KB-221.0A	35 - 37	SILTY, CLAYEY SAND with GRAVEL (SC-SM)					6.8	19	15	4		
⊠	KB-221.3	8	SILTY, CLAYEY GRAVEL with SAND (GC-GM)					17.8	25	18	7		
▲	KB-221.4	4 - 6	SILTY SAND (SM)					14.8					
★	KB-221.4	8 - 10	SILTY SAND (SM)					10.5					
⊙	KB-222.2	7 - 9	ELASTIC SILT (MH)					37.9	62	35	27		
Boring ID		Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay	
●	KB-221.0A	35 - 37	19	3.917	0.728		0.0	35.8	43.1		21.0		
⊠	KB-221.3	8	37.5	19.495	0.195		0.0	49.9	36.4		13.7		
▲	KB-221.4	4 - 6	12.5	0.491			0.0	10.9	47.4		41.6		
★	KB-221.4	8 - 10	12.5	1.924	0.489		0.0	11.8	65.2		23.0		
⊙	KB-222.2	7 - 9	0.075				0.0	0.0	0.0		100.0		

PROJECT: LAB Testing

SITE: Champlain- Hudson Power Express

Terracon
30 Corporate Cir Ste 201
Albany, NY

PROJECT NUMBER: JB215256H

CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO


EXHIBIT: B-8

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256H LAB TESTING.GPJ TERRACON_DATATEMPLATE.GDT 11/16/22

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256H LAB TESTING.GPJ TERRACON_DATATEMPLATE.GDT 11/16/22

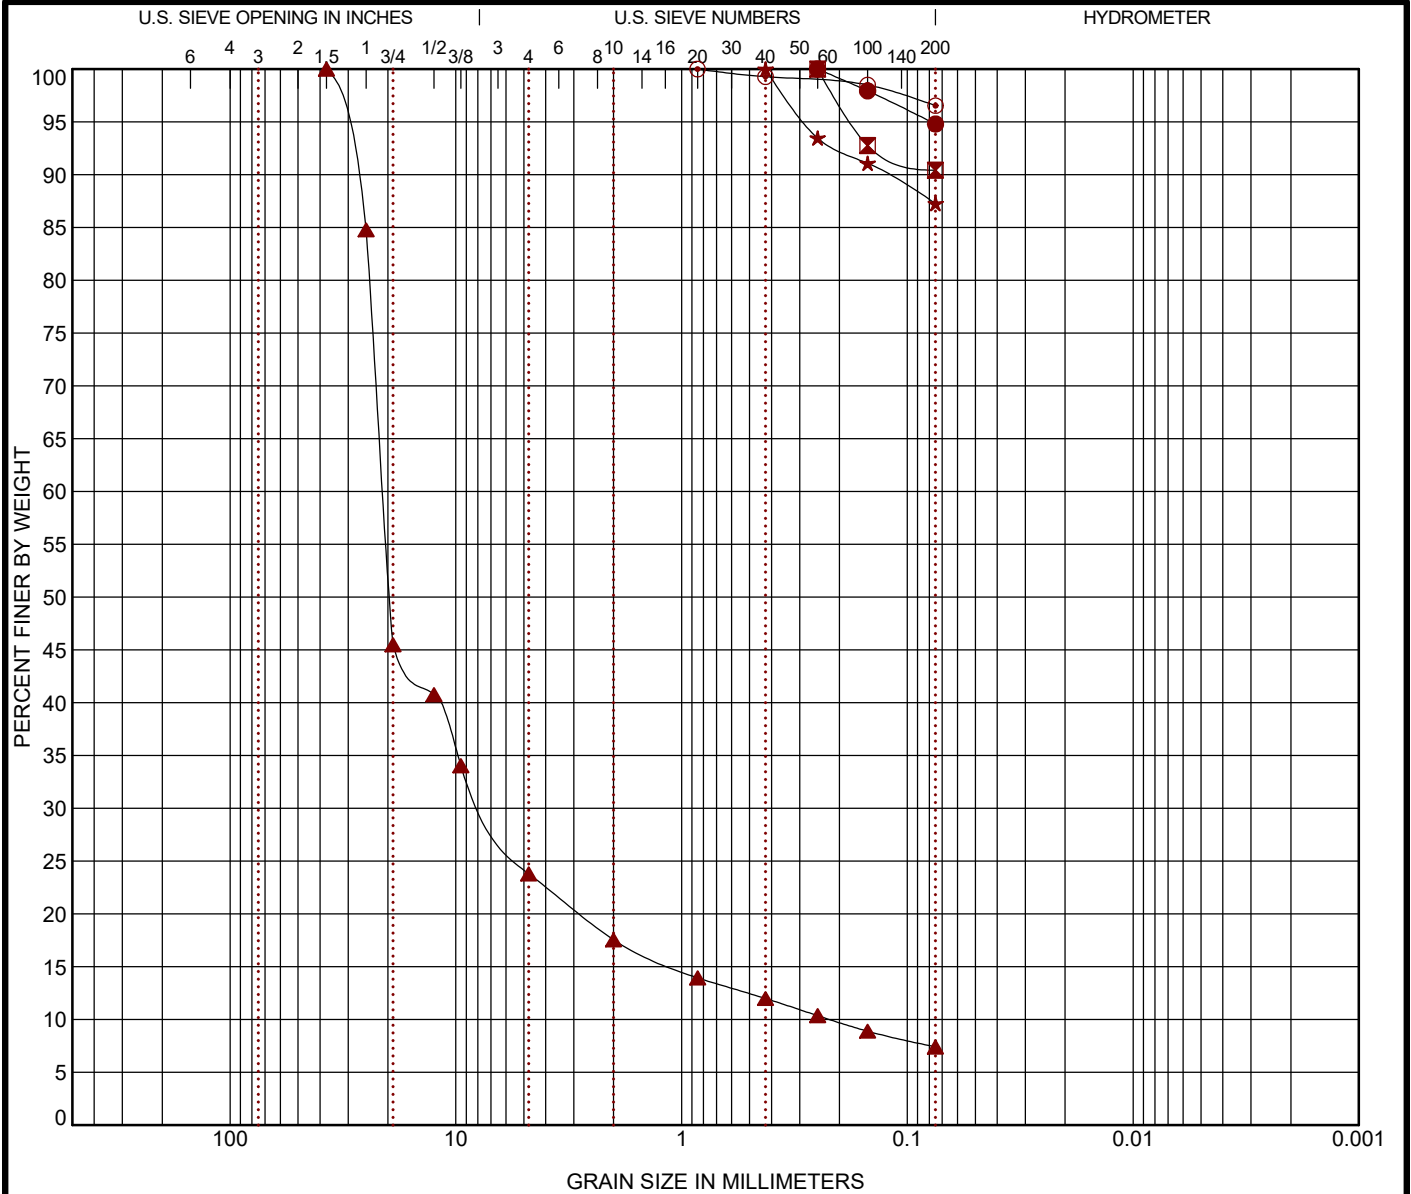

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID	Depth (Ft)	USCS Classification					WC (%)	LL	PL	PI	Cc	Cu
● KB-222.2	25 - 27	LEAN CLAY (CL)					36.9	49	27	22		
⊠ KB-222.2	40 - 42	LEAN CLAY (CL)					38.2	40	25	15		
▲ KB-222.6A	15 - 17	POORLY GRADED GRAVEL with SAND and SILT (GP-GM)					1.2	NP	NP	NP	11.29	95.41
★ KB-222.6A	35 - 37	FAT CLAY (CH)					35.8	52	28	24		
⊙ KB-222.6A	50 - 52	SILT (ML)					41.7	47	28	19		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay	
● KB-222.2	25 - 27	0.25				0.0	0.0	5.2		94.8		
⊠ KB-222.2	40 - 42	0.25				0.0	0.0	9.6		90.4		
▲ KB-222.6A	15 - 17	37.5	21.027	7.232	0.22	0.0	76.2	16.4		7.4		
★ KB-222.6A	35 - 37	0.425				0.0	0.0	12.7		87.3		
⊙ KB-222.6A	50 - 52	0.85				0.0	0.0	3.5		96.5		

PROJECT: LAB Testing

SITE: Champlain- Hudson Power Express



PROJECT NUMBER: JB215256H

CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-9

Client


Kiewit Engineering (NY) Corp

Project

LAB Testing

Project No. JB215256H

ASTM D7012 Stress/ Strain Curve

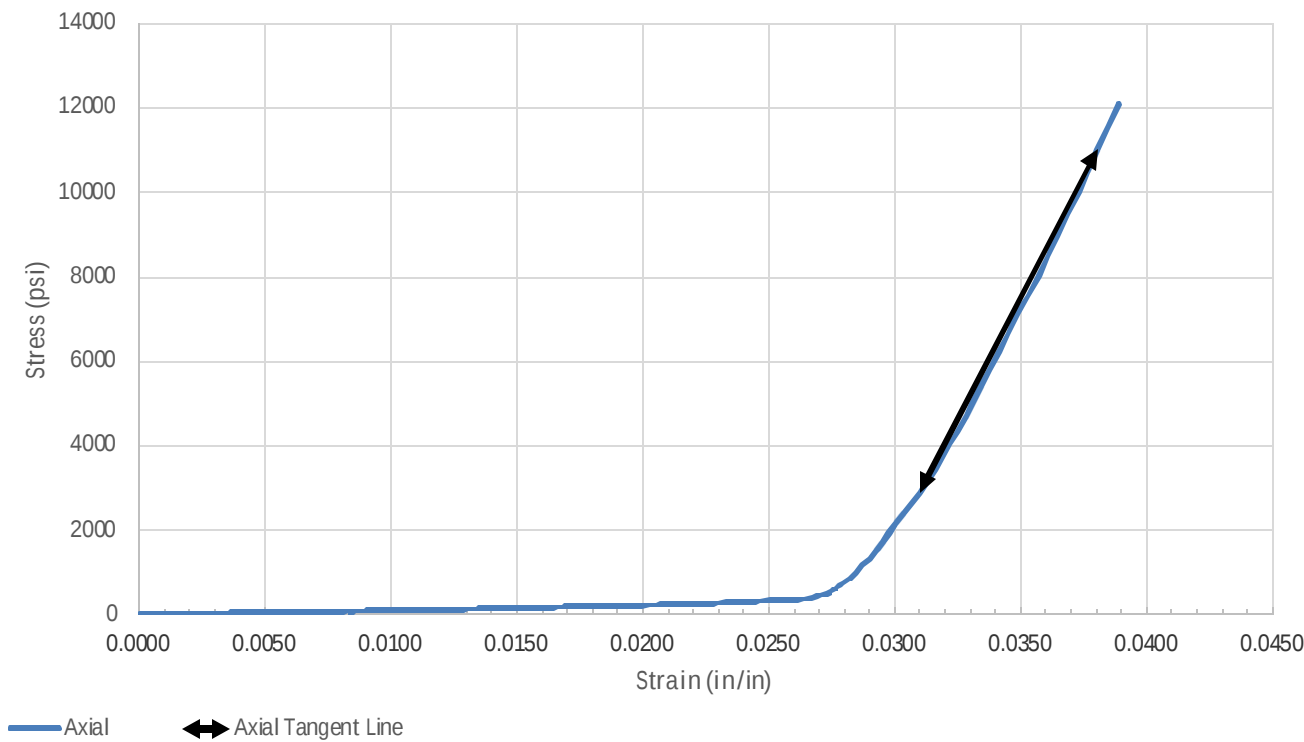

SAMPLE LOCATION

Site:	LAB Testing		
Description:	Greywacke		
Boring:	KB-222.2	Depth (feet):	55.0-60.0

SPECIMEN INFORMATION

Sample No.:	RC1	Mass (g):	556.78
Length (in.):	4.14	Diameter (in.):	1.97
L/D Ratio:	2.10	Density (pcf):	168.09

TEST RESULTS

Failure Load (lbs):	36853
Failure Strain (in/in):	0.042
Unconfined Compressive Strength (psi):	12,091
Elastic Modulus, E, (ksi):	1152
Time of Failure (min):	02:10
Rate of Loading (in/sec):	0.04
Moisture Content Post-break:	0.56%

Rock Core D7012 Method C



Client	Project
Kiewit Engineering (NY) Corp	LAB Testing

Project No. JB215256H

Equipment:	TICCS ID:
Calipers	W-44049
Scale	B-71466
Dial Indicator	C-70608
Compression (spherically seated)	C-48999

Samples were prepared and tested in accordance with ASTM D4543 and D7012. Deviations, if any, are noted below:
Notes:

Per ASTM D4543, this specimen has not met the requirements for perpendicularity, by exceeding 0.250°.
Per ASTM D4543, this specimen has not met the requirements for flatness, by exceeding 0.001 inches.
Per ASTM D4543, this specimen has not met the requirements for parallelism, by exceeding 0.25°.
Per ASTM D4543, this specimen has not met the requirements for flatness, by exceeding 0.001 inches.
Per ASTM D4543 and ASTM D7012, the desired specimen length to diameter are between 2.0:1 and 2.5:1.

According to ASTM D7012 Section 8.2.1, this specimen, although not meeting all requirements of ASTM D4543 is acceptable for testing. However, the results reported may differ from results obtained from a test specimen that meets the requirements of D4543.

DATE: March 15, 2023

TO: Zachary Bauer; Tetra Tech Rooney

FROM: Matthew Hawley, P.E.; Kiewit Engineering (NY) Corp. 
Jaren Knighton; Kiewit Engineering (NY) Corp.

SUBJECT: Geotechnical Data: Segment 11 – Package 7A – HDD Crossing 119 – Revision 2
Champlain Hudson Power Express Project
Catskill, New York

Kiewit Engineering is providing the attached geotechnical data for use in the horizontal direction drill (HDD) design for the Champlain Hudson Power Express project in Upstate New York. This HDD crossing is located southwest of Catskill, New York. The approximate station for the start of HDD crossing number 119 is STA 70158+50 (42.2109° N, 73.8873° W).

The geotechnical data at this HDD crossing is attached. The available data is taken from the previous investigation by TRC and the recent investigations by Terracon and Kiewit, referenced below.

- TRC, Geotechnical Data Report, Champlain Hudson Power Express, Canadian Pacific Railway Borings MP 177.6-228.2, dated March 15, 2013.
- Terracon Consultants-NY, Inc., Results of Field Exploration, Champlain-Hudson Power Express – Package 7a, Catskill, NY, dated May 23, 2022.
- Kiewit Engineering (NY) Corp., Package 7A Phase 3 Borings, Champlain Hudson Power Express, New York, dated December 8, 2022.
- Kiewit Engineering (NY) Corp., Package 7A Phase 4 Borings, Champlain Hudson Power Express, NY, dated February 17, 2023.

Contact us if you have questions or require additional information.

HDD 119
Borings B222.6-1, K-222.6,
K-222.7, KB-222.6A, KB-222.8
Segment 11 - Design Package 7A

CHPE Segment 11 - Package 7A

HDD Soil Boring Coordinates and Elevations

Firm	Boring	Northing (feet)	Easting (feet)	Ground Surface Elevation (feet)
TRC*	B221.0-1	1237452.6	663787.2	99.6
	B221.2-1	1236173.4	663261.8	115.0
	B221.4-1	1235622.5	662622.3	22.4
	B221.5-1	1235006.9	662058.8	95.5
	B221.6-1	1234675.8	661633.8	98.3
	B221.8-1	1234265.3	661277.2	99.4
	B222.34-1	1232191.5	659098.9	133.5
	B222.6-1	1231252.6	658182.3	113.7
	B222.9-1	1229751.0	657274.3	121.4
	B225.8-1	1215861.0	650622.7	91.0
	B226.1-1	1214654.4	650328.3	105.9
	B226.2-1	1214120.5	650254.4	108.5
	B226.6-1	1211894.7	649689.7	112.1
AECOM**	CU-1	1237028.6	663123.9	19.7
	CU-2	1236042.7	662897.0	24.8
	CU-2A	1235325.9	662268.9	38.1
	CU-5A	1210523.7	649411.8	118.4
	SC-5	1239310.3	664321.6	110.2
	SC-6	1237781.0	663919.8	101.6

Notes:

- Northings and Eastings are provided in NAD83 New York State Plane East Zone.

- Elevations are referenced to the NAVD88 datum.



* TRC boring coordinates as shown in Table 1-6 in AECOM report (reference below). Boring elevations estimated from November 2021 topographic survey by Williams Aerial.

** AECOM boring coordinates and elevations as shown in Table 1-6 in AECOM report.

*** Kiewit boring coordinates and elevations are noted on the boring logs.

Reference:

AECOM, Geotechnical Data Report, Upland Segments: Putnam Station, Washington County, to Cementon, Green County, NY, Champlain Hudson Power Express, dated May 28, 2021.

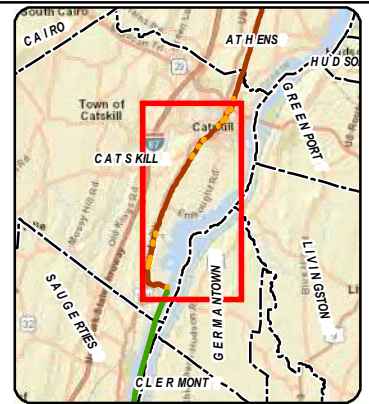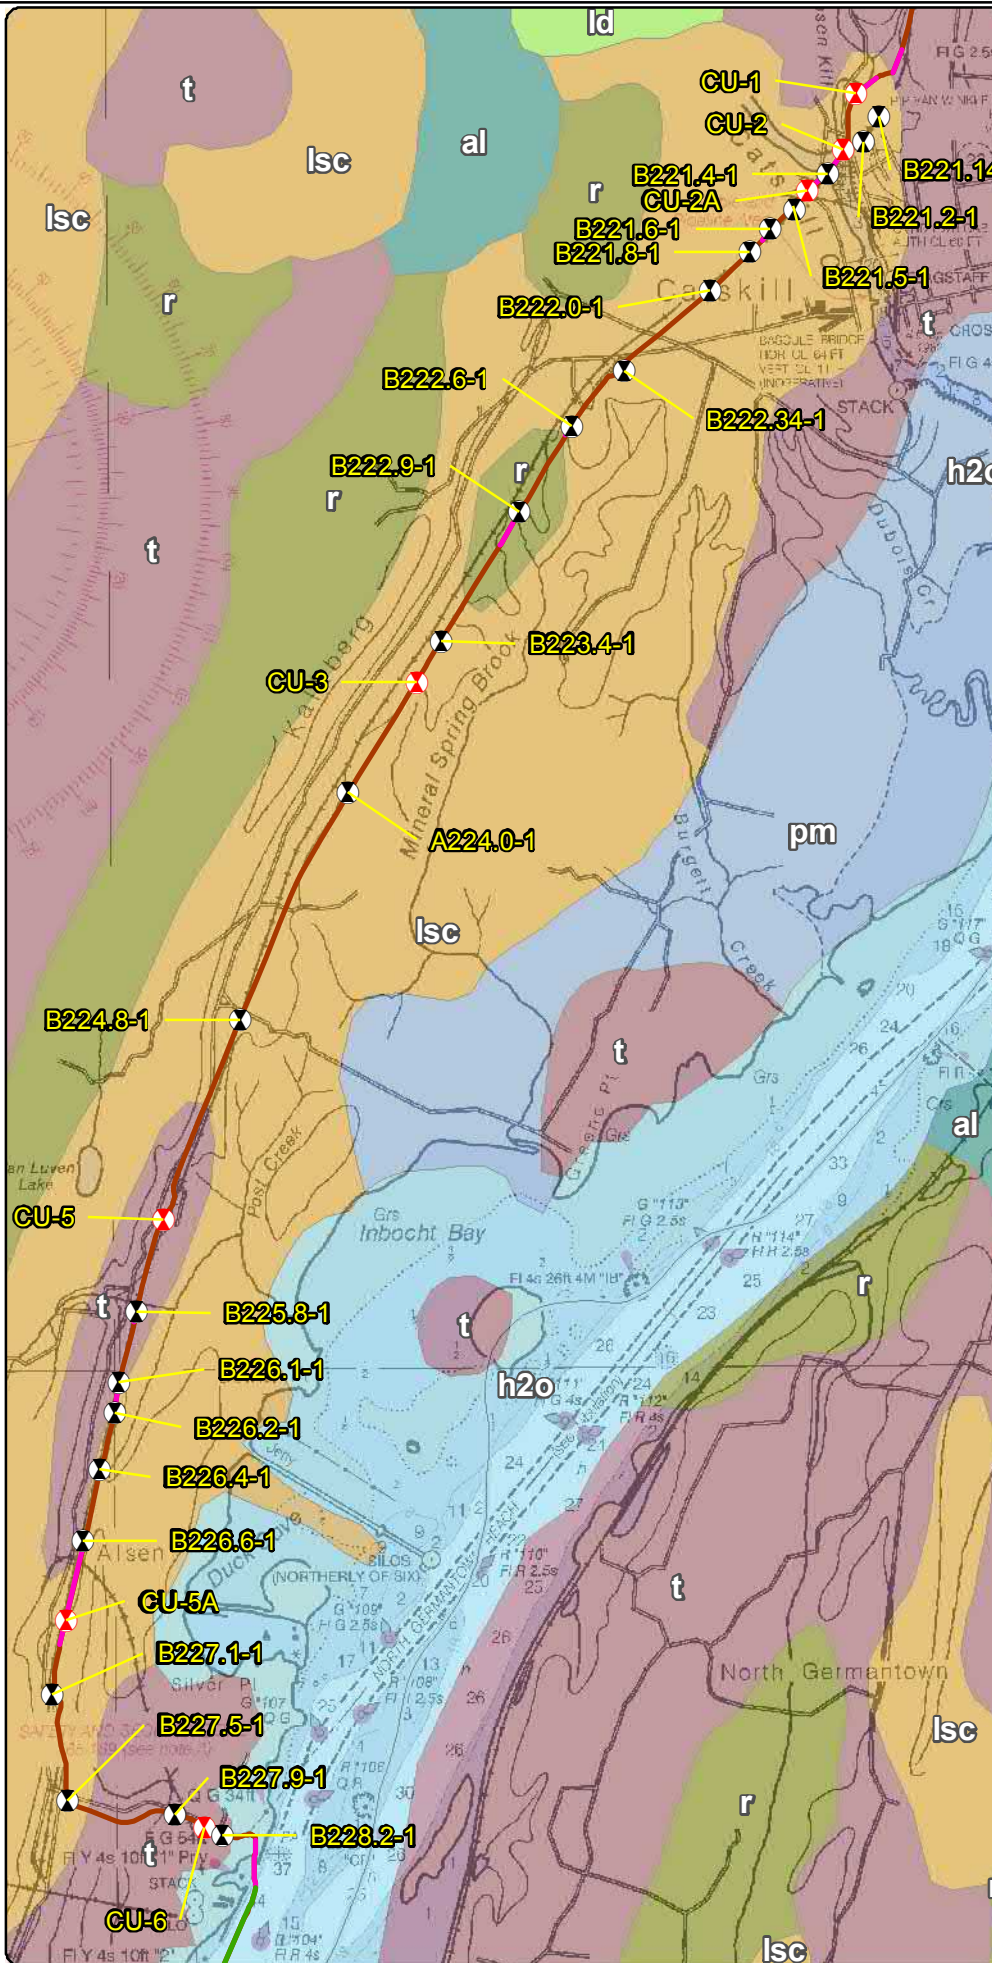

LEGEND

- 2021 Boring Location
- Previous (2013) Boring Location
- Terrestrial Route HVDC
- Submarine Route HVDC
- Terrestrial Route HVAC
- Preliminary HDD Locations
- Preliminary Pipe Bridge Location
- Town Boundary
- County Boundary

Surficial Geology

- al - Recent alluvium
- h2o - Water
- ld - Lacustrine delta
- lsc - Lacustrine silt and clay
- pm - Swamp deposits
- r - Bedrock
- t - Till




0.3 0.15 0 0.3 Miles





Champlain Hudson Power Express Project
Champlain Hudson Power Express Inc.

Surficial Geology and Geotechnical Borings Catskill to Upland Figure 3-11

Prepared on 5/3/2021
by: **AECOM**

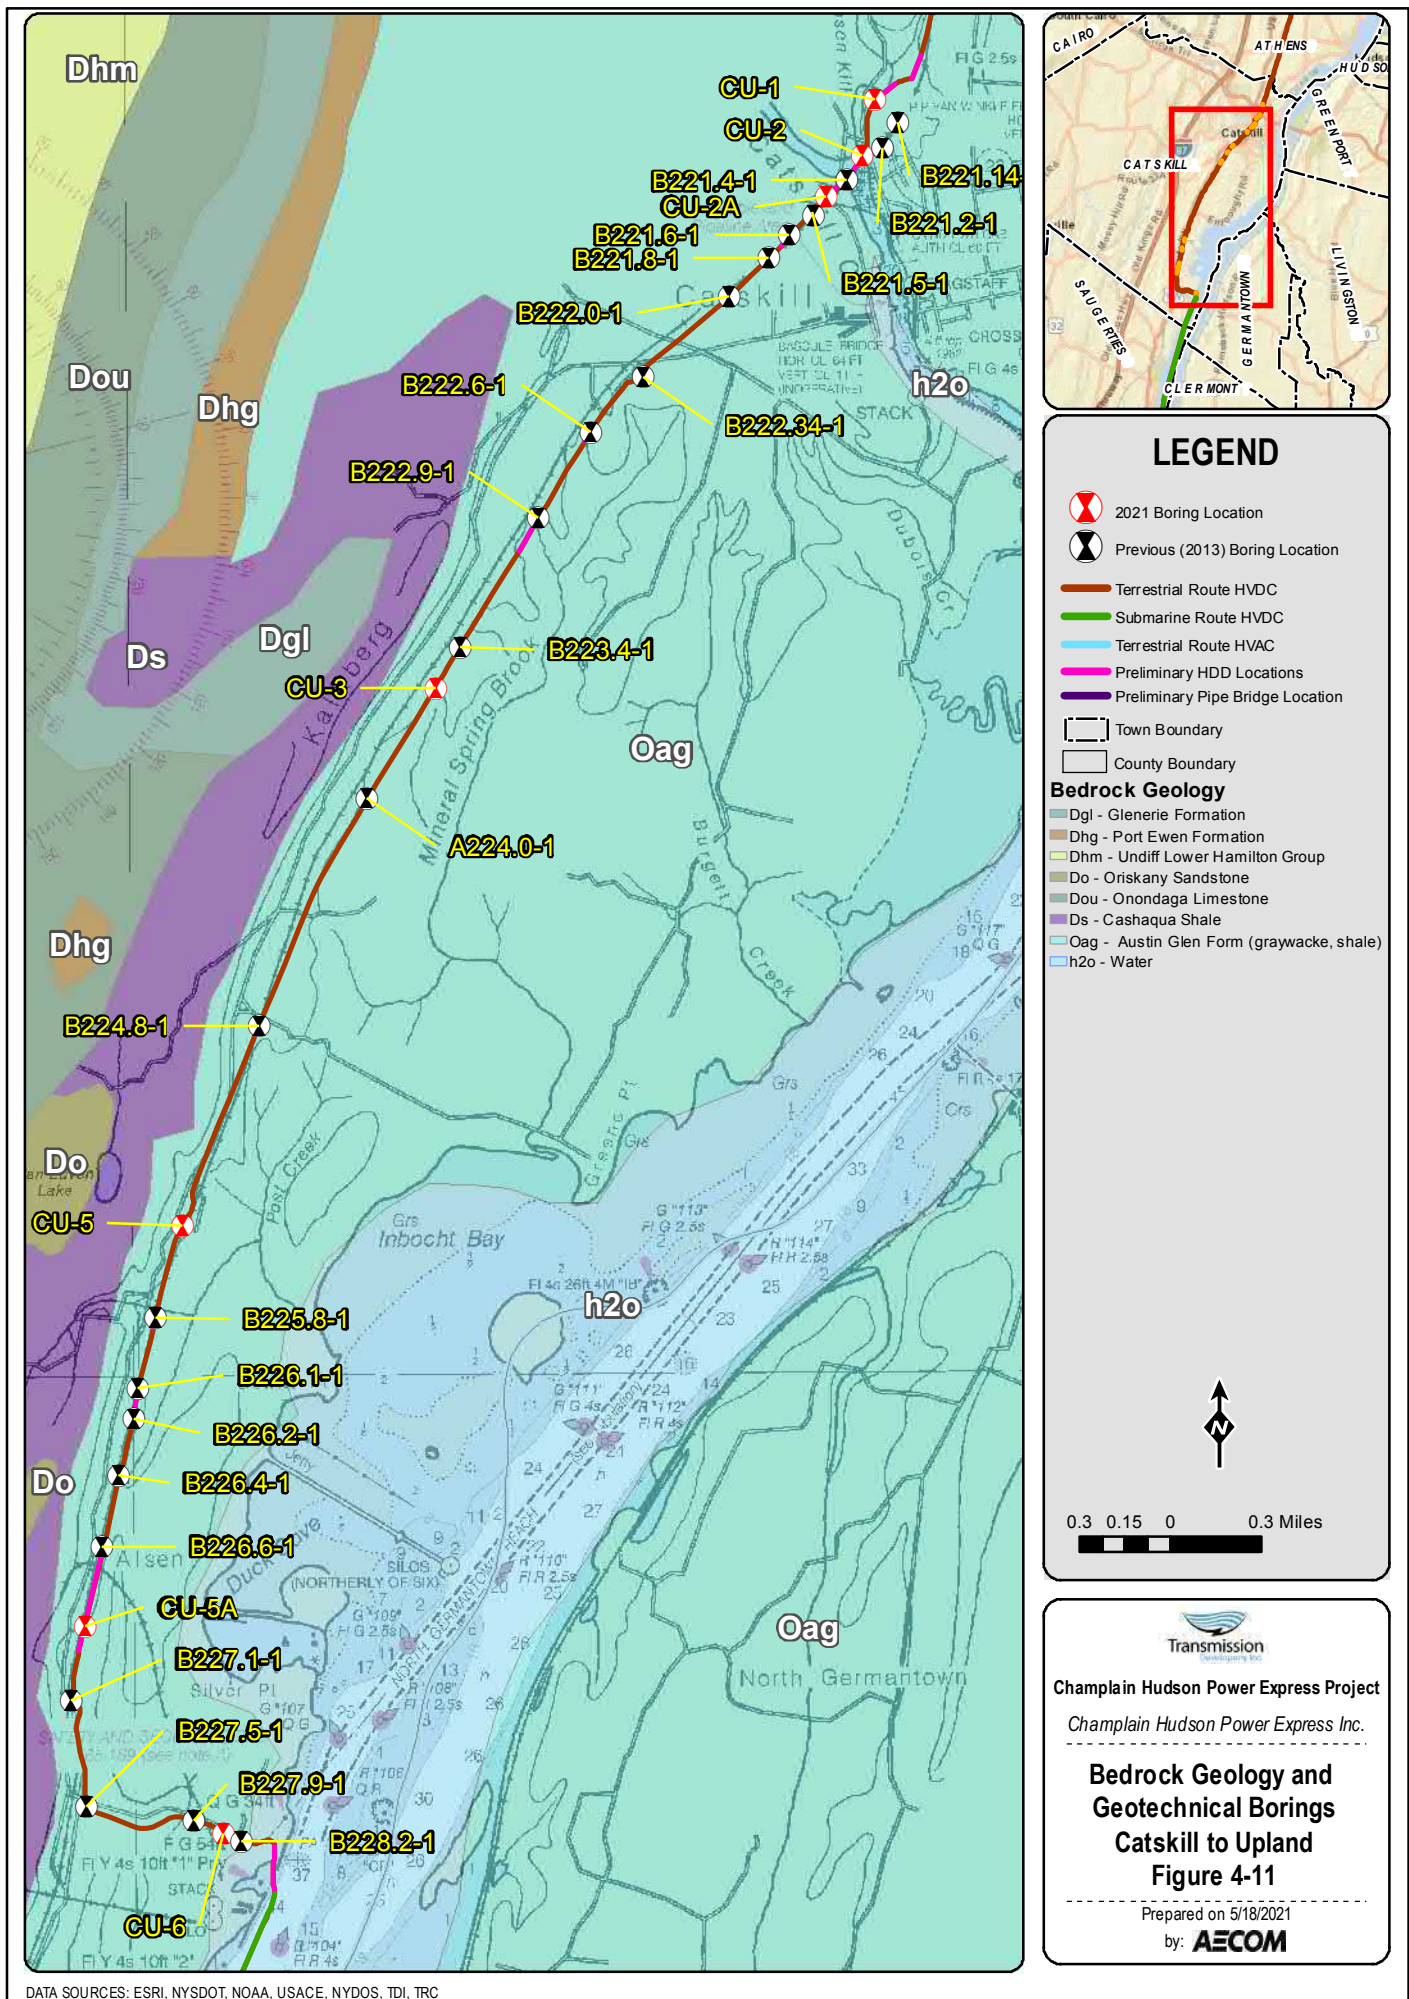

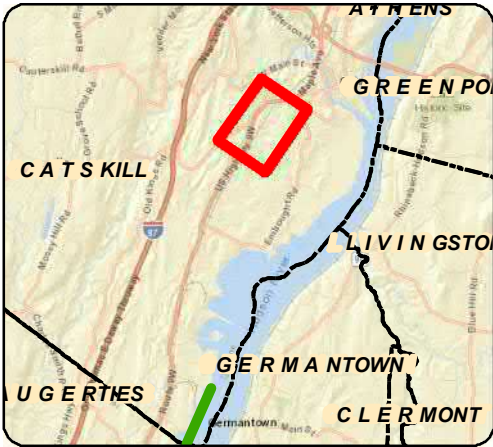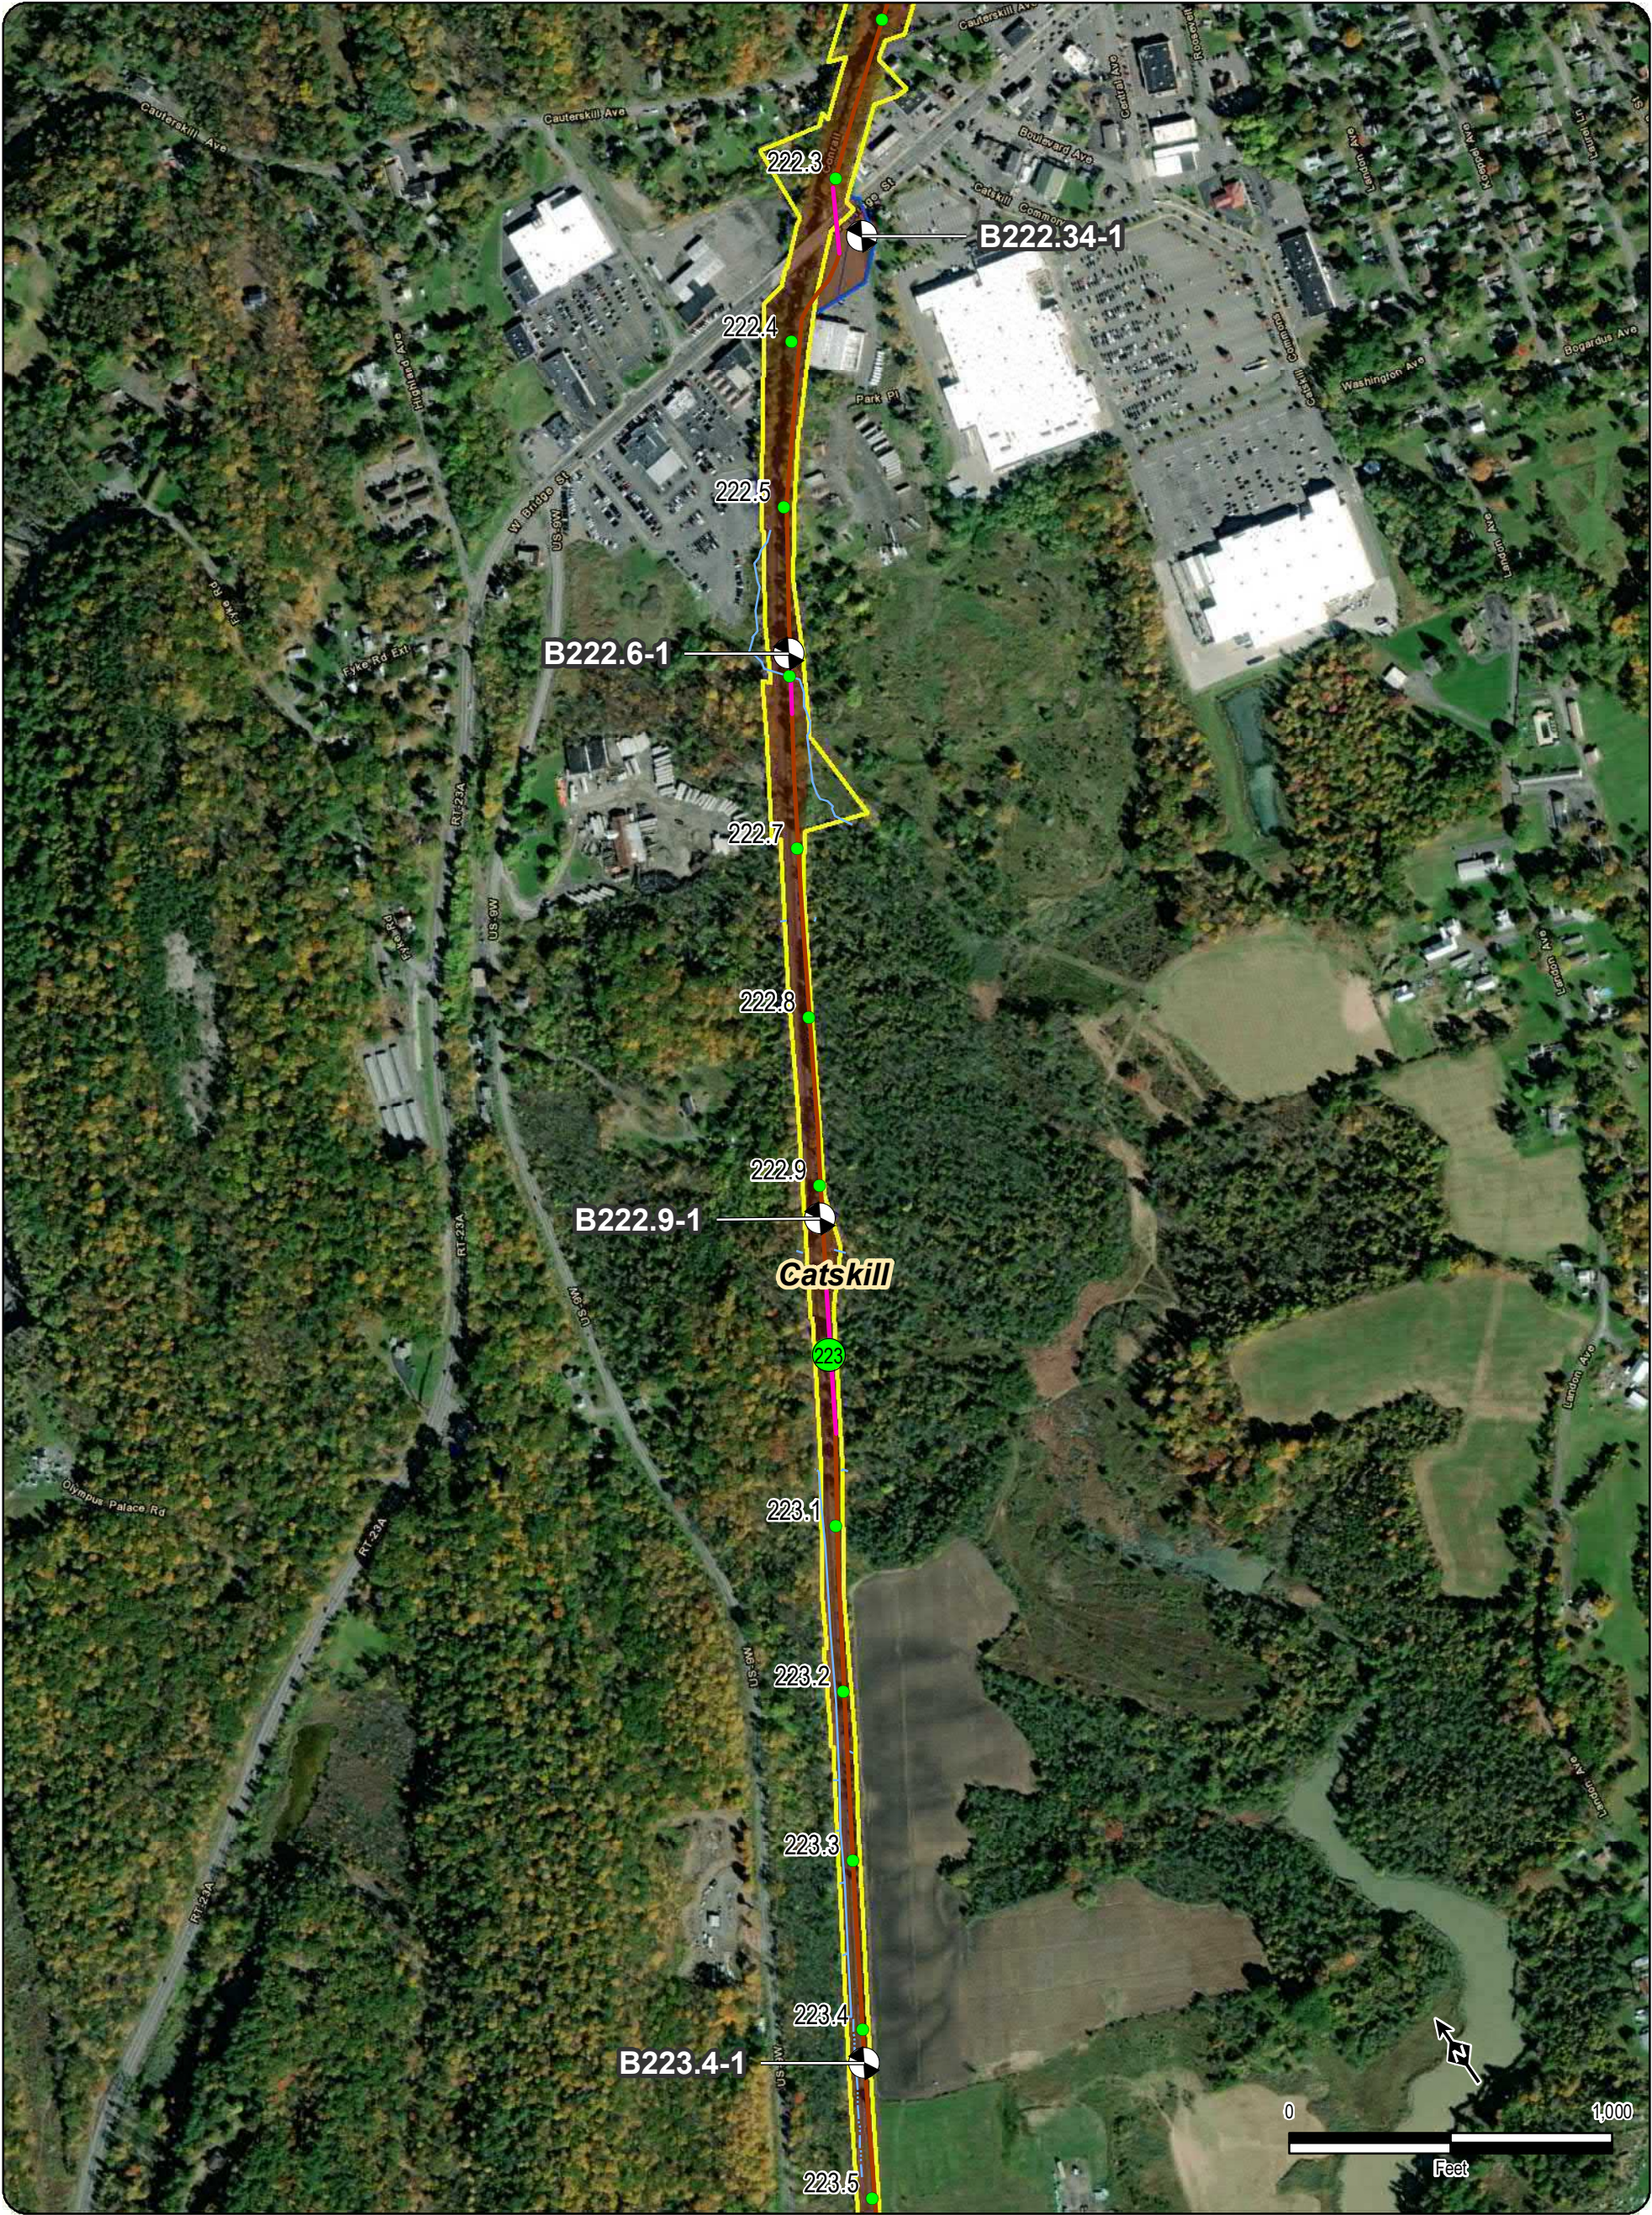

111.8

Certified Milepost - Tenths

111.8

Certified Milepost

135

Preferred Alternative Milepost

Preferred Alternative Milepost - Tenths

Preferred Alternative Milepost

Terrestrial Route HVDC

Submarine Route HVDC

Terrestrial Route HVAC

Preliminary HDD Locations

Preliminary Pipe Bridge Location

2021 Boring Location

Previous (2013) Boring Location

LEGEND

Streams/Ditches

Railroad ROW

Deviation Zone

Deviation Zone Outside ROW

Preferred Alternative Deviation Zone

Preferred Alternative Deviation Zone Outside ROW

Town Boundary

Village Boundary

State Park (OPRHP)

Parcel Ownership

TOWN NAME

Road Name

Village Name

Transmission

Developers Inc.

Champlain Hudson Power Express Project

Champlain Hudson Power Express Inc.

BORING LOCATION PLAN

Catskill to Upland

Figure A-11

Sheet 2 of 6

Prepared by:

AECOM

5/20/2021

DATA SOURCES: ESRI, NETWORK MAPPING 2010, NYSDOT, OPRHP, TDI, TRC

Y:\Projects\CHPE\Route\Consensus_Alternative_Routes\MXD\A11.5_Routes_DZ_201909\Boring_Locations\Maps_for_May_2021_Report\Catskill_to_Upland_Boring_Locations_Mapset_May_2021_Report.mxd



TEST BORING LOG

PROJECT: TDI CHAMPLAIN HUDSON POWER EXPRESS

LOCATION: CSX RAILROAD ROW, NY

BORING **B222.6-1**

G.S. ELEV. N/A

FILE 195651

SHEET 1 OF 1

GROUNDWATER DATA

FIRST ENCOUNTERED NR

DEPTH HOUR DATE ELAPSED TIME

23.5' NR 12/2 0 HR

METHOD OF ADVANCING BOREHOLE

a FROM 0.0' TO 10.0'

d FROM 10.0' TO 14.0'

c₂ FROM 14.0' TO 27.5'

d FROM 27.5' TO 30.5'

DRILLER P. PLANTIER

HELPER M. NAGEY

INSPECTOR N/A

DATE STARTED 12/02/2012

DATE COMPLETED 12/02/2012

DEPTH	A	B	C	DESCRIPTION	Wn	REMARKS
				BLACK SILT, SM F/ SAND, TR F/ GRAVEL (FILL)		
	S-1	1 2 2 3		2.0		
	S-2	50/0.4				
				GRAY SILT, TR TO SM F/ GRAVEL, TR CLAY, TR F/ SAND (FILL)		
				4.0		
5				BROWN TO DARK GRAY SILT, TR F/M SAND (FILL)	19.6	
	S-3	4 6 5 4		6.0		
	S-4	4 7 6 5				
10	S-5	4 8 9 10		BROWN TO GRAY CLAY, SM M/F/C SAND, SM F/ GRAVEL, TR TO SM SILT (FILL)	30.0	
	S-6	30 50/0.0		13.5		
15	R-1	REC =60% RQD =0%		14.0 GRAY F/C GRAVEL-SIZED ROCK FRAGMENTS (FILL)		
20	R-2	REC =80% RQD =26%		BOULDERS AND COBBLES (POSSIBLE FILL)		
	R-3	REC =0% RQD =0%				
25						
	R-4	REC =0% RQD =0%		27.5		
	S-8	4 6 5		LIGHT BROWN SILT, TR WOOD		
30	S-9	3 4 3		30.5		
				END OF BORING AT 30.5'		
35						

ATTEMPTED
SAMPLING AT 22.5 FT,
ENCOUNTERED
SPOON REFUSAL
(50/0.0)

NEWPROJECTS TEST BORING LOG 195651_TDI_CSX.GPJ SITE BLAUVELT.GDT 3/12/13

DRN. TBT
CKD. PWK




SUMMARY OF LABORATORY TEST DATA

Project Name: TDI Champlain Hudson Power Express – CSX
 Client Name: Transmission Developers, Inc.
 TRC Project #: 195651

SAMPLE IDENTIFICATION			Soil Group (USCS System)	GRAIN SIZE DISTRIBUTION				PLASTICITY				Specific Gravity	Moisture Content (%)	Unit Weight (pcf)	Compressive Strength (tsf)	Organic Content (%)
Boring #	Sample #	Depth (ft)		Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Liquidity Index					
B222.34-1	S-2	2.0-4.0	-	-	-	-	-	-	-	-	-	-	31.3	-	-	-
	S-4	6.0-8.0	CH	-	-	-	-	58	29	29	0.2	-	35.2	-	-	-
	S-5	8.0-10.0	-	-	-	-	-	-	-	-	-	-	36.2	88.2	-	-
	S-6	13.5-15.0	CH/MH	-	-	-	-	56	30	26	0.2	-	34.8	-	-	-
B222.6-1	S-3	4.0-6.0	SM	0.0	6.6	93.4		-	-	-	-	-	19.6	-	-	-
	S-4	6.0-8.0	-	17.1	18.6	64.3		-	-	-	-	-	30.0	-	-	14.4
	S-5	8.0-10.0														
	R-2	15.6-16.0	-	-	-	-		-	-	-	-	-	-	166.7	665	-
	R-3	22.6-23.0	-	-	-	-		-	-	-	-	-	-	169.0	436	-
B222.9-1	S-2	2.0-4.0	-	-	-	-	-	-	-	-	-	-	29.7	-	-	-
	S-3	4.0-6.0	-	-	-	-	-	-	-	-	-	-	33.0	-	-	-

Particle Size Distribution Report

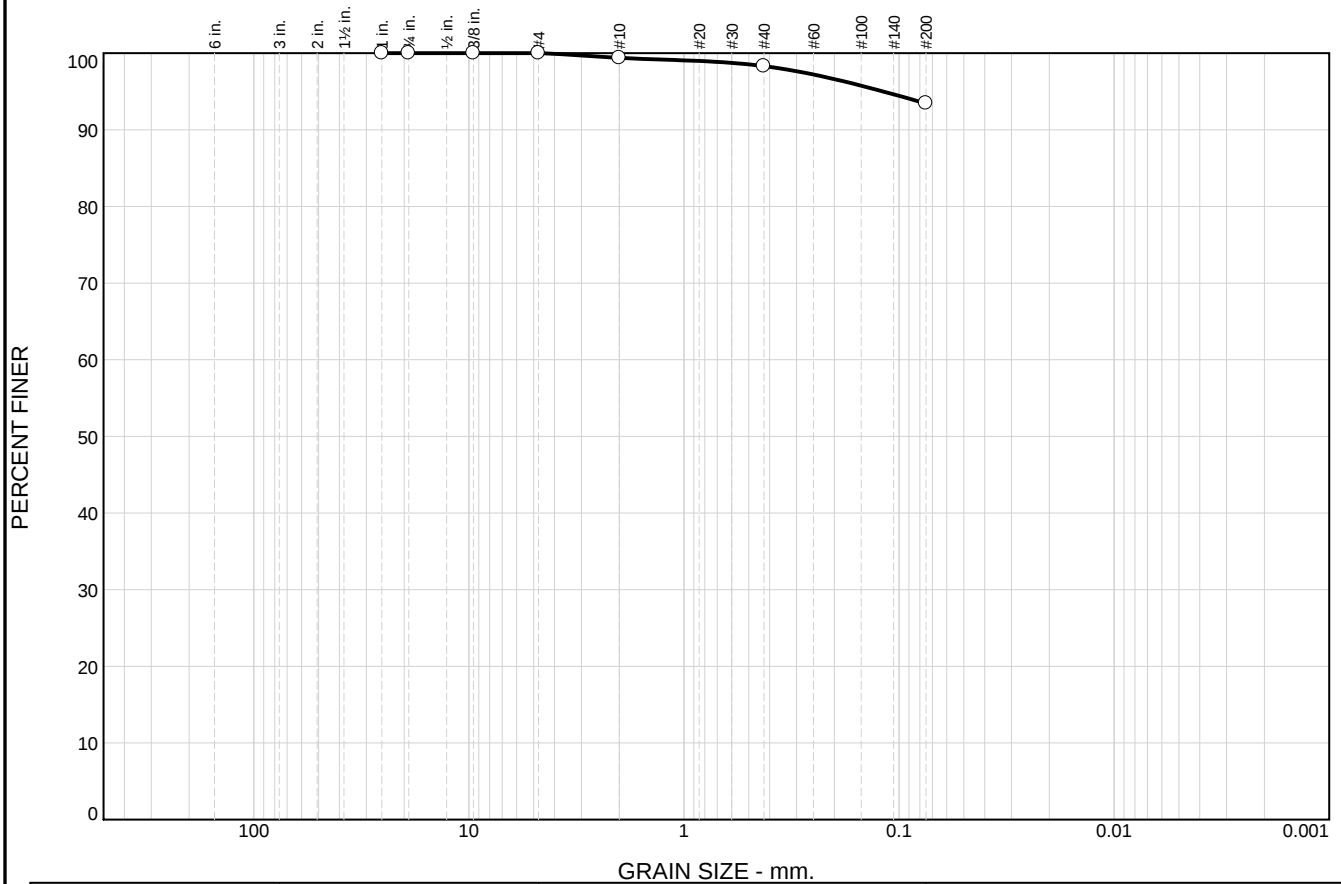


% +3"		% Gravel		% Sand			% Fines	
		Coarse	Fine	Coarse	Medium	Fine	Silt	Clay
☐	0.0	0.0	0.0	0.6	1.1	4.9	93.4	
☐								
☒	LL	PL	D ₈₅	D ₆₀	D ₅₀	D ₃₀	D ₁₅	D ₁₀
☐								
☐								
Material Description							USCS	AASHTO
☐ BROWN TO DARK GRAY SILT, TR F/M SAND								
Project No. 195651 Client: TRANSMISSION DEVELOPERS INC. Project: TDI CHAMPLAIN HUDSON POWER EXPRESS - CSX ☐ Source of Sample: B222.6-1 Depth: 4.0-6.0 FT Sample Number: S-3							Remarks: ☐ SAMPLE DESCRIPTION BASED ON VISUAL IDENTIFICATION AND LABORATORY ANALYSIS	
TRC Engineers, Inc. Mt. Laurel, NJ								

Figure 127

Tested By: TBT 01/10/13 Checked By: JPB 03/12/13

Particle Size Distribution Report

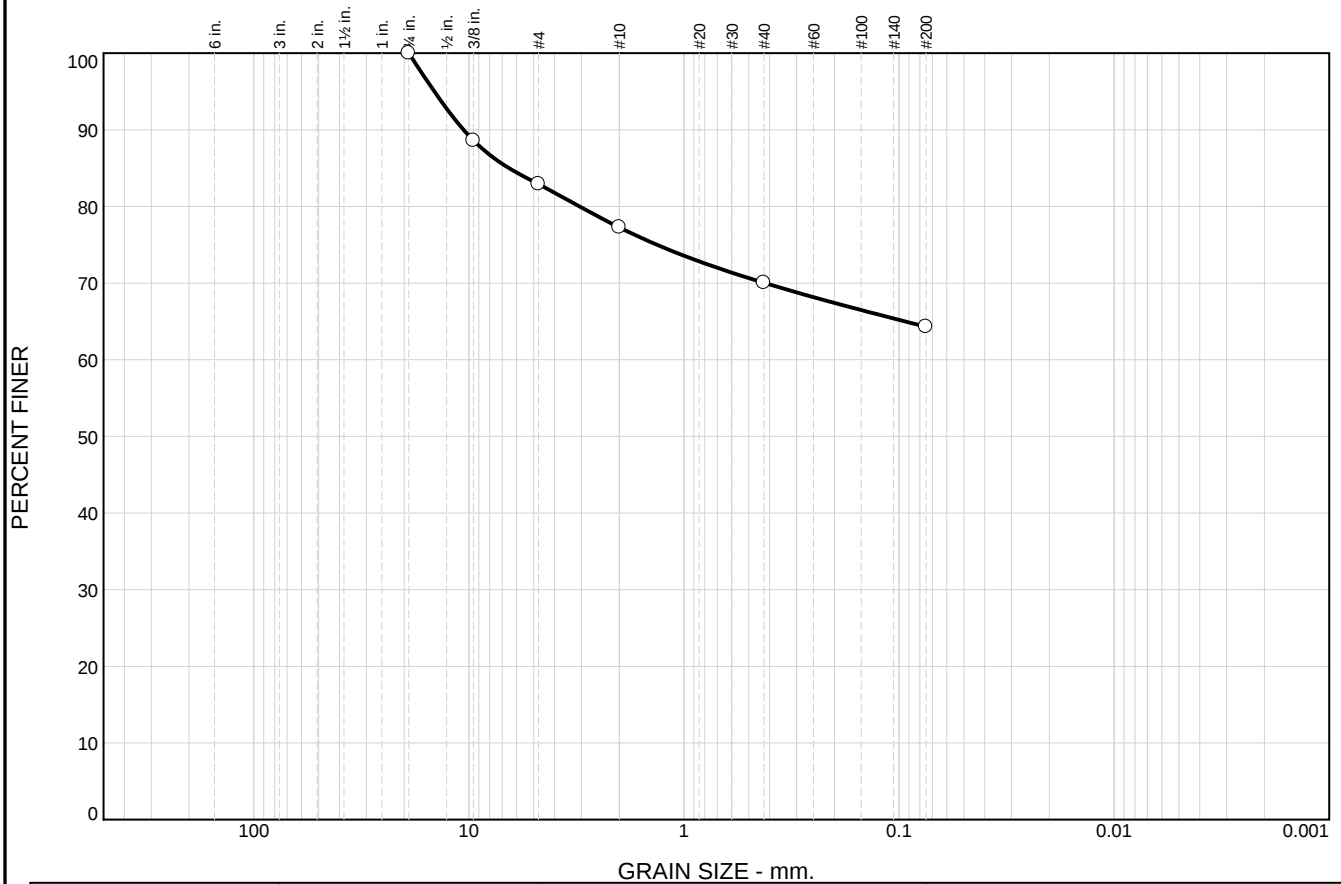

GRAIN SIZE - mm.										
% +3"		% Gravel		% Sand			% Fines			
		Coarse	Fine	Coarse	Medium	Fine	Silt		Clay	
☐	0.0	0.0	17.1	5.6	7.3	5.7	64.3			
☒	LL	PL	D ₈₅	D ₆₀	D ₅₀	D ₃₀	D ₁₅	D ₁₀	C _c	C _u
☐			6.5044							
Material Description								USCS	AASHTO	
○ BROWN TO GRAY CLAY, SM M/F/C SAND, SM F/ GRAVEL, TR TO SM SILT										
Project No. 195651 Client: TRANSMISSION DEVELOPERS INC. Project: TDI CHAMPLAIN HUDSON POWER EXPRESS - CSX ☐ Sample Source: B222.6-1 Depth: 6.0-10.0 FT Sample No.: S-4 & S-5								Remarks: ○SAMPLE DESCRIPTION BASED ON VISUAL IDENTIFICATION AND LABORATORY ANALYSIS		
TRC Engineers, Inc. Mt. Laurel, NJ										

Figure 128

Tested By: BMH 01/29/13 Checked By: JPB 03/12/13

TRC Engineers, Inc.
Soil Mechanics Laboratory

Unconfined Compression Strength Test of Rock Core

Project Name: TDI
Project No.: 195651
Boring No.: B222.6-1
Sample No.: R-2
Depth (ft): 15.6-16.0
Elevation (ft):

Average Sample Diameter (in.): 1.978
Cross Sectional Area (sq. in.): 3.073
Average Sample Height (in.): 3.971
Sample Mass-Dry (g): 533.95
Unit Weight (PCF) 166.7

Sample Description: _____
COBBLES WITHIN GLACIAL TILL

Test Data

Strain Dial (in.)	Load (lb)	Strain (%)	Stress (tsf)
0.000	0	0.00	0
0.010	200	0.25	5
0.020	500	0.50	12
0.030	1200	0.76	28
0.040	3400	1.01	80
0.050	6600	1.26	155
0.060	11000	1.51	258
0.070	18200	1.76	426
0.080	23700	2.01	555
0.090	28400	2.27	665
0.100	27000	2.52	633

Failure Conditions:

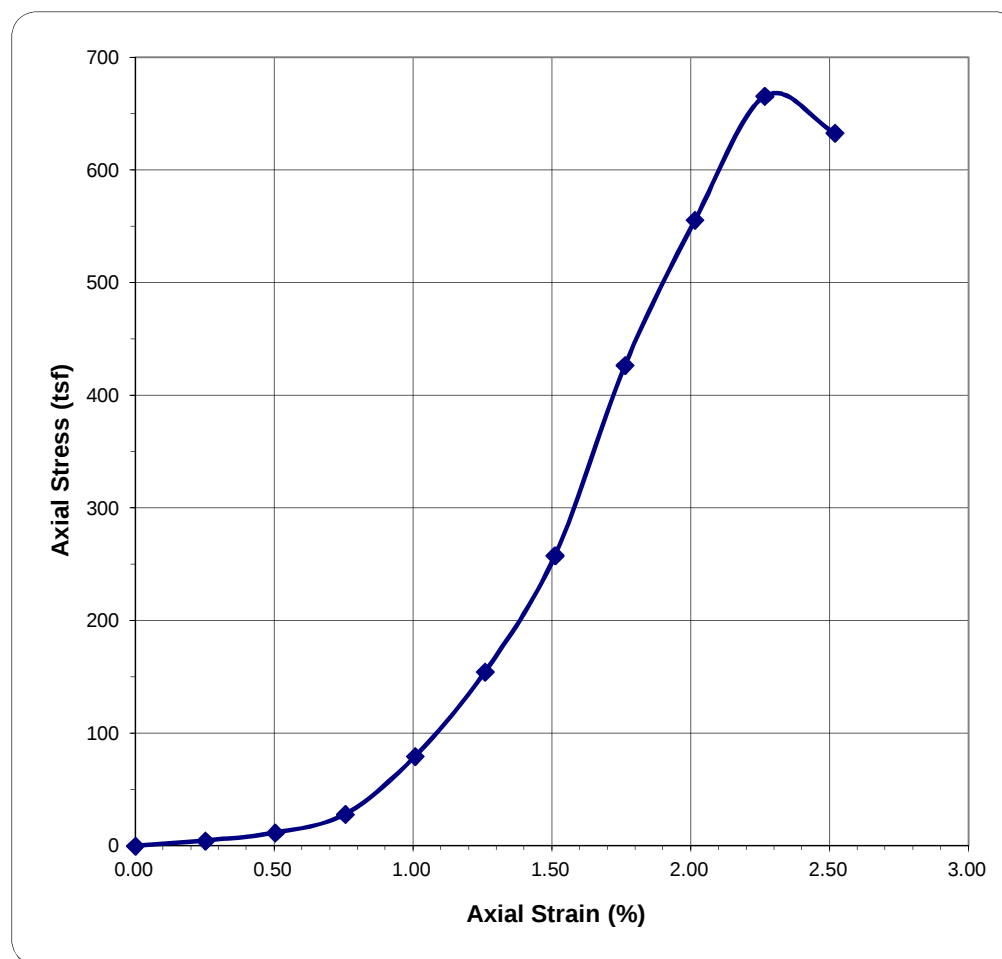



FIGURE: 157

TRC Engineers, Inc.
Soil Mechanics Laboratory

Unconfined Compression Strength Test of Rock Core

Project Name: TDI
Project No.: 195651
Boring No.: B222.6-1
Sample No.: R-3
Depth (ft): 22.6-23.0
Elevation (ft):

Average Sample Diameter (in.): 1.968
Cross Sectional Area (sq. in.): 3.042
Average Sample Height (in.): 3.956
Sample Mass-Dry (g): 533.82
Unit Weight (PCF) 169.0

Sample Description: _____
COBBLES WITHIN GLACIAL TILL

Test Data

Strain Dial (in.)	Load (lb)	Strain (%)	Stress (tsf)
0.000	0	0.00	0
0.010	400	0.25	9
0.020	1000	0.51	24
0.030	2600	0.76	62
0.040	4400	1.01	104
0.050	7200	1.26	170
0.060	11000	1.52	260
0.070	17200	1.77	407
0.080	18400	2.02	436
0.090	18000	2.28	426

Failure Conditions:



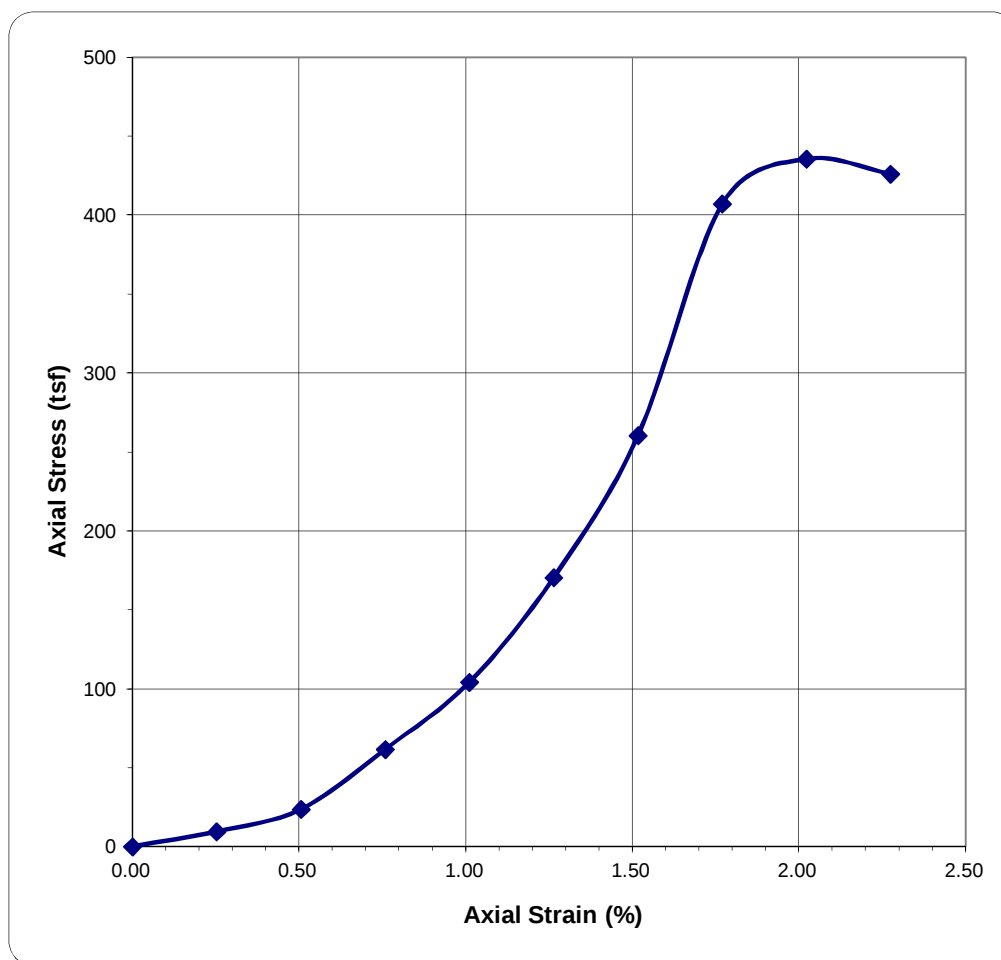


FIGURE: 158

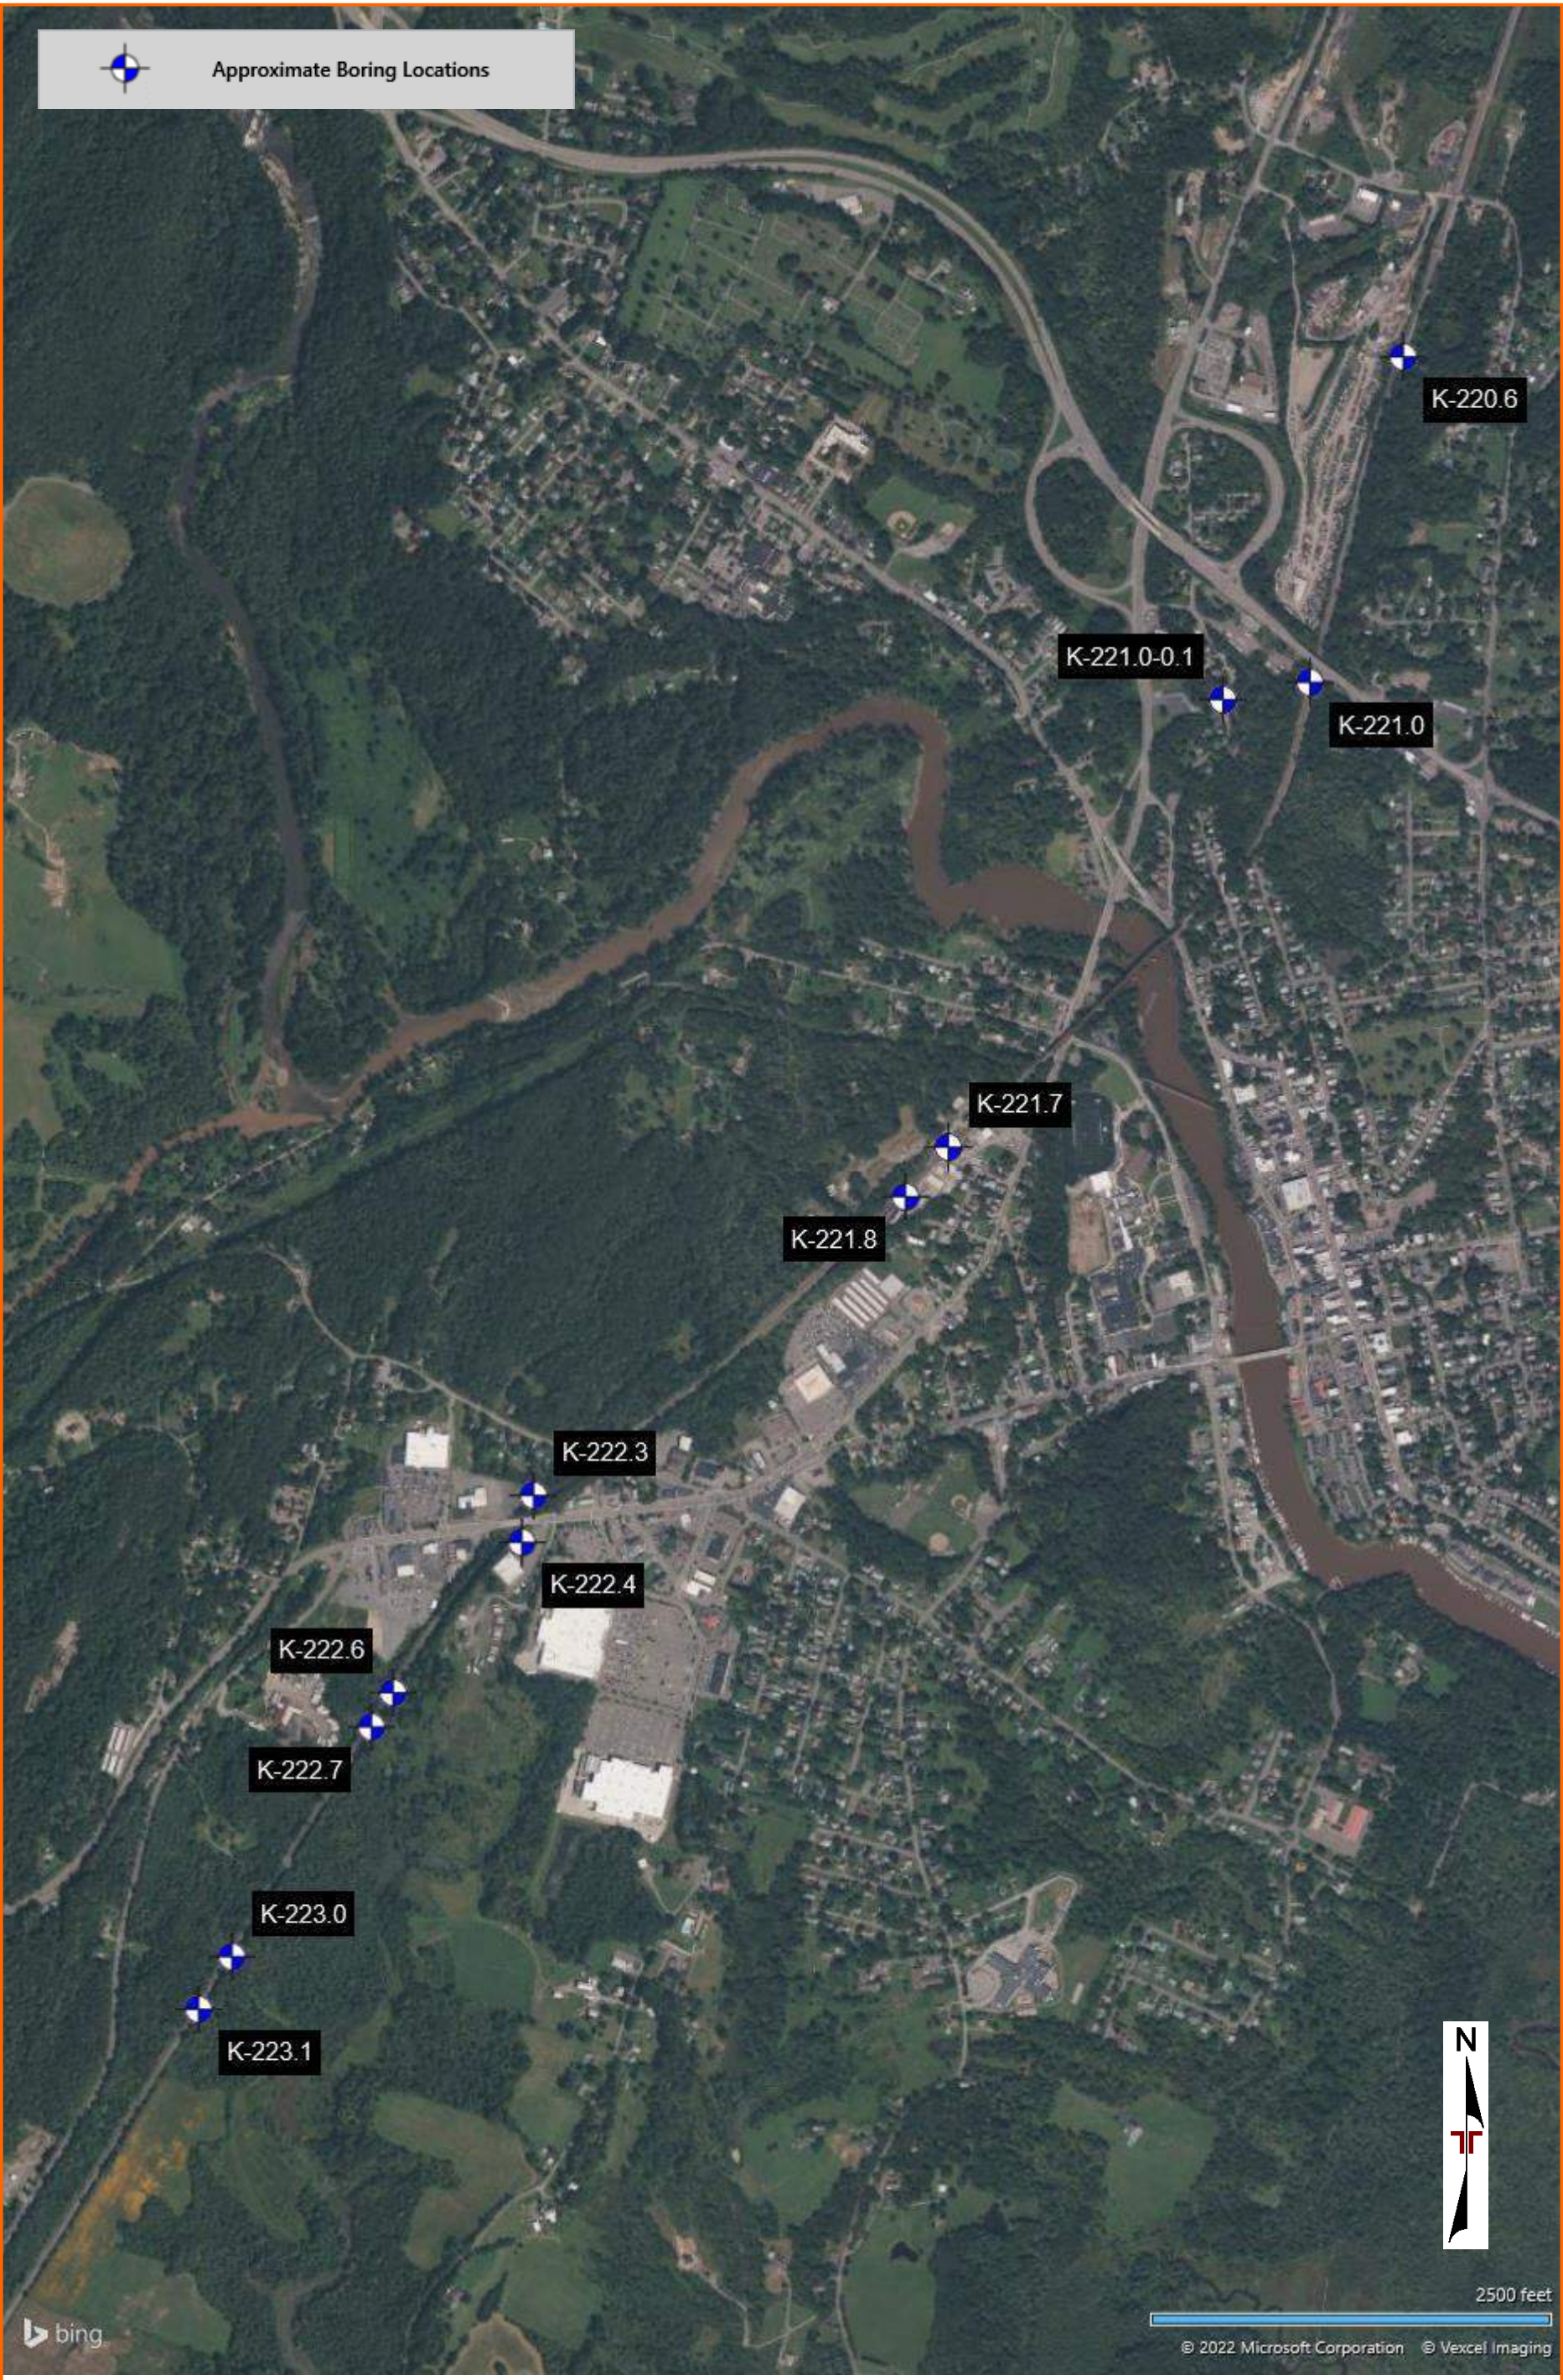

Page 1 of 2

CLIENT: Kiewit Engineering (NY) Corp.

GRAPHIC LOG	LOCATION	See Exploration Plan	DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (in.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES
	Latitude: 42.211433° Longitude: -73.887189°								LL-PL-PI	
DEPTH			ELEVATION (Ft.)							
	FILL - SOILS REMOVED VIA VACUUM EXTRACTION			5						
	6.0	108								
	FILL - SILT AND CLAY , fine gravel noted, brown, stiff to very stiff									
	no recovery, pushed cobble									
	15.0	99								
	FILL - WELL GRADED GRAVEL WITH SILT AND SAND , brown, medium dense									
	17.0	97								
	FILL - SILT AND CLAY , fine gravel noted, brown, very stiff									
			20							
			25							

Hammer Type: Automatic

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON.GPJ TERRACON DATATEMPLATE.GDT 5/20/22

BORING LOG NO. K-222.6

Page 2 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES
	Latitude: 42.211433° Longitude: -73.887189°								LL-PL-PI	
DEPTH ELEVATION (Ft.)										
	<u>FILL - SILT AND CLAY</u> , fine gravel noted, brown, very stiff <i>(continued)</i>				X	7	21-10-11-10 N=21	8.9		
	<u>SILT AND CLAY (CL-ML)</u> , gray, stiff		30		X	15	6-7-5-5 N=12			
	<u>LEAN CLAY (CL)</u> , gray, soft		35		X	15	3-3-2-3 3" Split Spoon with ring sampler	25.5	23-15-8	87
					X	15	3-2-2-3 N=4			
Boring Terminated at 40 Feet			40							

Stratification lines are approximate. In-situ, the transition may be gradual.

Hammer Type: Automatic

Advancement Method:
4 1/4 HSA

See [Exploration and Testing Procedures](#) for a description of field and laboratory procedures used and additional data (If any).

Notes:

Logged By MO
Hammer Efficiency Summary:
Energy Transfer Ratio: 86.9% +/-2.2%
Hammer Efficiency Correction (CE):1.52

Abandonment Method:
Backfilled with bentonite grout upon completion

See [Supporting Information](#) for explanation of symbols and abbreviations.

Elevations were provided by Kiewit.

WATER LEVEL OBSERVATIONS

No measurable groundwater prior to grouting

Terracon

30 Corporate Cir Ste 201
Albany, NY

Boring Started: 03-28-2022

Boring Completed: 03-28-2022

Drill Rig: Mobile B-57

Driller: S. Kahn

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

BORING LOG NO. K-222.7

Page 1 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan Latitude: 42.210847° Longitude: -73.887689° Surface Elev.: 114.84 (Ft.)	DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES
								LL-PL-PI	
	DEPTH ELEVATION (Ft.)								
	FILL - SOILS REMOVED VIA VACUUM EXTRACTION								
		5							
	6.0	109							
	FILL - SILT AND CLAY , fine gravel noted, medium stiff to stiff								
	10.0	105							
	FILL - SILTY GRAVEL WITH SAND , brown, medium dense								
	15.0	100							
	FILL - SILT AND CLAY , fine gravel noted, brown, medium stiff								
		15							
		20							
		25							
	25.0	90							

Stratification lines are approximate. In-situ, the transition may be gradual.

Hammer Type: Automatic

Advancement Method:
4 1/4 HSA

See [Exploration and Testing Procedures](#) for a description of field and laboratory procedures used and additional data (if any).

Notes:

Logged by: MO
Hammer Efficiency Summary:
Energy Transfer Ratio: 77.4% +/-2.7%
Hammer Efficiency Correction (CE):1.29
WOH = Weight of Hammer

Abandonment Method:
Backfilled with bentonite grout upon completion

See [Supporting Information](#) for explanation of symbols and abbreviations.

Elevations were provided by Kiewit.

WATER LEVEL OBSERVATIONS

No measurable groundwater prior to grouting

Terracon
30 Corporate Cir Ste 201
Albany, NY

Boring Started: 03-25-2022

Boring Completed: 03-25-2022

Drill Rig: CME 550

Driller: B. Duffy

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

BORING LOG NO. K-222.7

Page 2 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES
	Latitude: 42.210847° Longitude: -73.887689°								LL-PL-PI	
	Surface Elev.: 114.84 (Ft.)									
	ELEVATION (Ft.)									
	DEPTH									
	<u>FILL - LEAN CLAY WITH SAND</u> , brown, stiff				X	16	WOH-3-5-5 N=8	34.3	49-27-22	76
	30.0	85			X	12	WOH-2-50/4			
	<u>FILL - Cored through boulder</u>									
	31.8	83								
	<u>FILL - Boulders</u>									
	40.0	75			X	18	WOH-WOH- WOH-2			
	<u>SILT AND CLAY (CL-ML)</u> , gray, very soft									
	42.0	73								
Boring Terminated at 42 Feet										

Stratification lines are approximate. In-situ, the transition may be gradual.

Hammer Type: Automatic

Advancement Method:
4 1/4 HSA

See [Exploration and Testing Procedures](#) for a description of field and laboratory procedures used and additional data (If any).

Notes:

Logged by: MO
Hammer Efficiency Summary:
Energy Transfer Ratio: 77.4% +/-2.7%
Hammer Efficiency Correction (CE):1.29
WOH = Weight of Hammer

Abandonment Method:
Backfilled with bentonite grout upon completion

See [Supporting Information](#) for explanation of symbols and abbreviations.

Elevations were provided by Kiewit.

WATER LEVEL OBSERVATIONS

No measurable groundwater prior to grouting

Terracon

30 Corporate Cir Ste 201
Albany, NY

Boring Started: 03-25-2022

Boring Completed: 03-25-2022

Drill Rig: CME 550


Driller: B. Duffy

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

ATTERBERG LIMITS RESULTS

ASTM D4318

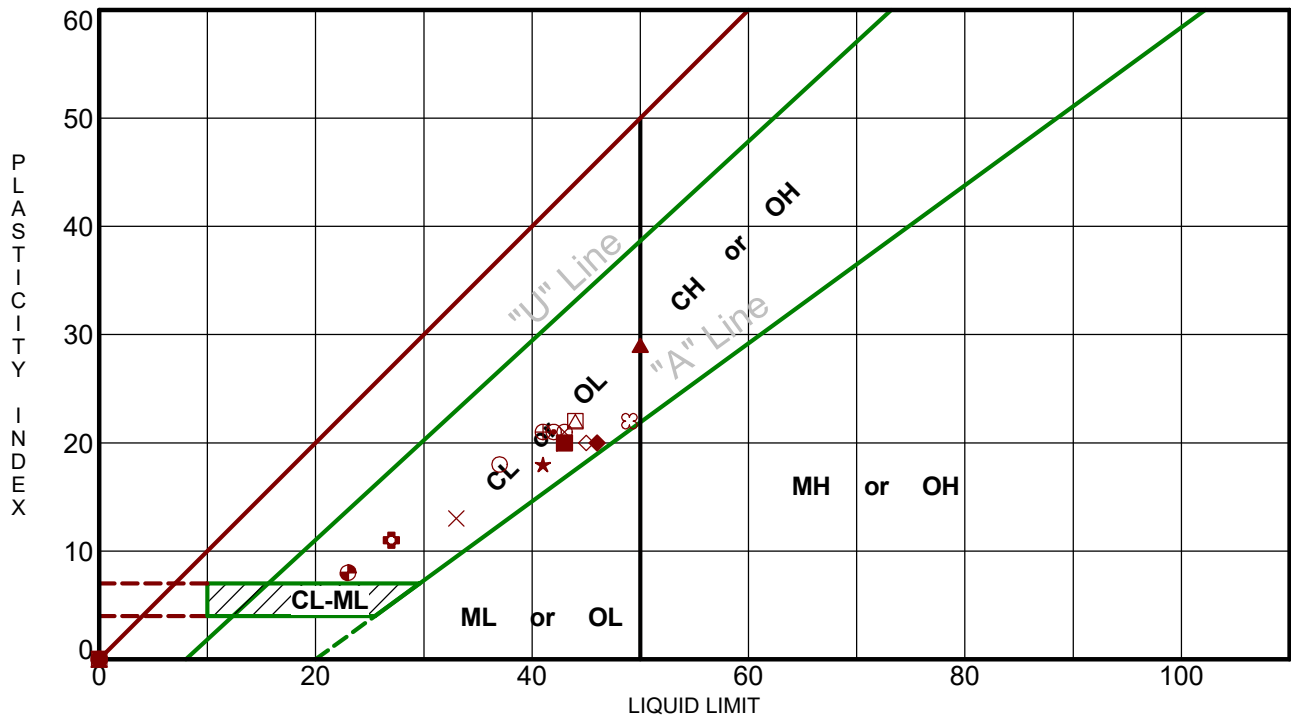

Boring ID	Depth (Ft)	LL	PL	PI	Fines	USCS	Description
● K-220.6	6 - 8	NP	NP	NP	22.1	GM	SILTY GRAVEL with SAND
▣ K-220.6	13 - 15	NP	NP	NP	11.9	SW-SM	WELL-GRADED SAND with SILT and GRAVEL
▲ K-221.0	8 - 10	50	21	29	73.4	CH	FAT CLAY with SAND
★ K-221.0	23 - 25	41	23	18	89.8	CL	LEAN CLAY
⊙ K-221.7	10 - 12	42	21	21	93.6	CL	LEAN CLAY
⊕ K-221.7	33 - 35	27	16	11	58.8	CL	SANDY LEAN CLAY
○ K-221.8	8 - 10	37	19	18	91.3	CL	LEAN CLAY
△ K-221.8	35 - 37	44	22	22	79.7	CL	LEAN CLAY with SAND
⊗ K-222.3	6 - 8	43	22	21	59.8	CL	SANDY LEAN CLAY
⊕ K-222.3	10 - 12	41	20	21	69.6	CL	SANDY LEAN CLAY
□ K-222.4	10 - 12	44	22	22	87.3	CL	LEAN CLAY
⊕ K-222.6	15 - 17	NP	NP	NP	6.5	GW-GM	WELL-GRADED GRAVEL with SILT and SAND
⊕ K-222.6	35 - 37	23	15	8	86.7	CL	LEAN CLAY
★ K-222.7	10 - 12	NP	NP	NP	25.3	GM	SILTY GRAVEL with SAND
⊗ K-222.7	25 - 27	49	27	22	76.3	CL	LEAN CLAY with SAND
■ K-223.0	10 - 12	43	23	20	58.5	CL	SANDY LEAN CLAY
◆ K-223.0	25 - 27	46	26	20	84.9	CL	LEAN CLAY with SAND
◇ K-223.1	15 - 17	45	25	20	71.3	CL	LEAN CLAY with SAND
× K-223.1	29 - 31	33	20	13	98.3	CL	LEAN CLAY

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

Terracon
30 Corporate Cir Ste 201
Albany, NY


PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. ATTERBERG LIMITS JB215256D CHAMPLAIN-HUDSON GPJ TERRACON DATATEMPLATE.GDT 5/12/22

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

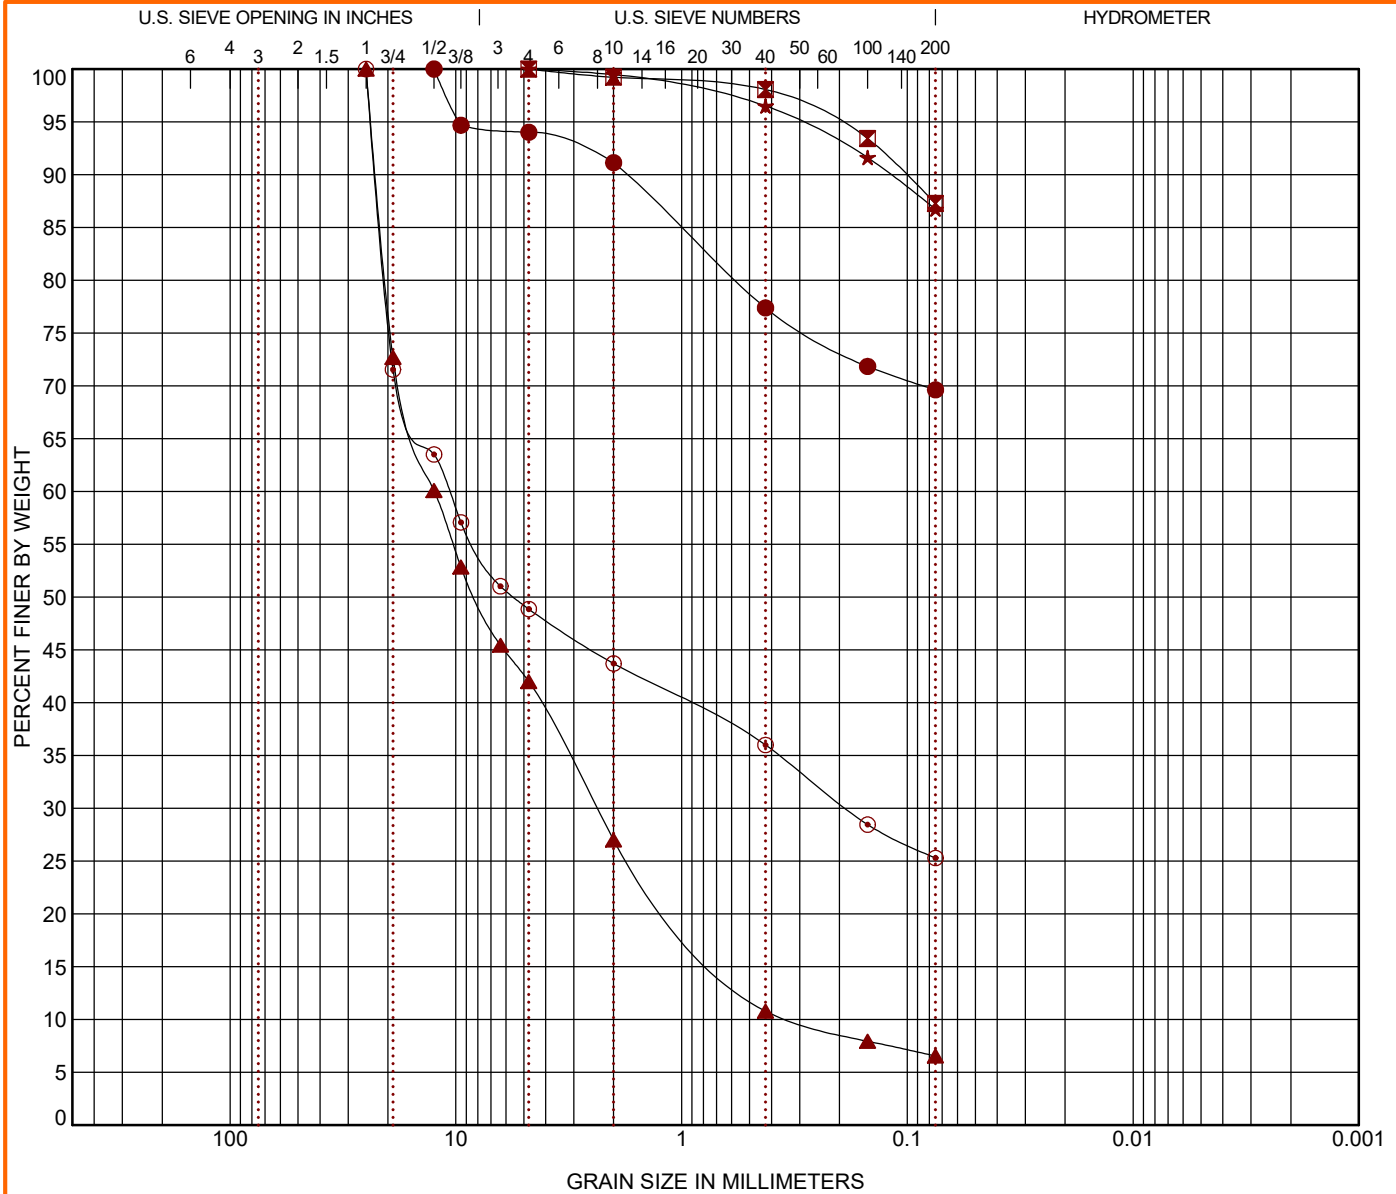

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID		Depth (Ft)	USCS Classification				WC (%)	LL	PL	PI	Cc	Cu
●	K-222.3	10 - 12	SANDY LEAN CLAY (CL)				28.3	41	20	21		
⊠	K-222.4	10 - 12	LEAN CLAY (CL)				30.0	44	22	22		
▲	K-222.6	15 - 17	WELL-GRADED GRAVEL with SILT and SAND (GW-GM)				9.2	NP	NP	NP	1.42	39.06
★	K-222.6	35 - 37	LEAN CLAY (CL)				25.5	23	15	8		
⊙	K-222.7	10 - 12	SILTY GRAVEL with SAND (GM)				11.5	NP	NP	NP		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay	
●	K-222.3	10 - 12	12.5			0.0	6.0	24.4		69.6		
⊠	K-222.4	10 - 12	4.75			0.0	0.0	12.7		87.3		
▲	K-222.6	15 - 17	25	12.459	2.379	0.319	0.0	58.0	35.5		6.5	
★	K-222.6	35 - 37	4.75			0.0	0.0	13.3		86.7		
⊙	K-222.7	10 - 12	25	10.764	0.186	0.0	51.1	23.6		25.3		

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

Terracon
30 Corporate Cir Ste 201
Albany, NY


PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256D CHAMPLAIN-HUDSON_GP.J TERRACON_DATATEMPLATE.GDT 5/12/22

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

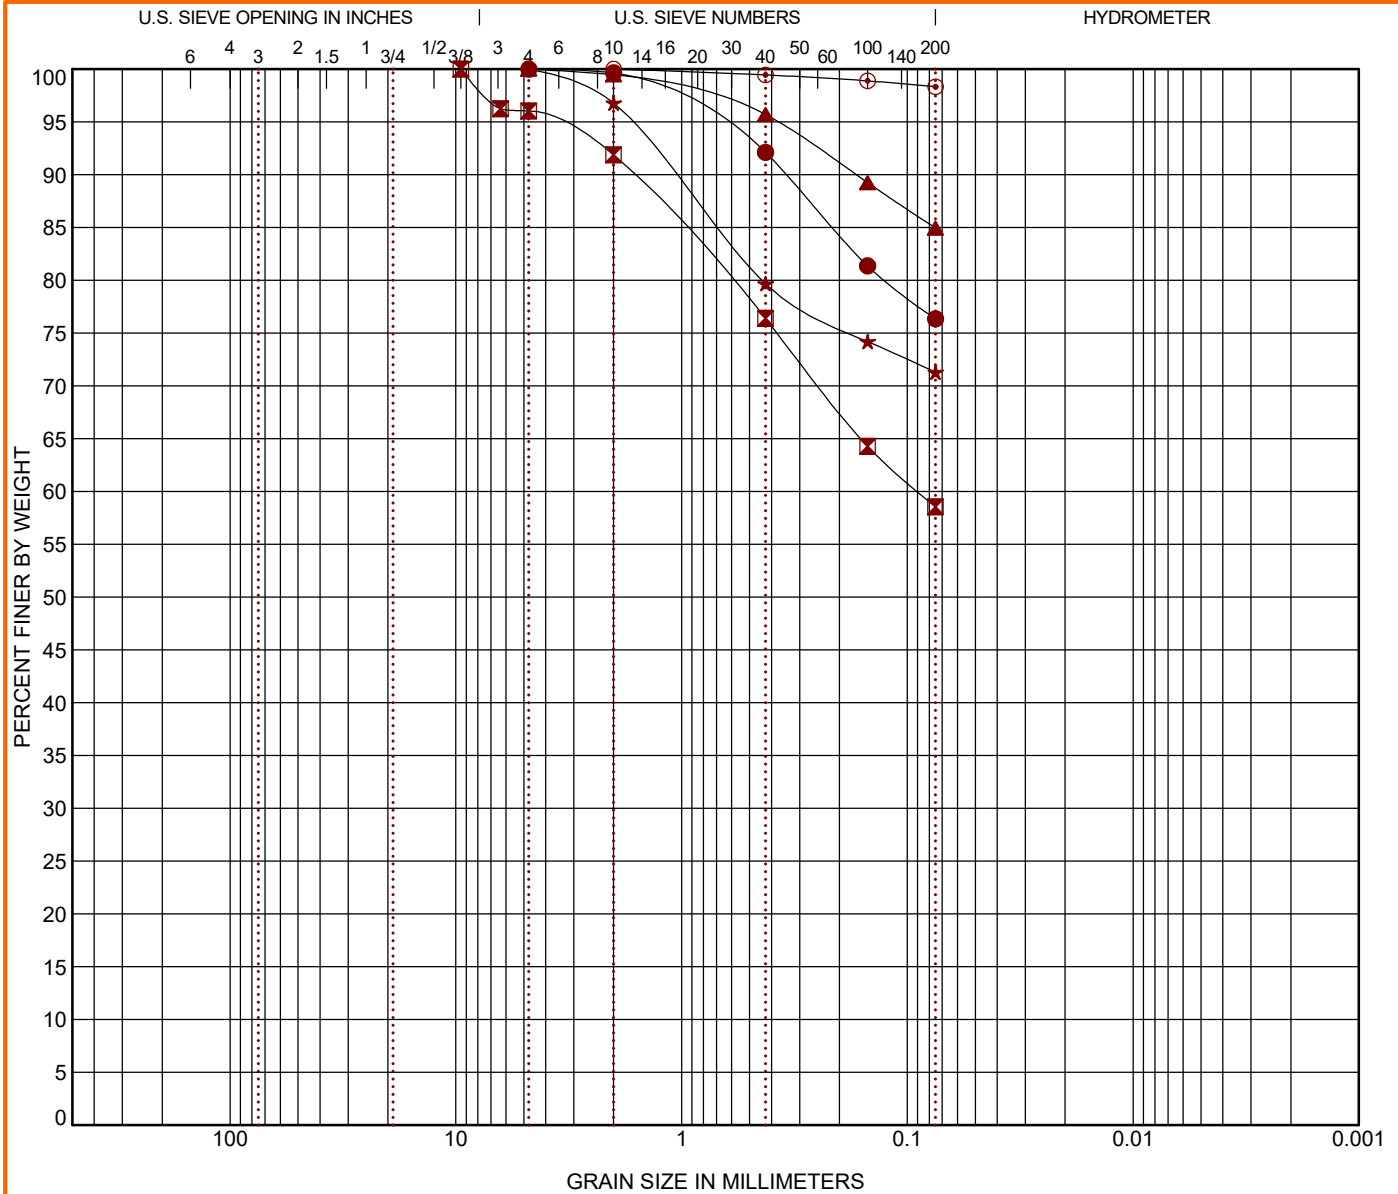

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID	Depth (Ft)	USCS Classification				WC (%)	LL	PL	PI	Cc	Cu
● K-222.7	25 - 27	LEAN CLAY with SAND (CL)				34.3	49	27	22		
☒ K-223.0	10 - 12	SANDY LEAN CLAY (CL)				34.0	43	23	20		
▲ K-223.0	25 - 27	LEAN CLAY with SAND (CL)				33.4	46	26	20		
★ K-223.1	15 - 17	LEAN CLAY with SAND (CL)				33.5	45	25	20		
⊙ K-223.1	29 - 31	LEAN CLAY (CL)				33.9	33	20	13		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay
● K-222.7	25 - 27	4.75				0.0	0.0	23.7		76.3	
☒ K-223.0	10 - 12	9.5	0.09			0.0	4.0	37.5		58.5	
▲ K-223.0	25 - 27	4.75				0.0	0.0	15.1		84.9	
★ K-223.1	15 - 17	4.75				0.0	0.0	28.7		71.3	
⊙ K-223.1	29 - 31	2				0.0	0.0	1.7		98.3	

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

Terracon
30 Corporate Cir Ste 201
Albany, NY

PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256D CHAMPLAIN-HUDSON_GPJ TERRACON_DATATEMPLATE.GDT 5/12/22



Package 7A Phase 3 Borings

Champlain Hudson Power Express

New York

PROJECT NUMBER 20001480

CREATED BY	Kiewit
DATE	12/08/2022

Legend Key

- Kiewit Borings (Phase 3)





Kiewit

EXPLORATORY BORING LOG

Champlain Hudson Power Express
New York

BORING NO: KB-222.6A

PROJECT NUMBER 20001480
START DATE 09/06/2022
FINISH DATE 09/07/2022

LOGGED BY A. McCart
DRILLER/RIG M. Eaves / CME-850
DRILL CONTRACTOR Parratt Wolff

COORDINATES N 1231211.05
E 658150.84
GROUND ELEV. 114.0 ft
HAMMER TYPE/EFF. Automatic

Depth (ft)	Elevation (ft)	Graphic Log	Material Description	Sample Type Core Run No.	Recovery % RQD	Pocket Pen. (tsf)	Blow Counts (N Value)	Notes	Legend			
									▲ SPT N Value	● MC (%)	— PL & LL (%)	☒ Fines Content (%)
			Excavated to 8 ft by air knife and vacuum					Boring advanced with 4.25" ID HSA	20	40	60	80
5												
106.0			FILL: GRAVEL with Sand and Silt (GP-GM), dark brown, medium dense to very dense, moist		38%		6-8-10-12 (18)		▲			
10					50%		20-14-12-8 (26)		▲			
15			Rock/large cobble encountered at 15.5 - 17 ft		60%		35-50/4"		☒			
20	94.0		Fat CLAY (CH), trace silt, light brown with light gray mottling, stiff to firm, moist		84%		2-1-2-3 (3)		▲			
25					84%		2-2-2-3 (4)		▲			
30												



Kiewit

EXPLORATORY BORING LOG

Champlain Hudson Power Express
New York

BORING NO: KB-222.6A

PROJECT NUMBER 20001480
START DATE 09/06/2022
FINISH DATE 09/07/2022

LOGGED BY A. McCart
DRILLER/RIG M. Eaves / CME-850
DRILL CONTRACTOR Parratt Wolff

COORDINATES N 1231211.05
E 658150.84
GROUND ELEV. 114.0 ft
HAMMER TYPE/EFF. Automatic

Depth (ft)	Elevation (ft)	Graphic Log	Material Description	Sample Type Core Run No.	Recovery % RQD	Pocket Pen. (tsf)	Blow Counts (N Value)	Notes	Legend			
									▲ SPT N Value	● MC (%)	— PL & LL (%)	☒ Fines Content (%)
			Fat CLAY (CH), trace silt, light brown with light gray mottling, stiff to firm, moist		100%		3-4-5-8 (9)		▲			
35			Wet below 35 ft		100%		3-3-3-5 (6)		▲	●	—	☒
40			Gray to dark gray, soft to very soft, no silt below 40 ft		100%		0-0-3-2 (3)		▲			
45					100%		0-0-0-0 (0)	WOH	▲			
66.0			SILT (ML), gray, very soft, wet		100%		0-0-0-0 (0)	WOH	▲	●	—	☒
50					100%		0-0-4-4	3-inch ring sampler				
55					100%							
60												



Kiewit

EXPLORATORY BORING LOG

Champlain Hudson Power Express
New York

BORING NO: KB-222.6A

PROJECT NUMBER 20001480
START DATE 09/06/2022
FINISH DATE 09/07/2022

LOGGED BY A. McCart
DRILLER/RIG M. Eaves / CME-850
DRILL CONTRACTOR Parratt Wolff

COORDINATES N 1231211.05
E 658150.84
GROUND ELEV. 114.0 ft
HAMMER TYPE/EFF. Automatic

Depth (ft)	Elevation (ft)	Graphic Log	Material Description	Sample Type Core Run No.	Recovery % RQD	Pocket Pen. (tsf)	Blow Counts (N Value)	Notes	Legend			
									▲ SPT N Value	● MC (%)	— PL & LL (%)	☒ Fines Content (%)
			SILT (ML), gray, very soft, wet									
					100%		0-0-2-3 (2)					
65					100%		0-0-0-0 (0)	WOH				
70					100%		0-0-0-0 (0)	WOH				
75					100%		0-0-0-0 (0)	WOH				
80					100%		0-0-0-0 (0)	WOH				
32.0			Boring Terminated at 82 ft									
85												
90												

Summary of Laboratory Results

Sheet 2 of 2

BORING ID	Depth (Ft.)	Water Content (%)
KB-222.6A	15-17	1.2
KB-222.6A	35-37	35.8
KB-222.6A	50-52	41.7
KB-222.6A	65-67	38.4
KB-223.1A	6-8	31.3
KB-223.1A	25-27	39.6
KB-223.1A	45-47	22.0
KB-226.1	6-8	33.3
KB-226.1	20-22	37.7
KB-226.8A	4-6	35.5
KB-226.8A	20-22	37.4
KB-226.8A	38-40	46.7

PROJECT: LAB Testing

SITE: Champlain- Hudson Power Express



PROJECT NUMBER: JB215256H


CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-2

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. SMART LAB SUMMARY-PORTRAIT JB215256H LAB TESTING.GPJ TERRACON_DATATEMPLATE.GDT 11/16/22

ATTERBERG LIMITS RESULTS

ASTM D4318

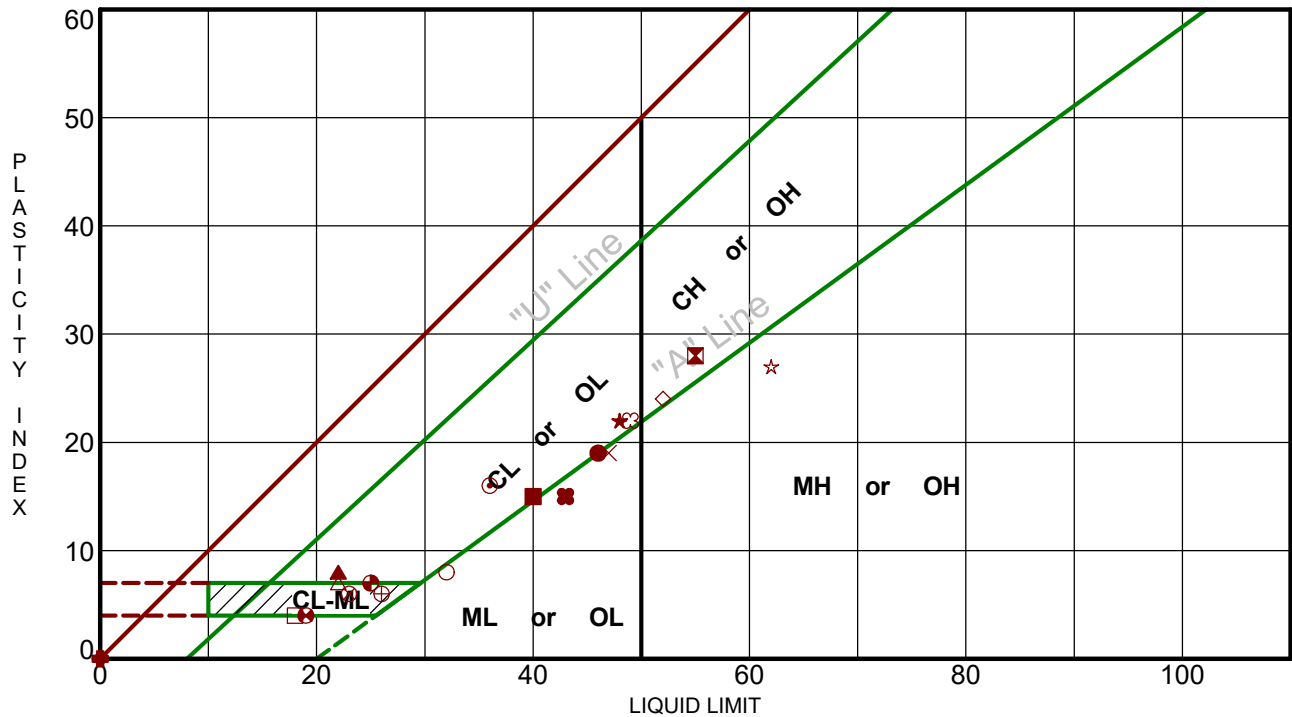

Boring ID	Depth (Ft)	LL	PL	PI	Fines	USCS	Description
● KB-193.9	15 - 17	46	27	19	70.4	CL	LEAN CLAY with SAND
■ KB-193.9	35 - 37	55	27	28	96.8	CH	FAT CLAY
▲ KB-194.0	4 - 6	22	14	8	81.9	CL	LEAN CLAY with SAND
★ KB-194.0	15 - 17	48	26	22	85.2	CL	LEAN CLAY
○ KB-194.0	25 - 27	36	20	16	97.0	CL	LEAN CLAY
⊕ KB-194.0	35 - 37	NP	NP	NP	14.7	SM	SILTY SAND with GRAVEL
○ KB-220.5	8 - 10	32	24	8	26.2	SM	SILTY SAND with GRAVEL
△ KB-221.0A	4 - 6	22	15	7	89.6	CL-ML	SILTY CLAY
⊗ KB-221.0A	8 - 10	23	17	6	11.7	GP-GC	POORLY GRADED GRAVEL with SILTY CLAY and SAND
⊕ KB-221.0A	15 - 17	26	20	6	11.8	GP-GC	POORLY GRADED GRAVEL with SILTY CLAY and SAND
□ KB-221.0A	25 - 27	18	14	4	25.9	GC-GM	SILTY, CLAYEY GRAVEL with SAND
⊕ KB-221.0A	35 - 37	19	15	4	21.0	SC-SM	SILTY, CLAYEY SAND with GRAVEL
⊕ KB-221.3	8	25	18	7	13.7	GC-GM	SILTY, CLAYEY GRAVEL with SAND
★ KB-222.2	7 - 9	62	35	27	100.0	MH	ELASTIC SILT
⊗ KB-222.2	25 - 27	49	27	22	94.8	CL	LEAN CLAY
■ KB-222.2	40 - 42	40	25	15	90.4	CL	LEAN CLAY
◆ KB-222.6A	15 - 17	NP	NP	NP	7.4	GP-GM	POORLY GRADED GRAVEL with SAND and SILT
◇ KB-222.6A	35 - 37	52	28	24	87.3	CH	FAT CLAY
× KB-222.6A	50 - 52	47	28	19	96.5	ML	SILT
⊕ KB-222.6A	65 - 67	43	28	15	99.3	ML	SILT

PROJECT: LAB Testing

SITE: Champlain- Hudson Power Express

Terracon
30 Corporate Cir Ste 201
Albany, NY

PROJECT NUMBER: JB215256H

CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO


EXHIBIT: B-2

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. ATTERBERG LIMITS JB215256H LAB TESTING.GPJ TERRACON.DATATEMPLATE.GDT 11/16/22

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256H LAB TESTING.GPJ TERRACON_DATATEMPLATE.GDT 11/16/22

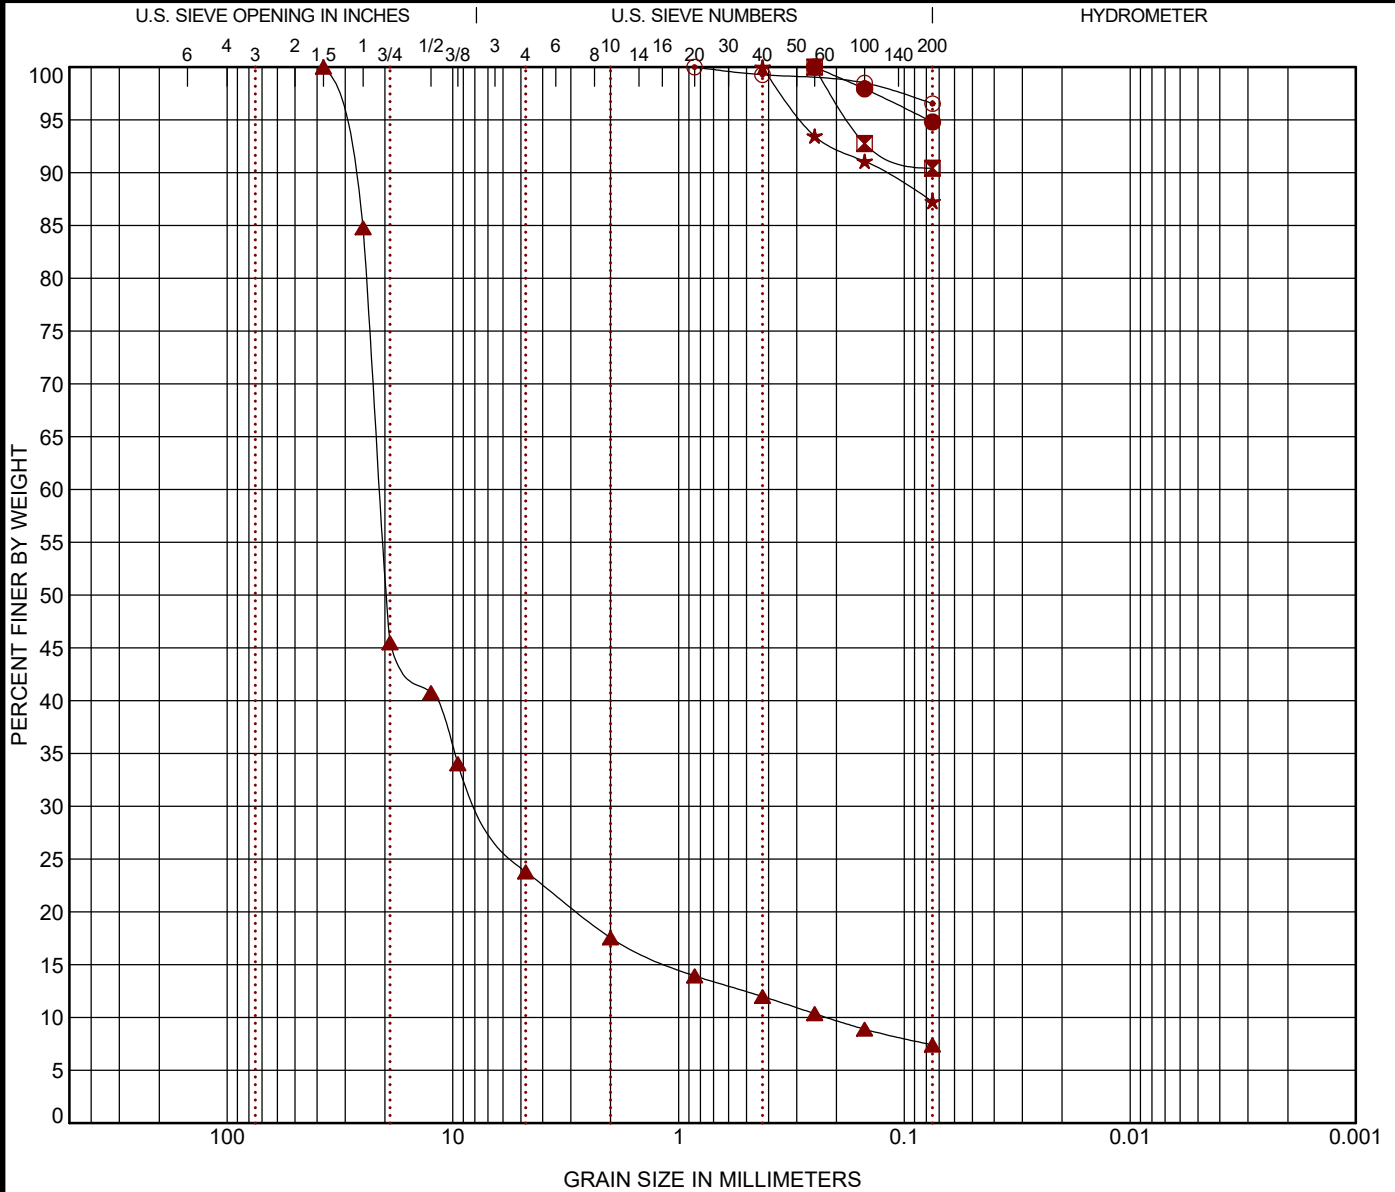

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID		Depth (Ft)	USCS Classification					WC (%)	LL	PL	PI	Cc	Cu
●	KB-222.2	25 - 27	LEAN CLAY (CL)					36.9	49	27	22		
☒	KB-222.2	40 - 42	LEAN CLAY (CL)					38.2	40	25	15		
▲	KB-222.6A	15 - 17	POORLY GRADED GRAVEL with SAND and SILT (GP-GM)					1.2	NP	NP	NP	11.29	95.41
★	KB-222.6A	35 - 37	FAT CLAY (CH)					35.8	52	28	24		
⊙	KB-222.6A	50 - 52	SILT (ML)					41.7	47	28	19		
Boring ID		Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay	
●	KB-222.2	25 - 27	0.25				0.0	0.0	5.2		94.8		
☒	KB-222.2	40 - 42	0.25				0.0	0.0	9.6		90.4		
▲	KB-222.6A	15 - 17	37.5	21.027	7.232	0.22	0.0	76.2	16.4		7.4		
★	KB-222.6A	35 - 37	0.425				0.0	0.0	12.7		87.3		
⊙	KB-222.6A	50 - 52	0.85				0.0	0.0	3.5		96.5		

PROJECT: LAB Testing

SITE: Champlain- Hudson Power Express



PROJECT NUMBER: JB215256H


CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-9

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256H LAB TESTING.GPJ TERRACON_DATATEMPLATE.GDT 11/16/22

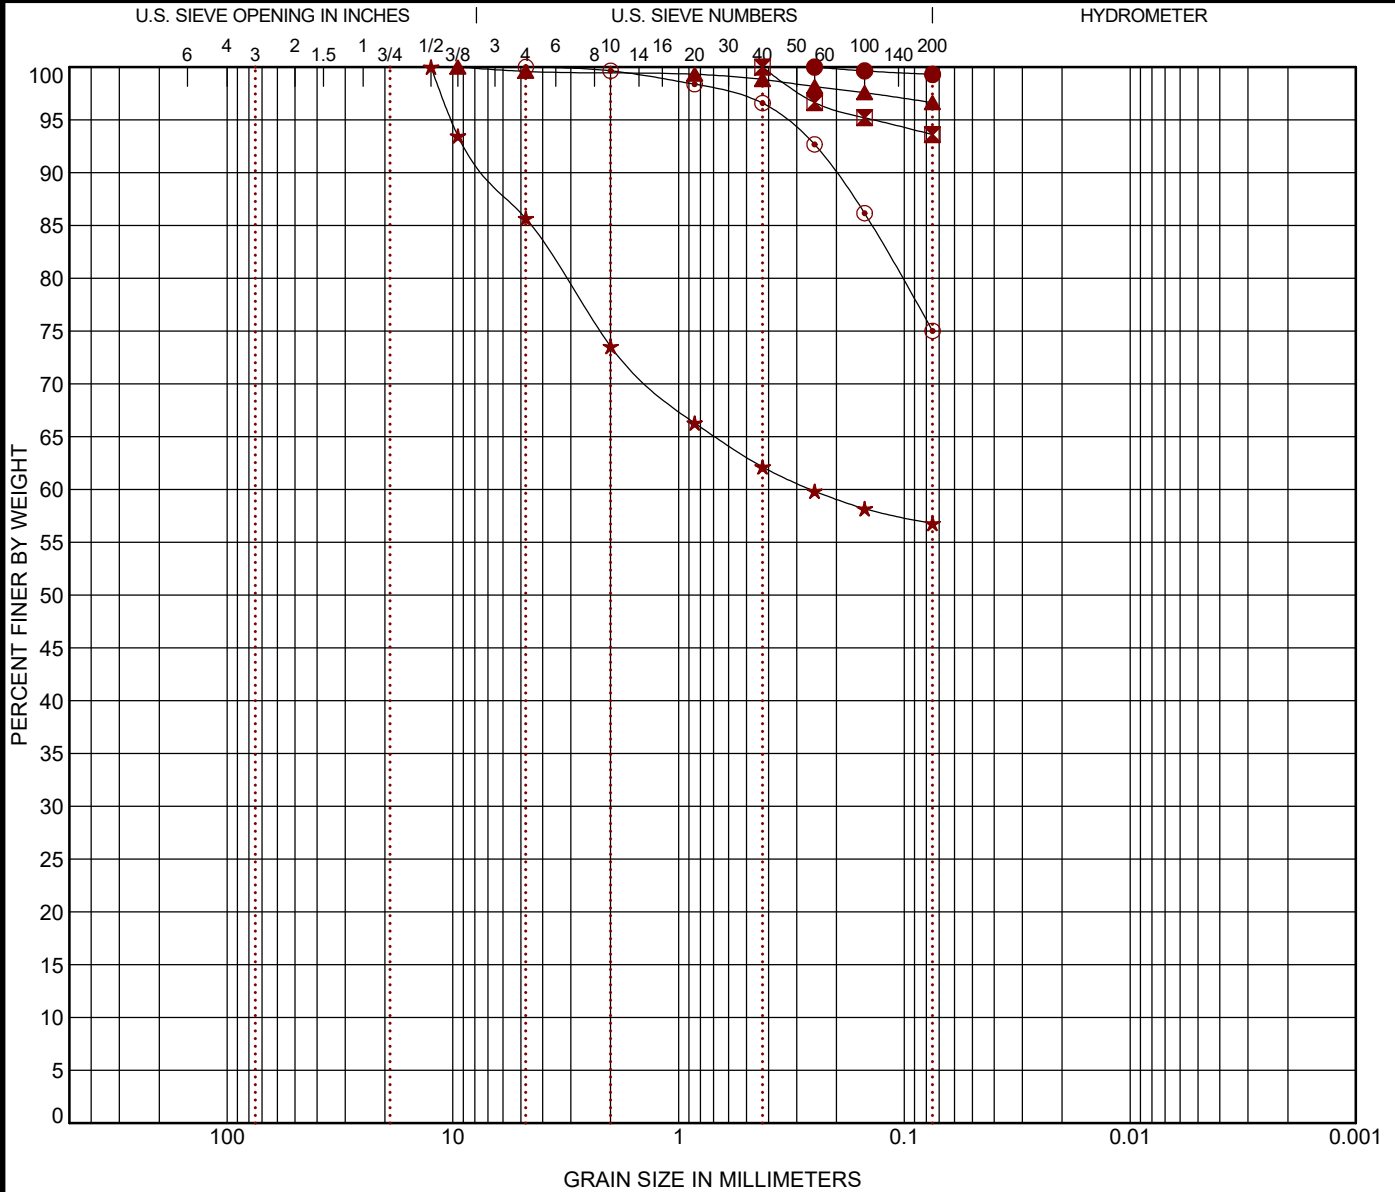

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID	Depth (Ft)	USCS Classification				WC (%)	LL	PL	PI	Cc	Cu
● KB-222.6A	65 - 67	SILT (ML)				38.4	43	28	15		
☒ KB-223.1A	6 - 8	FAT CLAY (CH)				31.3	57	29	28		
▲ KB-223.1A	25 - 27	ELASTIC SILT (MH)				39.6	52	30	22		
★ KB-223.1A	45 - 47	SANDY LEAN CLAY (CL)				22.0	31	19	12		
⊙ KB-226.1	6 - 8	ELASTIC SILT with SAND (MH)				33.3	64	36	28		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay
● KB-222.6A	65 - 67	0.25				0.0	0.0	0.7		99.3	
☒ KB-223.1A	6 - 8	0.425				0.0	0.0	6.4		93.6	
▲ KB-223.1A	25 - 27	9.5				0.0	0.4	3.0		96.6	
★ KB-223.1A	45 - 47	12.5	0.259			0.0	14.3	28.9		56.8	
⊙ KB-226.1	6 - 8	4.75				0.0	0.0	25.0		75.0	

PROJECT: LAB Testing

SITE: Champlain- Hudson Power Express



PROJECT NUMBER: JB215256H

CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-10




Package 7A Phase 4 Borings
Champlain Hudson Power Express
New York

PROJECT NUMBER 20001480

CREATED BY	Kiewit
DATE	02/17/2023

Legend Key
● Kiewit Borings

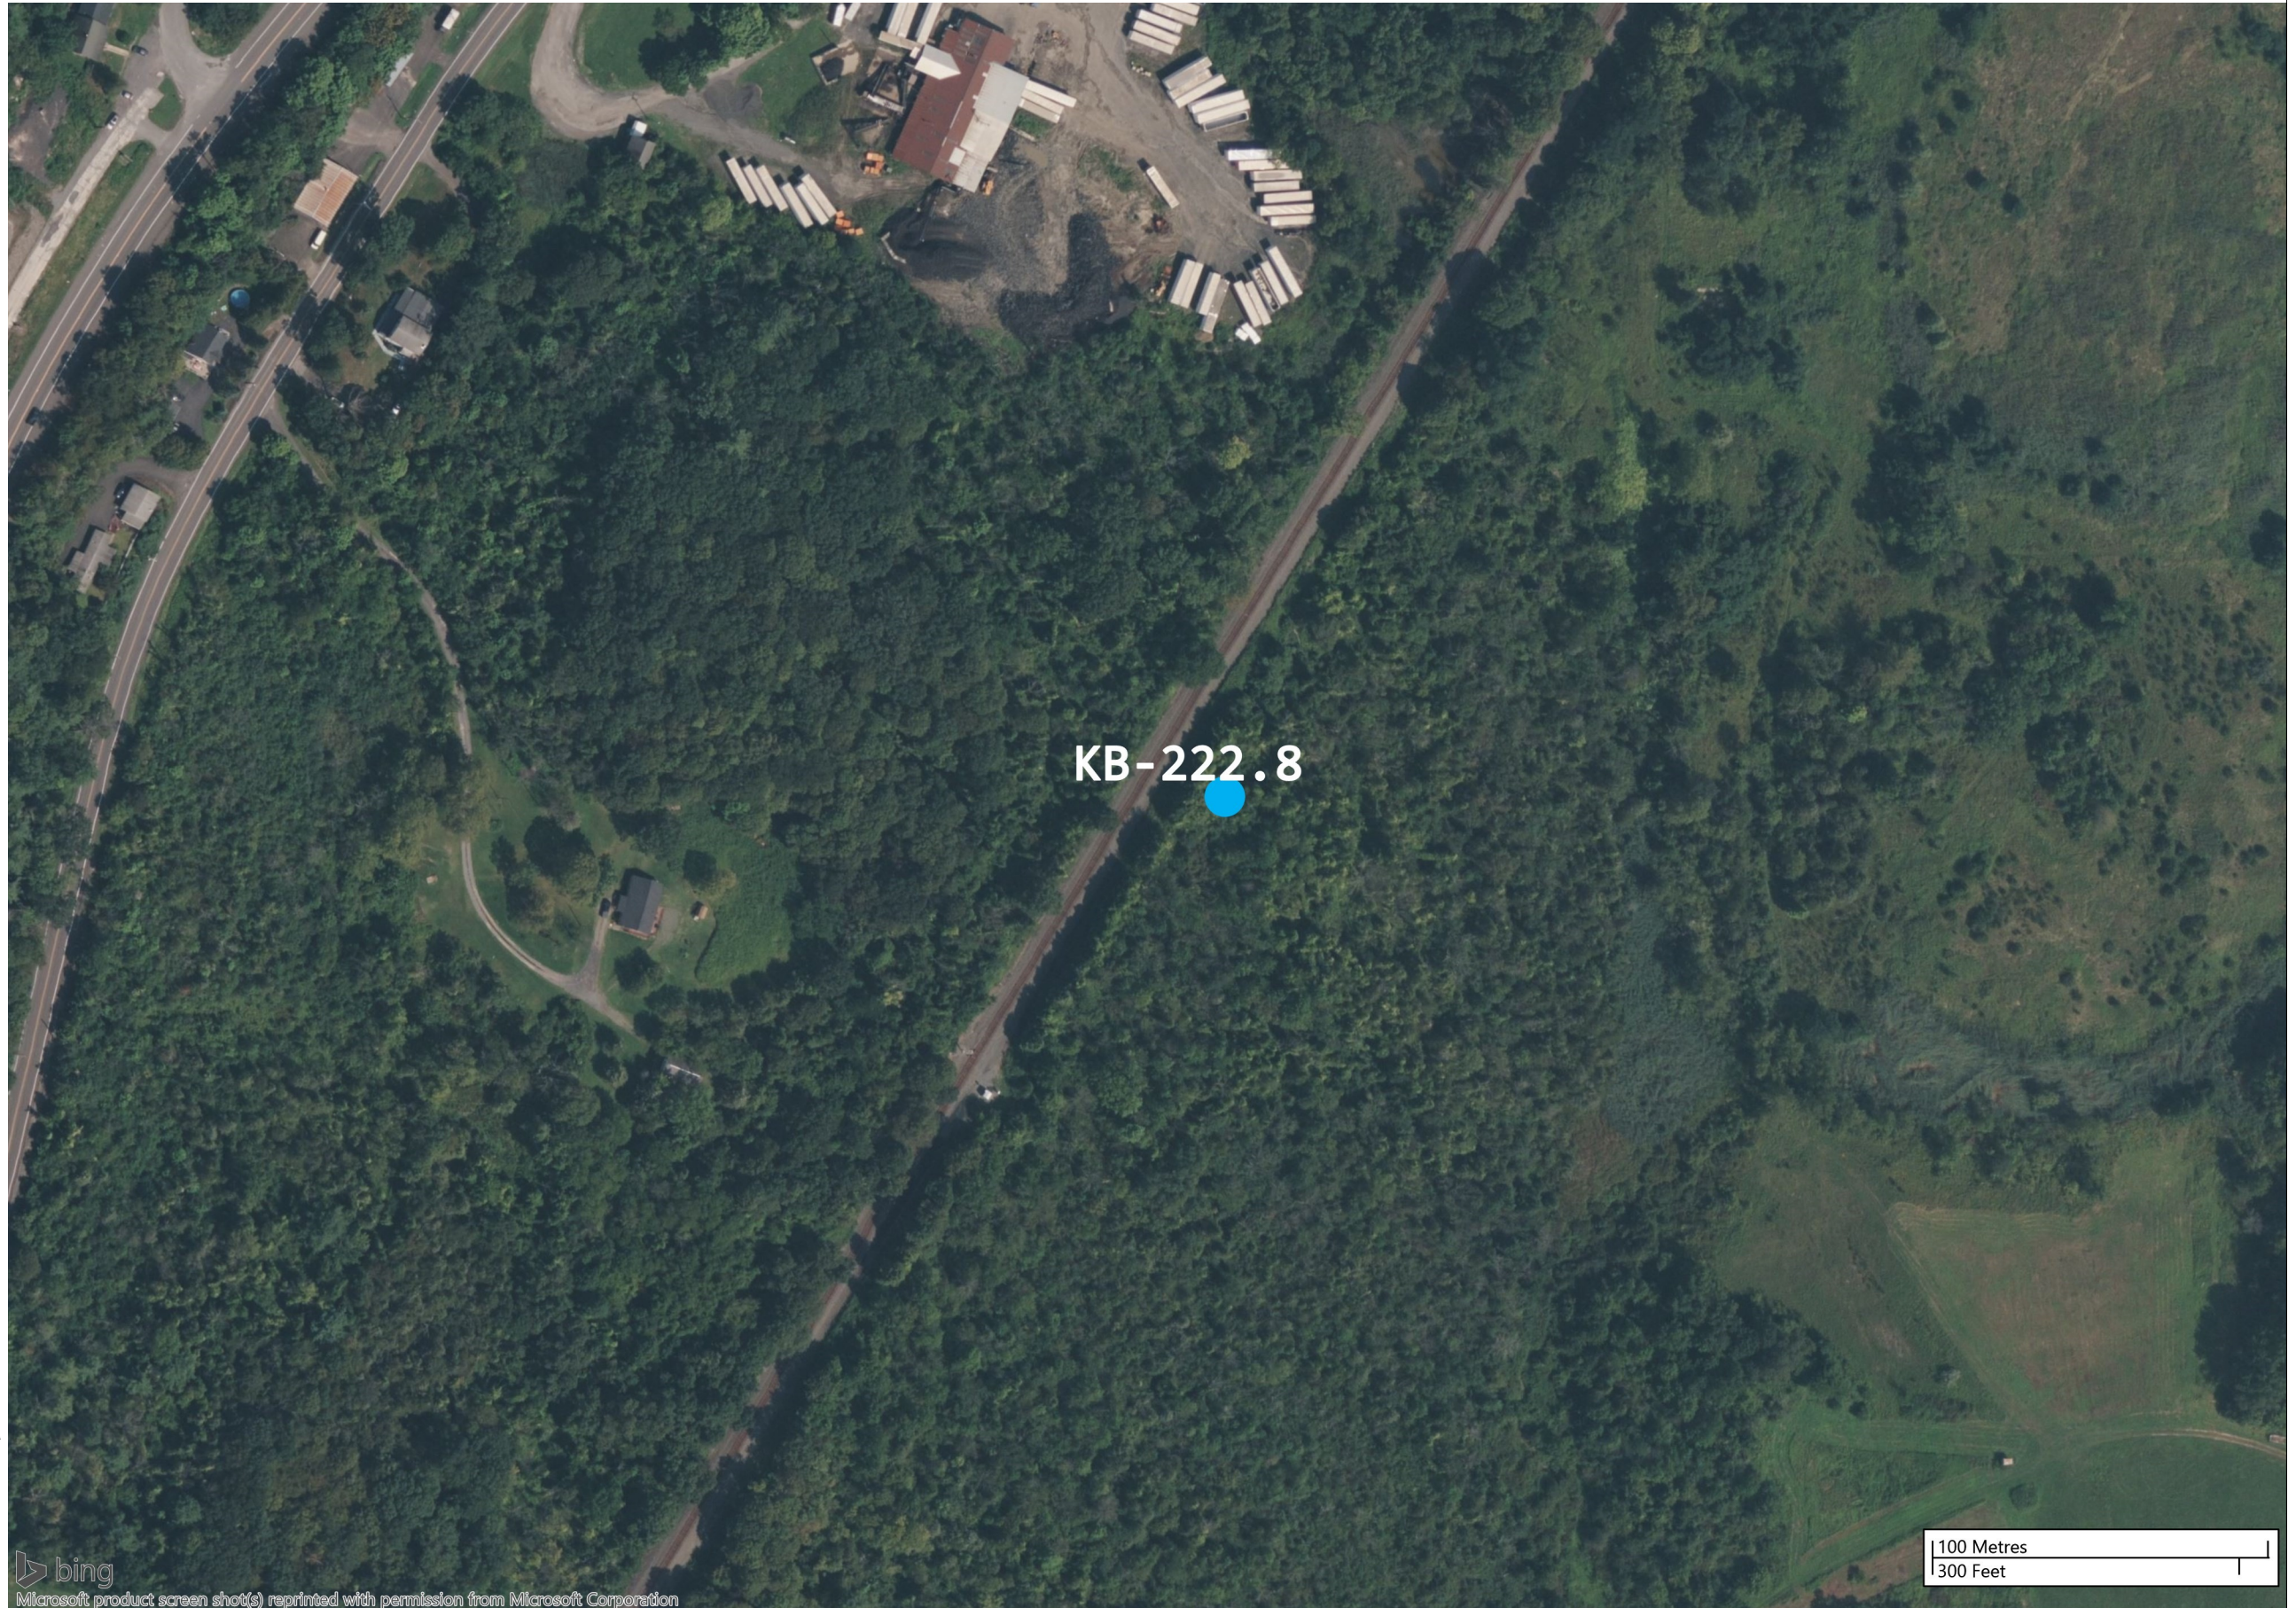



Kiewit

EXPLORATORY BORING LOG


Champlain Hudson Power Express
New York

BORING NO: KB-222.8

PROJECT NUMBER 20001480
START DATE 01/09/2023
FINISH DATE 01/11/2023

LOGGED BY S. Ahmad
DRILLER/RIG Eric / Geoprobe 7822DT
DRILL CONTRACTOR ADT Inc.

COORDINATES N 1230382.95
E 657696.81
GROUND ELEV. 117.2 ft
HAMMER TYPE/EFF. Automatic

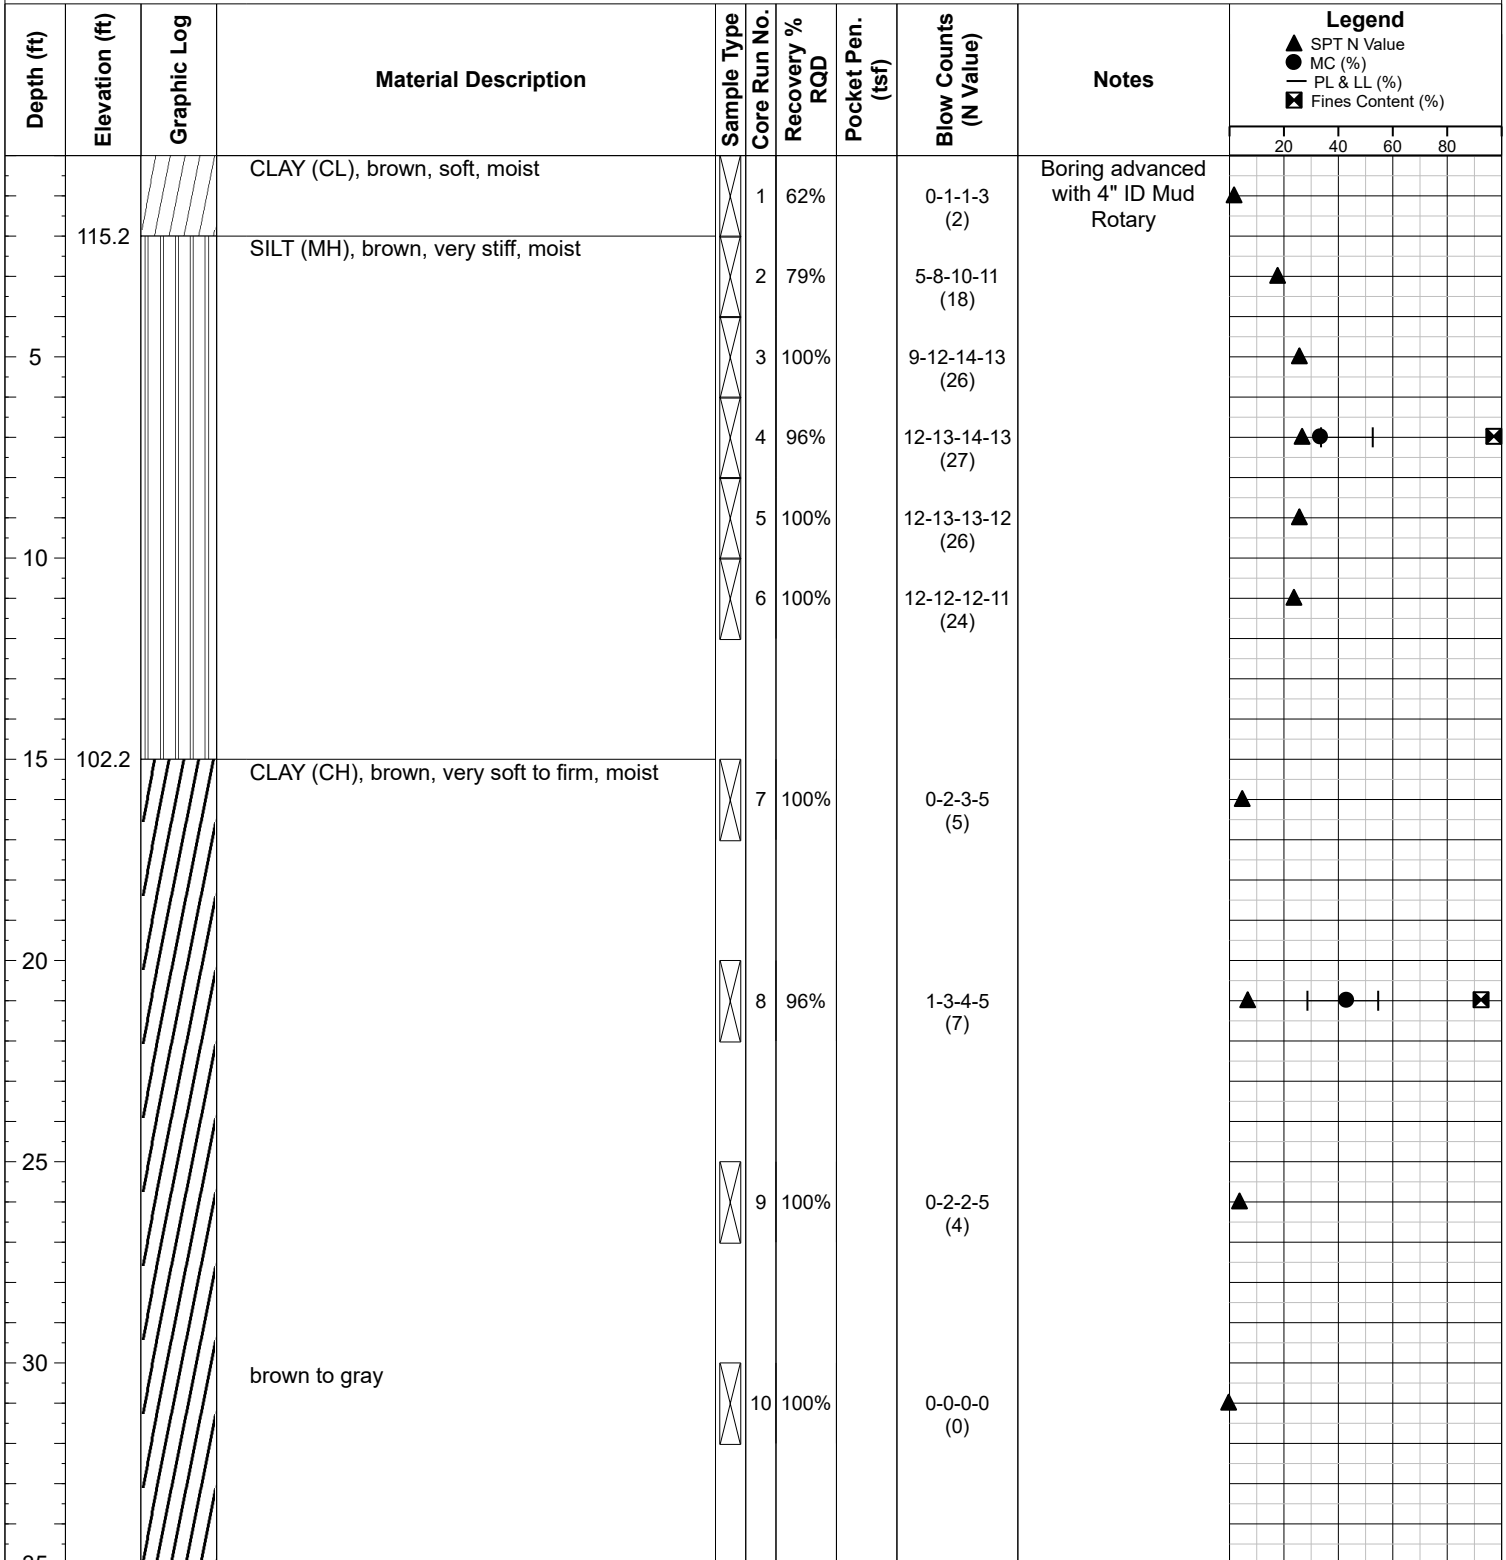



Kiewit

EXPLORATORY BORING LOG

Champlain Hudson Power Express
New York

BORING NO: KB-222.8

PROJECT NUMBER 20001480
START DATE 01/09/2023
FINISH DATE 01/11/2023

LOGGED BY S. Ahmad
DRILLER/RIG Eric / Geoprobe 7822DT
DRILL CONTRACTOR ADT Inc.

COORDINATES N 1230382.95
E 657696.81
GROUND ELEV. 117.2 ft
HAMMER TYPE/EFF. Automatic

Depth (ft)	Elevation (ft)	Graphic Log	Material Description	Sample Type	Core Run No.	Recovery %	Pocket Pen. (tsf)	Blow Counts (N Value)	Notes	Legend			
										▲	●	—	■
										SPT N Value	MC (%)	PL & LL (%)	Fines Content (%)
										20	40	60	80
			CLAY (CH), gray, soft to very soft, moist		11	100%		0-0-0-0 (0)		▲			
40					12	100%		0-0-0-0 (0)		▲			
45	72.2		SILT (ML), gray, very soft, moist		13	100%		0-0-0-0 (0)		▲	●	—	■
50					14	100%		0-0-0-0 (0)		▲			
55					15	100%		0-0-0-0 (0)		▲			
60					16	100%		0-0-0-0 (0)		▲			
65	52.2		SILT (MH), gray, very soft, moist		17	100%		0-0-0-0 (0)		▲	●	—	■
70													



Kiewit

EXPLORATORY BORING LOG

Champlain Hudson Power Express
New York

BORING NO: KB-222.8

PROJECT NUMBER 20001480
START DATE 01/09/2023
FINISH DATE 01/11/2023

LOGGED BY S. Ahmad
DRILLER/RIG Eric / Geoprobe 7822DT
DRILL CONTRACTOR ADT Inc.

COORDINATES N 1230382.95
E 657696.81
GROUND ELEV. 117.2 ft
HAMMER TYPE/EFF. Automatic

Depth (ft)	Elevation (ft)	Graphic Log	Material Description	Sample Type	Core Run No.	Recovery %	RQD	Pocket Pen. (tsf)	Blow Counts (N Value)	Notes	Legend			
											▲	●	—	☒
			SILT (MH), gray, very soft, moist		1	100%			0-0-0-0	3-inch ring sampler				
75			stiff		18	62%			2-6-8-8 (14)		▲			
80			very soft		19	100%			0-0-0-0 (0)		▲			
85	31.2		CLAY (CL), gray, hard, moist, with rock fragments (glacial till)							rig chatter at 86ft while drilling				
90	27.2		Boring Terminated at 90ft	☒	20	75%			50/4"					▲
95														
100														
105														

SOIL LEGEND

Explanation of Symbols and Terms Used on Boring and Test Pit
Logs for Sampling and Description of Soils

SAMPLE AND DRILL METHODS		COMMON ABBREVIATIONS AND ACRONYMS			
	Standard Penetration Split-Spoon Sample	MR	Mud Rotary	Bulk	Bulk Sample
	Undisturbed Sample	HSA	Hollow Stem Auger	EOB	End of Boring
	Piston Sampler	SSA	Solid Stem Auger	AR	Auger Refusal
	Grab Sample	SS	Split Spoon Sampler	N-Value	Sum of blows for last two 6-in. increments of SPT
	Bulk Sample	UD	Undisturbed Sample	USCS	Unified Soil Classification System
	Auger Cuttings	WOR	Weight of Rods		
	Rock Core	WOH	Weight of Hammer		
	Modified California Sample	SPT	Standard Penetration Test		
WATER LEVEL SYMBOLS		REC	Recovery		
		RQD	Rock Quality Designation		
	Observation at time of drilling	MC	Moisture Content		
	Observation after drilling	PI	Plasticity Index		
	Delayed observation	PL	Plastic Limit		
	Perched water observed at drilling	LL	Liquid Limit		
	Observed Seepage	CPT	Cone Penetration Test		
	Cave-in Depth	PP	Pocket Penetrometer		

CROSS SECTION LEGEND	
	N(bpf)
	Recovery %
	RQD %
	Material Symbol
% Moisture Content symbol" data-bbox="755 373 770 388"/>	% Moisture Content

RELATIVE DENSITY / CONSISTENCY				
Coarse-grained Soils		Fine-grained Soils		
N-Value	Density	N-Value	Consistency	Pocket Pen (TSF)
0 - 4	Very Loose	0 - 1	Very Soft	0.0 - 0.25
5 - 10	Loose	2 - 4	Soft	0.25 - 0.50
11 - 30	Medium	5 - 8	Firm	0.51 - 1.00
31 - 50	Dense	9 - 15	Stiff	1.01 - 2.00
> 50	Very Dense	16 - 30	Very Stiff	2.01-4.00
		> 30	Hard	> 4.00

RELATIVE PROPORTIONS OF GRAVEL, SAND, AND FINES	
Trace	> 5 %
Few	5 to 10 %
Little	15 to 25 %
Some	30 - 45 %
Mostly	50 to 100 %

SOIL GRAIN SIZE

U.S. Standard Sieve

6"	3"	3/4"	4"	10"	40"	200"		
Boulders	Cobbles	Gravel		Sand		Silt	Clay	
		Coarse	Fine	Coarse	Medium	Fine		
152	76.2	19.1	4.76	2.00	0.420	0.074	0.002	(mm)


CRITERIA FOR DESCRIBING MOISTURE CONDITION		CRITERIA FOR DESCRIBING CEMENTATION	
Description	Criteria	Description	Criteria
Dry	Absence of moisture, dusty, dry to the touch	Weak	Crumbles or breaks with handling or little finger pressure
Moist	Damp but no visible free water	Moderate	Crumbles or breaks with considerable finger pressure
Wet	Visible free water, typically soil is below water table	Strong	Will not crumble or break with finger pressure

CRITERIA FOR DESCRIBING STRUCTURE	
Description	Criteria
Stratified	Alternating layers of varying material or color with layers at least 1/4 in. thick; note thickness
Laminated	Alternating layers of varying material or color with the layers less than 1/4 in. thick; note thickness
Fissured	Breaks along definite planes of fracture with little resistance to fracturing
Slickensided	Fracture planes appear polished or glossy, sometimes striated
Blocky	Cohesive soil that can be broken down into small angular lumps which resist further breakdown
Lensed	Inclusion of small pockets of different soils, such as lenses of sand scattered through a mass of clay; note thickness
Homogeneous	Same color and appearance throughout

SOIL SYMBOLS

USCS SOIL TYPES		
Symbol	Group	Description
	GW	Well-graded gravels, gravel sand mixtures with trace or no fines
	GP	Poorly-graded gravels, gravel-sand mixtures with trace or no fines
	GW-GM	Well-graded gravels, gravel-sand mixtures with silt fines
	GW-GC	Well-graded gravels, gravel-sand mixtures with clay fines
	GP-GM	Poorly-graded gravels, gravel-sand mixtures with silt fines
	GP-GC	Poorly-graded gravels, gravel-sand mixtures with clay fines
	GM	Silty gravels, gravel-silt-sand mixtures
	GC	Clayey gravels, gravel-sand-clay mixtures
	GC-GM	Clayey gravels, gravel-sand-clay-silt mixtures
	SW	Well-graded sands, sand-gravel mixtures with trace or no fines
	SP	Poorly-graded sands, sand-gravel mixtures with trace or no fines
	SW-SM	Well-graded sands, sand-gravel mixtures with silt fines
	SW-SC	Well-graded sands, sand-gravel mixtures with clay fines
	SP-SM	Poorly-graded sands, sand-gravel mixtures with silt fines
	SP-SC	Poorly-graded sands, sand-gravel mixtures with clay fines
	SM	Silty sands, sand-gravel-silt mixtures
	SC	Clayey sands, sand-gravel-clay mixtures
	SC-SM	Clayey sands, sand-gravel-clay-silt mixtures
	ML	Inorganic silts with low plasticity
	CL	Inorganic clays of low plasticity, gravelly or sandy clays, silty clays, lean clays
	CL-ML	Inorganic clay-silts of low plasticity, gravelly clays, sandy clays, silty clays, lean clays
	OL	Organic silts and organic silty clays of low plasticity
	MH	Inorganic silts of high plasticity, elastic silts
	CH	Inorganic clays of high plasticity, fat clays
	OH	Organic clays and organic silts of high plasticity
	PT	Peat, humus, swamp soils with high organic contents

OTHER MATERIALS	
Symbol	Description
	Asphalt
	Concrete
	Crushed Stone/Aggregate Base
	Fill

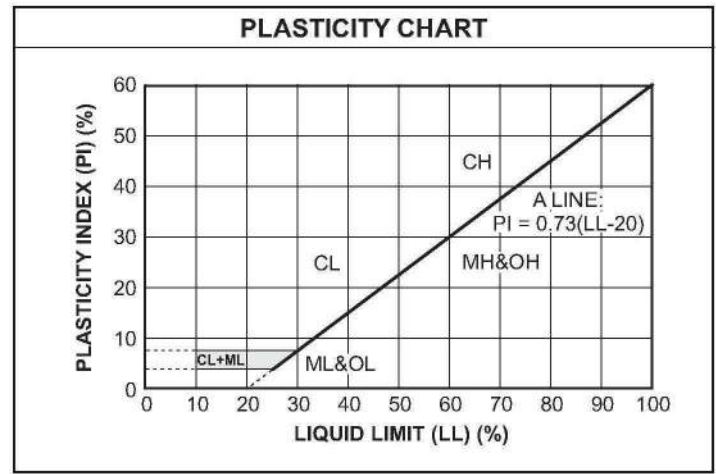

Summary of Laboratory Results

Sheet 1 of 1

BORING ID	Depth (Ft.)	Water Content (%)
KB-169.0-1.0	4-6	18.6
KB-169.0-1.0	10-12	22.8
KB-169.0-1.0	20-22	29.0
KB-169.0-1.0	35-37	26.2
KB-169.0-1.0	50-52	25.1
KB-169.0-2.4	4-6	9.7
KB-169.0-2.4	20-22	20.1
KB-169.0-2.4	35-37	29.8
KB-169.0-2.4	55-57	23.6
KB-169.0-2.5	4-6	18.0
KB-169.0-2.5	10-12	18.5
KB-169.0-2.5	30-32	28.0
KB-169.0-2.5	40-42	24.7
KB-169.0-3.6	4-6	13.0
KB-169.0-3.6	10-12	3.4
KB-169.0-3.6	25-27	13.3
KB-169.0-3.6	40-42	9.3
KB-169.0-3.6	50-52	2.5
KB-169.0-3.7	4-6	11.7
KB-169.0-3.7	20-22	23.0
KB-169.0-3.7	40-42	4.4
KB-169.0-3.7	60-62	8.6
KB-169.0-7.9	4-6	18.1
KB-221.0B	4-6	11.0
KB-221.0B	10-12	40.8
KB-221.0B	30-32	37.4
KB-221.0B	50-52	29.6
KB-221.8B	4-6	32.1
KB-221.8B	20-22	44.4
KB-221.8B	35-37	46.6
KB-221.8B	55-57	39.2
KB-222.8	6-8	33.6
KB-222.8	20-22	43.2
KB-222.8	45-47	39.4
KB-222.8	65-67	45.0

PROJECT: Lab Testing

SITE: Champlain to Hudson Power Express



PROJECT NUMBER: JB215256H


CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-1

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. SMART LAB SUMMARY-PORTRAIT JB215256H LAB TESTING.GPJ TERRACON_DATATEMPLATE.GDT 2/14/23

ATTERBERG LIMITS RESULTS

ASTM D4318

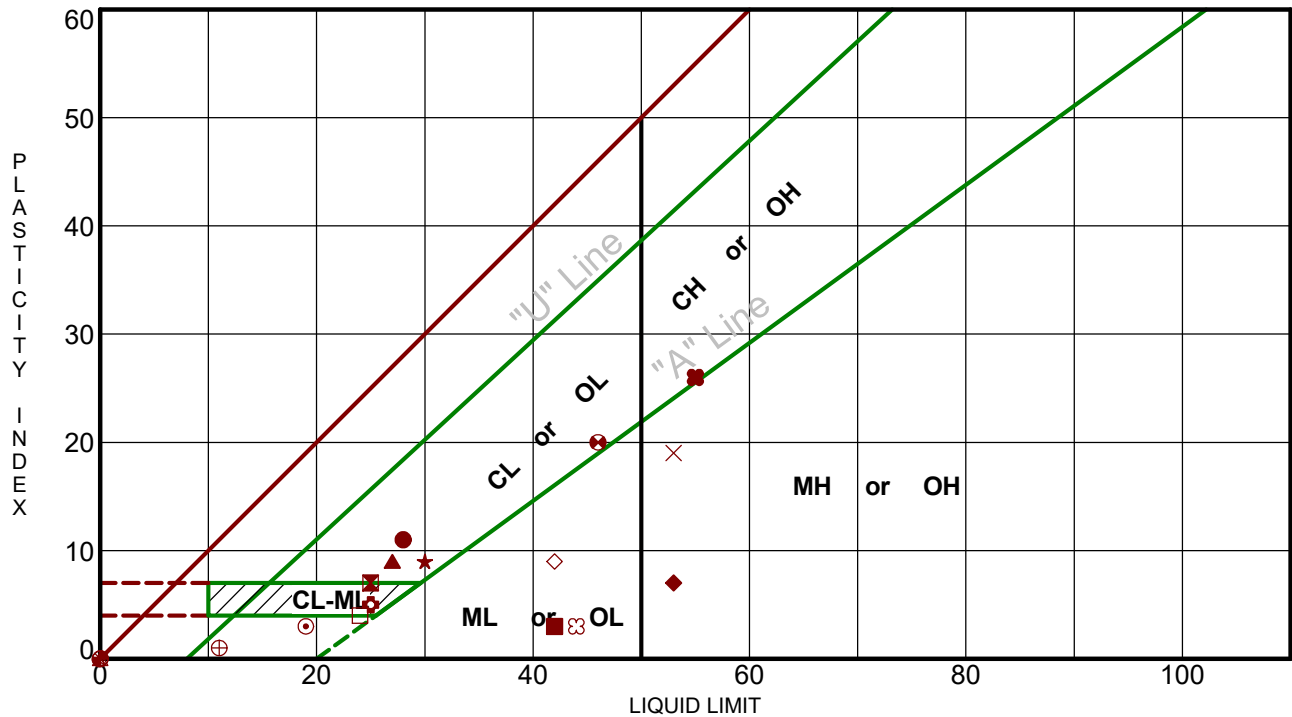

Boring ID	Depth (Ft)	LL	PL	PI	Fines	USCS	Description
● KB-169.0-1.0	20 - 22	28	17	11	93.4	CL	LEAN CLAY
⊠ KB-169.0-1.0	35 - 37	25	18	7	97.1	CL-ML	SILTY CLAY
▲ KB-169.0-1.0	50 - 52	27	18	9	99.4	CL	LEAN CLAY
★ KB-169.0-2.4	20 - 22	30	21	9	73.6	ML	SANDY SILT
⊙ KB-169.0-2.4	35 - 37	19	16	3	87.9	ML	SILT
⊕ KB-169.0-2.5	30 - 32	25	20	5	92.5	CL-ML	SILTY CLAY
○ KB-169.0-2.5	40 - 42	NP	NP	NP	95.7	ML	SILT
△ KB-169.0-3.6	4 - 6	NP	NP	NP	8.8	GP-GM	POORLY GRADED GRAVEL with SILT and SAND
⊗ KB-169.0-3.6	50 - 52	NP	NP	NP	43.6	SM	SILTY SAND
⊕ KB-169.0-3.7	60 - 62	11	10	1	39.1	SM	SILTY SAND
□ KB-221.0B	4 - 6	24	20	4	16.9	SC-SM	SILTY, CLAYEY SAND with GRAVEL
● KB-221.0B	10 - 12	46	26	20	96.3	CL	LEAN CLAY
⊕ KB-221.0B	30 - 32	NP	NP	NP	96.0	ML	SILT
★ KB-221.0B	50 - 52	NP	NP	NP	99.4	ML	SILT
⊗ KB-221.8B	4 - 6	44	41	3	72.3	ML	SILT with GRAVEL
■ KB-221.8B	20 - 22	42	39	3	98.3	ML	SILT
◆ KB-221.8B	35 - 37	53	46	7	95.5	MH	ELASTIC SILT
◇ KB-221.8B	55 - 57	42	33	9	99.6	ML	SILT
× KB-222.8	6 - 8	53	34	19	97.5	MH	ELASTIC SILT
■ KB-222.8	20 - 22	55	29	26	92.8	CH	FAT CLAY

PROJECT: Lab Testing

SITE: Champlain to Hudson Power Express

Terracon
30 Corporate Cir Ste 201
Albany, NY


PROJECT NUMBER: JB215256H

CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-1

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. ATTERBERG LIMITS JB215256H LAB TESTING.GPJ TERRACON.DATATEMPLATE.GDT 2/14/23

ASTM D4318




LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. ATTERBERG LIMITS JB215256H LAB TESTING.GPJ TERRACON DATATEMPLATE.GDT 2/14/23

Terracon
30 Corporate Cir Ste 201
Albany, NY

EXHIBIT: B-2

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

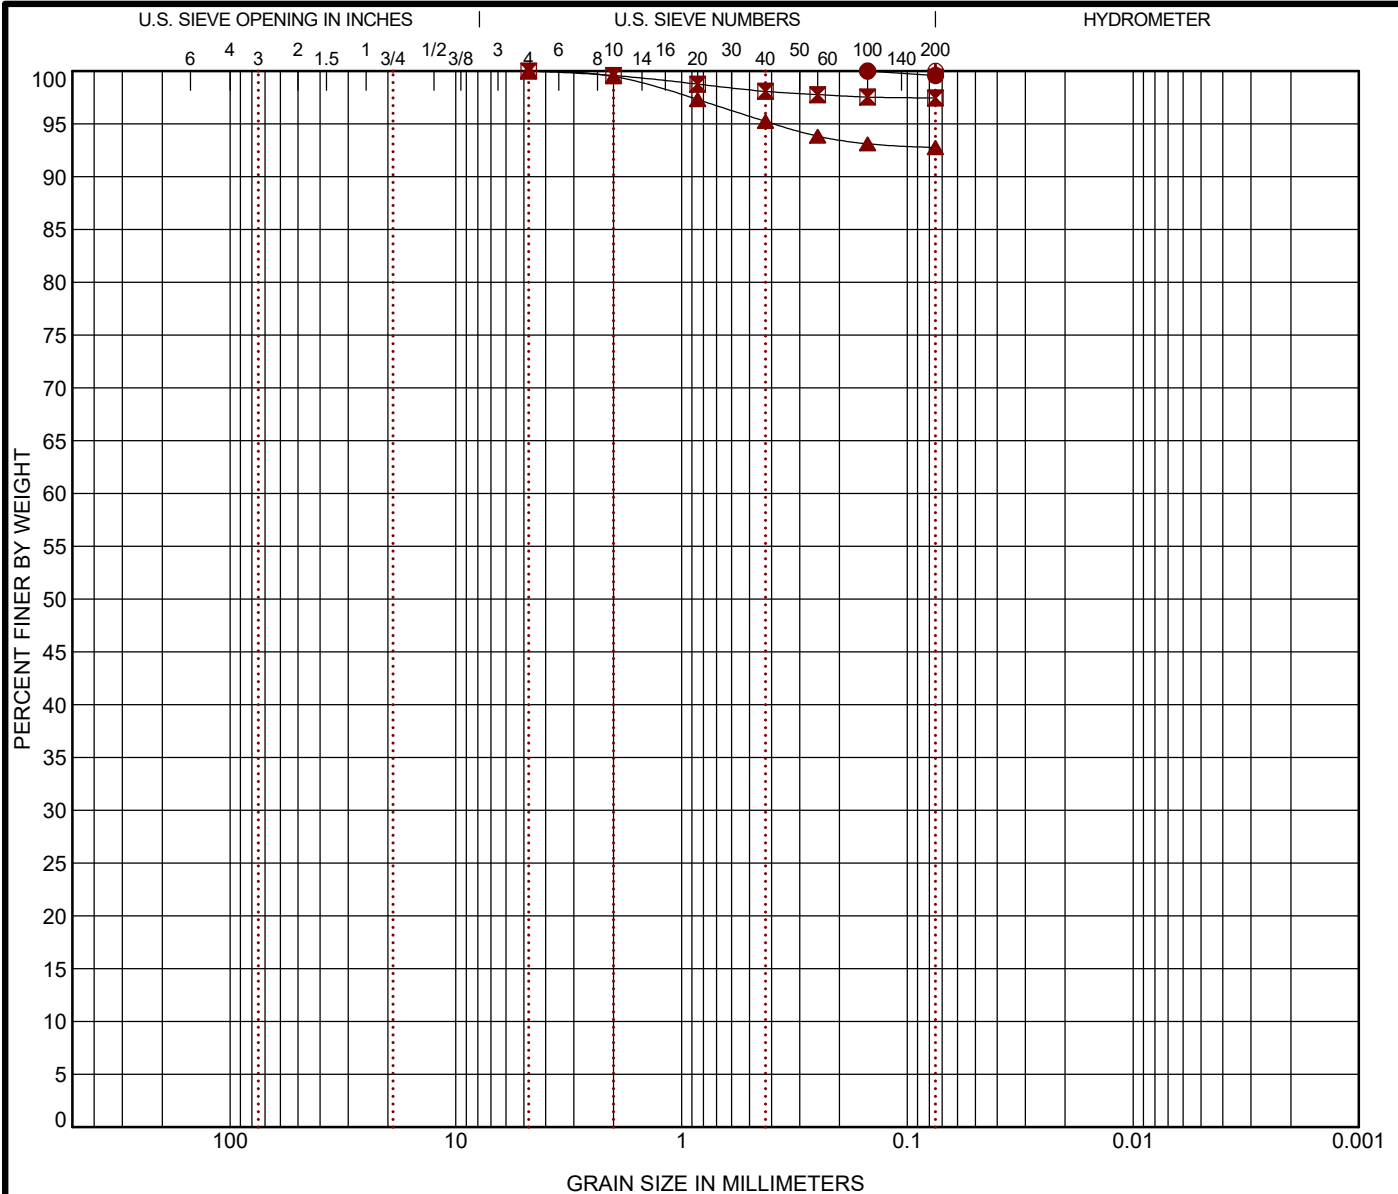

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID	Depth (Ft)	USCS Classification				WC (%)	LL	PL	PI	Cc	Cu
● KB-221.8B	55 - 57	SILT (ML)				39.2	42	33	9		
⊠ KB-222.8	6 - 8	ELASTIC SILT (MH)				33.6	53	34	19		
▲ KB-222.8	20 - 22	FAT CLAY (CH)				43.2	55	29	26		
★ KB-222.8	45 - 47	SILT (ML)				39.4	43	28	15		
⊙ KB-222.8	65 - 67	ELASTIC SILT (MH)				45.0	52	29	23		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay
● KB-221.8B	55 - 57	0.15				0.0	0.0	0.4		99.6	
⊠ KB-222.8	6 - 8	4.75				0.0	0.0	2.5		97.5	
▲ KB-222.8	20 - 22	4.75				0.0	0.0	7.2		92.8	
★ KB-222.8	45 - 47	0.075				0.0	0.0	0.0		100.0	
⊙ KB-222.8	65 - 67	0.075				0.0	0.0	0.0		100.0	

PROJECT: Lab Testing

SITE: Champlain to Hudson Power Express



PROJECT NUMBER: JB215256H

CLIENT: Kiewit Engineering (NY) Corp
Lone Tree, CO

EXHIBIT: B-7

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256H LAB TESTING.GPJ TERRACON_DATATEMPLATE.GDT 2/14/23

DATE: December 16, 2022

TO: Zachary Bauer; Tetra Tech Rooney

FROM: Matthew Hawley, P.E.; Kiewit Engineering (NY) Corp. **mkh**
Jaren Knighton; Kiewit Engineering (NY) Corp.

SUBJECT: Geotechnical Data: Segment 11 – Package 7A – HDD Crossing 120 – Revision 1
Champlain Hudson Power Express Project
Catskill, New York

Kiewit Engineering is providing the attached geotechnical data for use in the horizontal direction drill (HDD) design for the Champlain Hudson Power Express project in Upstate New York. This HDD crossing is located south of Catskill, New York. The approximate station for the start of HDD crossing number 120 is STA 70174+00 (42.2081° N, 73.8897° W).

The geotechnical data at this HDD crossing is attached. The available data is taken from the previous investigation by TRC and the recent investigations by Terracon and Kiewit, referenced below.

- TRC, Geotechnical Data Report, Champlain Hudson Power Express, Canadian Pacific Railway Borings MP 177.6-228.2, dated March 15, 2013.
- Terracon Consultants-NY, Inc., Results of Field Exploration, Champlain-Hudson Power Express – Package 7a, Catskill, NY, dated May 23, 2022.
- Kiewit Engineering (NY) Corp., Package 7A Phase 3 Borings, Champlain Hudson Power Express, New York, dated December 8, 2022.

Contact us if you have questions or require additional information.

HDD 120
Borings B222.9-1, K-223.0,
K-223.1, KB-223.1A
Segment 11 - Design Package 7A

CHPE Segment 11 - Package 7A

HDD Soil Boring Coordinates and Elevations

Firm	Boring	Northing (feet)	Easting (feet)	Ground Surface Elevation (feet)
TRC*	B221.0-1	1237452.6	663787.2	99.6
	B221.2-1	1236173.4	663261.8	115.0
	B221.4-1	1235622.5	662622.3	22.4
	B221.5-1	1235006.9	662058.8	95.5
	B221.6-1	1234675.8	661633.8	98.3
	B221.8-1	1234265.3	661277.2	99.4
	B222.34-1	1232191.5	659098.9	133.5
	B222.6-1	1231252.6	658182.3	113.7
	B222.9-1	1229751.0	657274.3	121.4
	B225.8-1	1215861.0	650622.7	91.0
	B226.1-1	1214654.4	650328.3	105.9
	B226.2-1	1214120.5	650254.4	108.5
	B226.6-1	1211894.7	649689.7	112.1
AECOM**	CU-1	1237028.6	663123.9	19.7
	CU-2	1236042.7	662897.0	24.8
	CU-2A	1235325.9	662268.9	38.1
	CU-5A	1210523.7	649411.8	118.4
	SC-5	1239310.3	664321.6	110.2
	SC-6	1237781.0	663919.8	101.6

Notes:

- Northings and Eastings are provided in NAD83 New York State Plane East Zone.

- Elevations are referenced to the NAVD88 datum.



* TRC boring coordinates as shown in Table 1-6 in AECOM report (reference below). Boring elevations estimated from November 2021 topographic survey by Williams Aerial.

** AECOM boring coordinates and elevations as shown in Table 1-6 in AECOM report.

*** Kiewit boring coordinates and elevations are noted on the boring logs.

Reference:

AECOM, Geotechnical Data Report, Upland Segments: Putnam Station, Washington County, to Cementon, Green County, NY, Champlain Hudson Power Express, dated May 28, 2021.

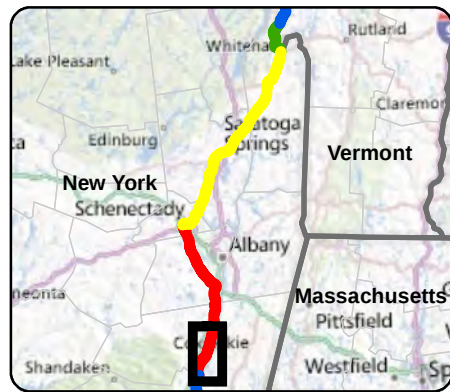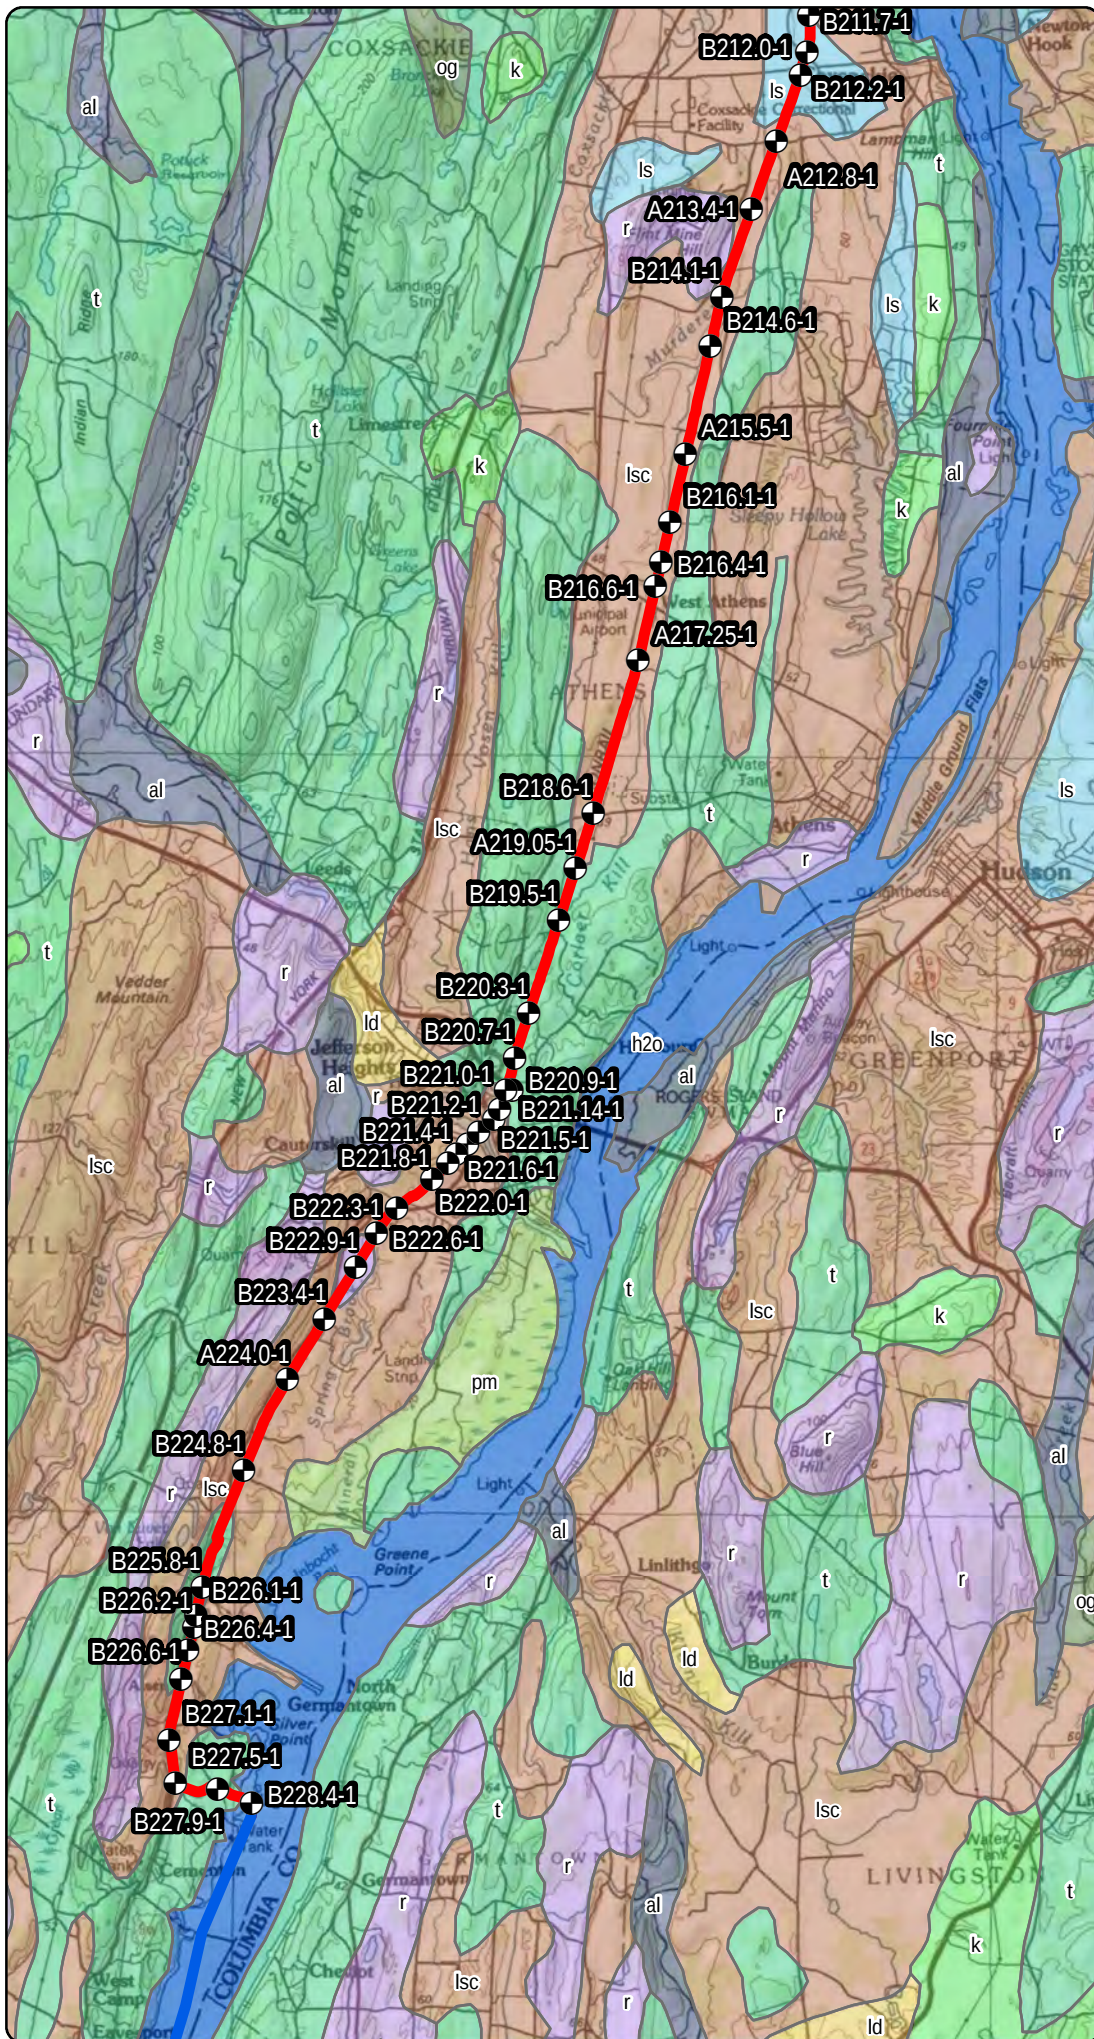


Legend

-  Approximate Boring Locations
-  Submarine Route
-  Terrestrial Route along CP Railroad ROW
-  Terrestrial Route along CSX Railroad ROW
-  Terrestrial Route

Surficial Geology


-  al - Recent alluvium, fine sand to gravel
-  d - Dunes, fine to medium sands
-  h2o, Water
-  k - Kame deposits, coarse to fine gravel and/or sand
-  km - Kame moraine, variable texture from boulders to sand
-  ld - Lacustrine delta, coarse to fine gravel and sand
-  ls - Lacustrine sand, generally quartz sand, well sorted, stratified
-  lsc - Lacustrine silt and clay, generally laminated silt and clay
-  og - Outwash sand and gravel, coarse to fine gravel with sand
-  pm - Swamp deposits, peat-muck, organic silt and sand in poorly drained area
-  r - Bedrock, exposed or generally within 1 meter of surface
-  t - Till, variable texture (boulders to silt)
-  tm - Till moraine, variable texture (size and sorting)




Champlain Hudson Power Express Project
Champlain Hudson Power Express Inc.

Surficial Geology and Geotechnical Borings

CSX Railroad ROW: Page 3 of 3



Prepared: 1/15/2013

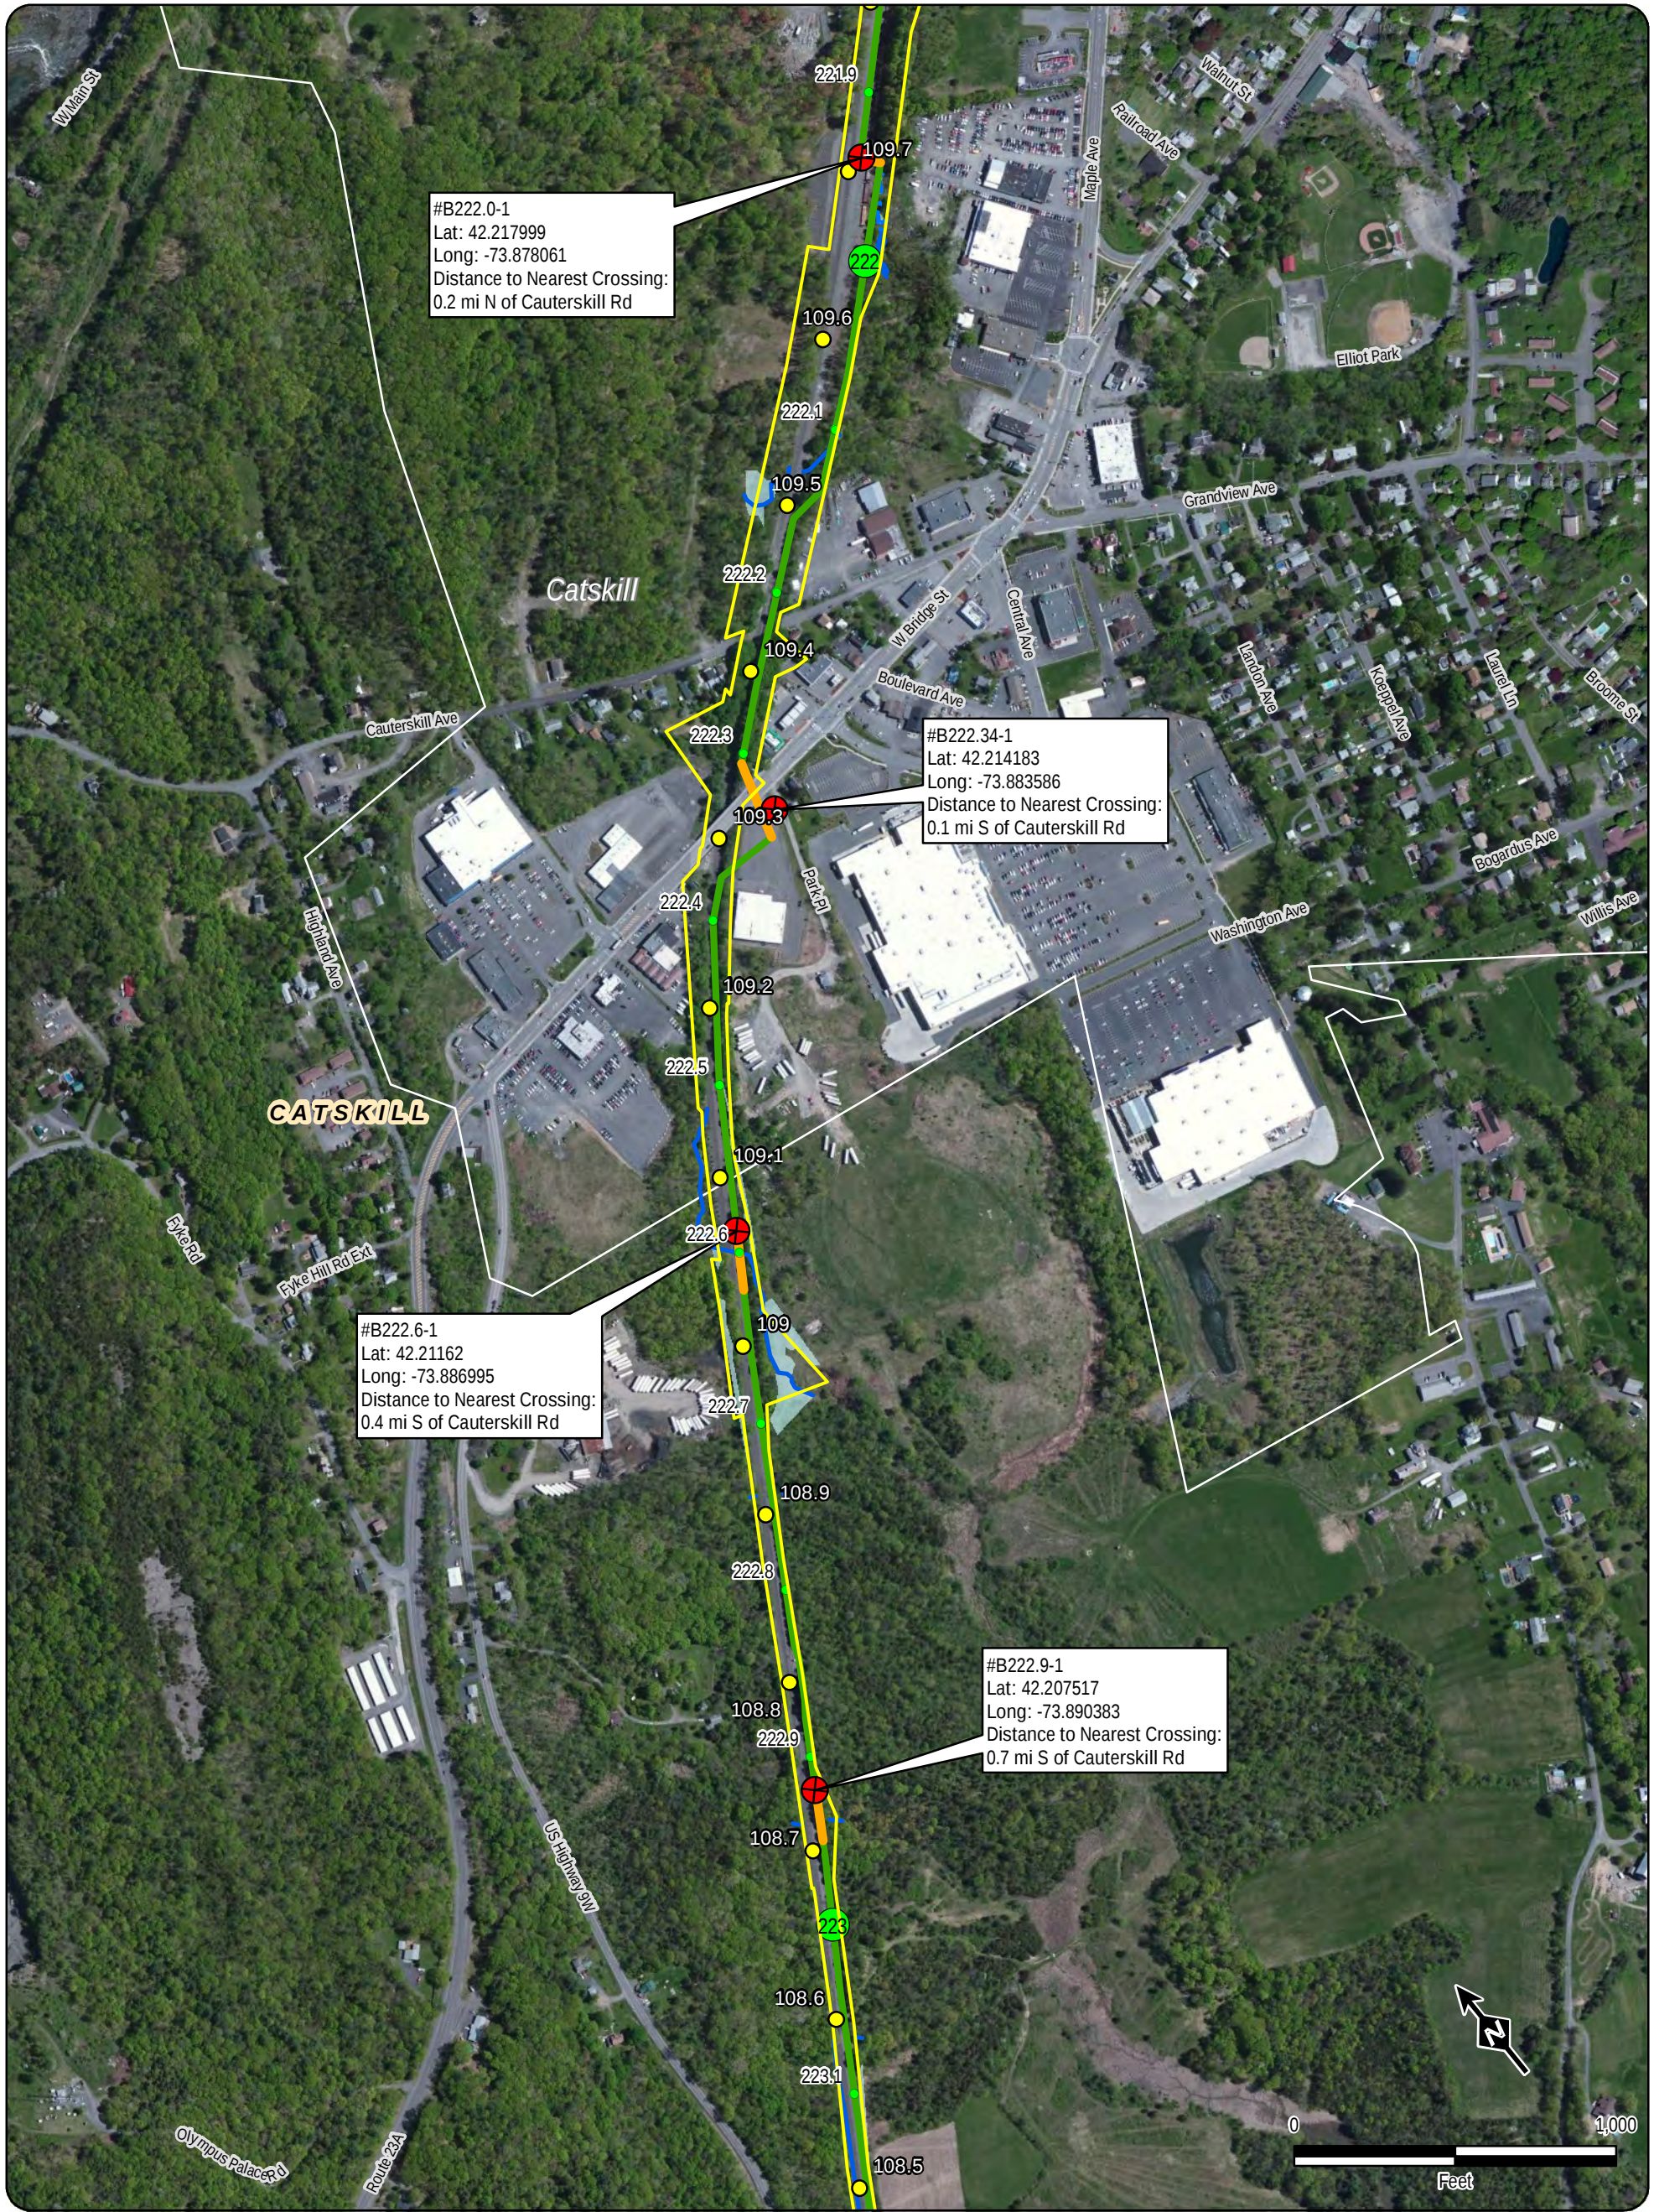

111.8

135

Terrestrial Route HVDC

Submarine Route HVDC

Preliminary HDD Locations

Preliminary Pipe Bridge Location

Approximate RR Mileposts

CP/CSX ROW

DOT ROW

LEGEND

Perennial Stream

Intermittent Stream

Ditch

Surface Water

Wetland

Town Boundary

Village Boundary

Geotechnical Borings

Not Drilled

As Built

Road Name

TOWN NAME

Village Name

Champlain Hudson Power Express Project

Champlain Hudson Power Express Inc.

Geotechnical Boring Locations

Catskill - CSX

Sheet 91 of 95

Prepared by: HDR & CTRC 3/12/2013



TEST BORING LOG

PROJECT: TDI CHAMPLAIN HUDSON POWER EXPRESS

LOCATION: CSX RAILROAD ROW, NY

BORING B222.9-1

G.S. ELEV. N/A

FILE 195651

SHEET 1 OF 1

GROUNDWATER DATA

FIRST ENCOUNTERED NR			
DEPTH	HOUR	DATE	ELAPSED TIME
10.0'	NR	12/2	0 HR

METHOD OF ADVANCING BOREHOLE

a	FROM	0.0'	TO	10.0'
d	FROM	10.0'	TO	30.0'

DRILLER P. PLANTIER

HELPER M. NAGEY

INSPECTOR N/A

DATE STARTED 12/02/2012

DATE COMPLETED 12/02/2012

DEPTH	A	B	C	DESCRIPTION	Wn	REMARKS
				LIGHT BROWN SILT, SM F/ GRAVEL, TR CLAY, TR F/M SAND		
	S-1	5 5 9 5		2.0		
				LIGHT BROWN SILT, TR CLAY	29.7	
	S-2	9 10 11 9		4.0		
5					33.0	
	S-3	8 7 11 8			30.8	
	S-4	11 13 19 18			33.4	
10	S-5	12 12 12 12				
				LIGHT BROWN SILT, SM CLAY	30.5	
15	S-6	4 5 6				
20	S-7	5 6 7				
25	S-8	30 50/0.4		23.5		
				TAN SILT		
				28.5		
30	S-9	21 13 22		30.0		
				GRAY C/ GRAVEL-SIZED ROCK FRAGMENTS		
				END OF BORING AT 30'		
35						

NEWPROJECTS TEST BORING LOG 195651_TDI_CSX.GPJ SITE BLAUVELT.GDT 3/12/13

DRN. TBT
CKD. PWK



SUMMARY OF LABORATORY TEST DATA

Project Name: TDI Champlain Hudson Power Express – CSX
 Client Name: Transmission Developers, Inc.
 TRC Project #: 195651

SAMPLE IDENTIFICATION			Soil Group (USCS System)	GRAIN SIZE DISTRIBUTION				PLASTICITY				Specific Gravity	Moisture Content (%)	Unit Weight (pcf)	Compressive Strength (tsf)	Organic Content (%)
Boring #	Sample #	Depth (ft)		Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Liquidity Index					
B222.34-1	S-2	2.0-4.0	-	-	-	-	-	-	-	-	-	-	31.3	-	-	-
	S-4	6.0-8.0	CH	-	-	-	-	58	29	29	0.2	-	35.2	-	-	-
	S-5	8.0-10.0	-	-	-	-	-	-	-	-	-	-	36.2	88.2	-	-
	S-6	13.5-15.0	CH/MH	-	-	-	-	56	30	26	0.2	-	34.8	-	-	-
B222.6-1	S-3	4.0-6.0	SM	0.0	6.6	93.4		-	-	-	-	-	19.6	-	-	-
	S-4	6.0-8.0	-	17.1	18.6	64.3		-	-	-	-	-	30.0	-	-	14.4
	S-5	8.0-10.0														
	R-2	15.6-16.0	-	-	-	-		-	-	-	-	-	-	166.7	665	-
	R-3	22.6-23.0	-	-	-	-		-	-	-	-	-	-	169.0	436	-
B222.9-1	S-2	2.0-4.0	-	-	-	-	-	-	-	-	-	-	29.7	-	-	-
	S-3	4.0-6.0	-	-	-	-	-	-	-	-	-	-	33.0	-	-	-




SUMMARY OF LABORATORY TEST DATA

Project Name: TDI Champlain Hudson Power Express – CSX
 Client Name: Transmission Developers, Inc.
 TRC Project #: 195651

SAMPLE IDENTIFICATION			Soil Group (USCS System)	GRAIN SIZE DISTRIBUTION				PLASTICITY				Specific Gravity	Moisture Content (%)	Unit Weight (pcf)	Compressive Strength (tsf)	Organic Content (%)
Boring #	Sample #	Depth (ft)		Gravel (%)	Sand (%)	Silt (%)	Clay (%)	Liquid Limit (%)	Plastic Limit (%)	Plasticity Index (%)	Liquidity Index					
	S-4	6.0-8.0	-	-	-	-	-	-	-	-	-	-	30.8	-	-	-
	S-5	8.0-10.0	CH	-	-	-	-	54	28	26	0.2	-	33.4	89.6	-	-
	S-6	13.5-15.0	-	-	-	-	-	-	-	-	-	-	30.5	94.4	-	-
B223.4-1	S-1	0.0-2.0	-	45.4	17.9	36.7		-	-	-	-	-	18.9	-	-	-
	S-2	2.0-4.0														
	S-3	4.0-6.0	-	-	-	-	-	-	-	-	-	-	37.6	-	-	-
	S-4	6.0-8.0	-	4.6		3.4	92.0	-	-	-	-	2.79	35.5	-	-	-
	S-5	8.0-10.0	-	-	-	-	-	-	-	-	-	-	30.5	-	-	-
	S-6	13.5-15.0	-	-	-	-	-	-	-	-	-	-	34.3	89.5	-	-
	S-7	18.5-20.0	ML	-	-	-	-	43	28	15	0.2	-	31.6	-	-	-
A224.0-1	S-1	0.0-2.0	-	-	-	-	-	-	-	-	-	-	3.1	-	-	-

LIQUID AND PLASTIC LIMITS TEST REPORT

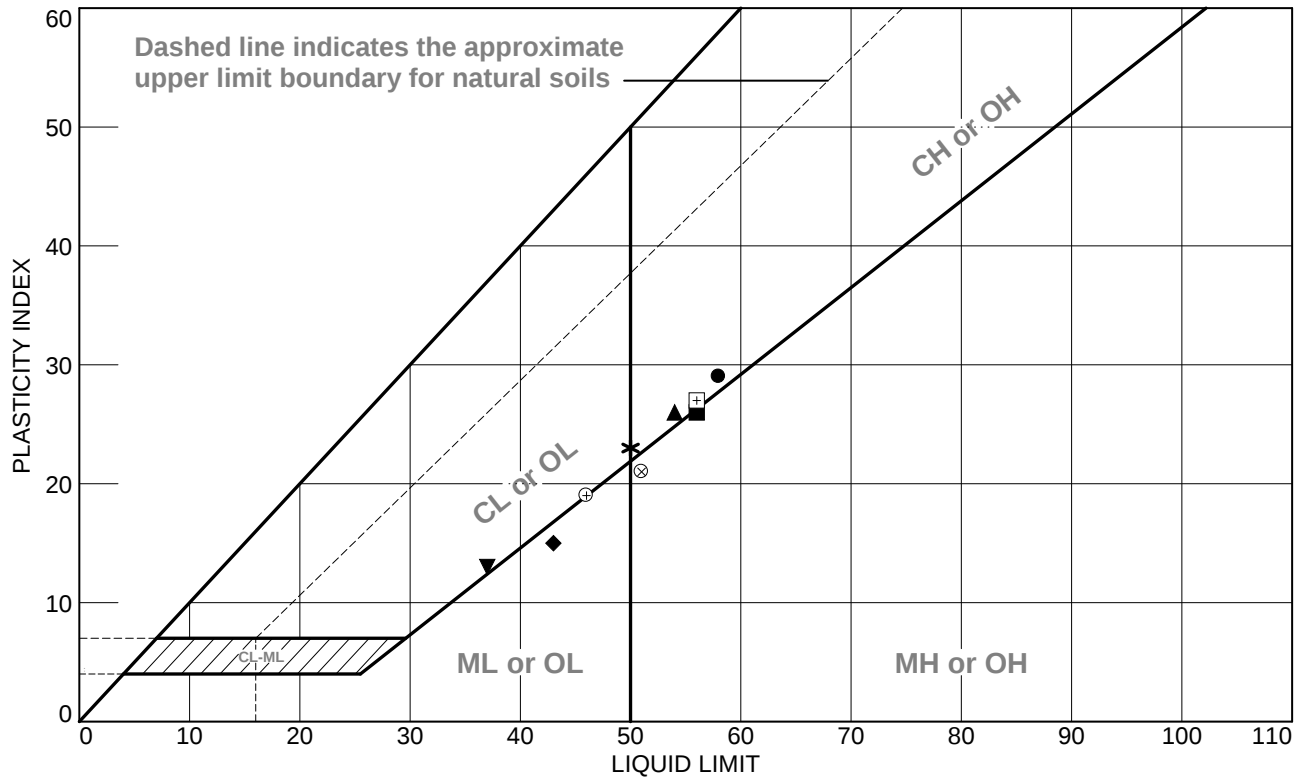


SOIL DATA

	SOURCE	SAMPLE NO.	DEPTH	NATURAL WATER CONTENT (%)	PLASTIC LIMIT (%)	LIQUID LIMIT (%)	PLASTICITY INDEX (%)	USCS
●	B222.34-1	S-4	6.0-8.0 FT	35.2	29	58	29	CH
■	B222.34-1	S-6	13.5-15.0 FT	34.8	30	56	26	CH/MH
▲	B222.9-1	S-5	8.0-10.0 FT	33.4	28	54	26	CH
◆	B223.4-1	S-7	18.5-20.0 FT	31.6	28	43	15	ML
▼	B224.8-1	S-8 & S-9	23.5-30.0 FT	33.3	24	37	13	CL
*	B226.1-1	S-6	13.5-15.0 FT	36.9	27	50	23	CH
⊕	B226.1-1	S-8	23.5-25.0 FT	39.0	27	46	19	CL
⊞	B226.6-1	S-3 & S-4	4.0-8.0 FT	38.8	29	56	27	CH
⊗	B226.6-1	S-6 & S-7	13.5-20.0 FT	53.7	30	51	21	MH

TRC
Engineers, Inc.
Mt. Laurel, NJ

Client: TRANSMISSION DEVELOPERS INC.
Project: TDI CHAMPLAIN HUDSON POWER EXPRESS - CSX
Project No.: 195651

Figure 9

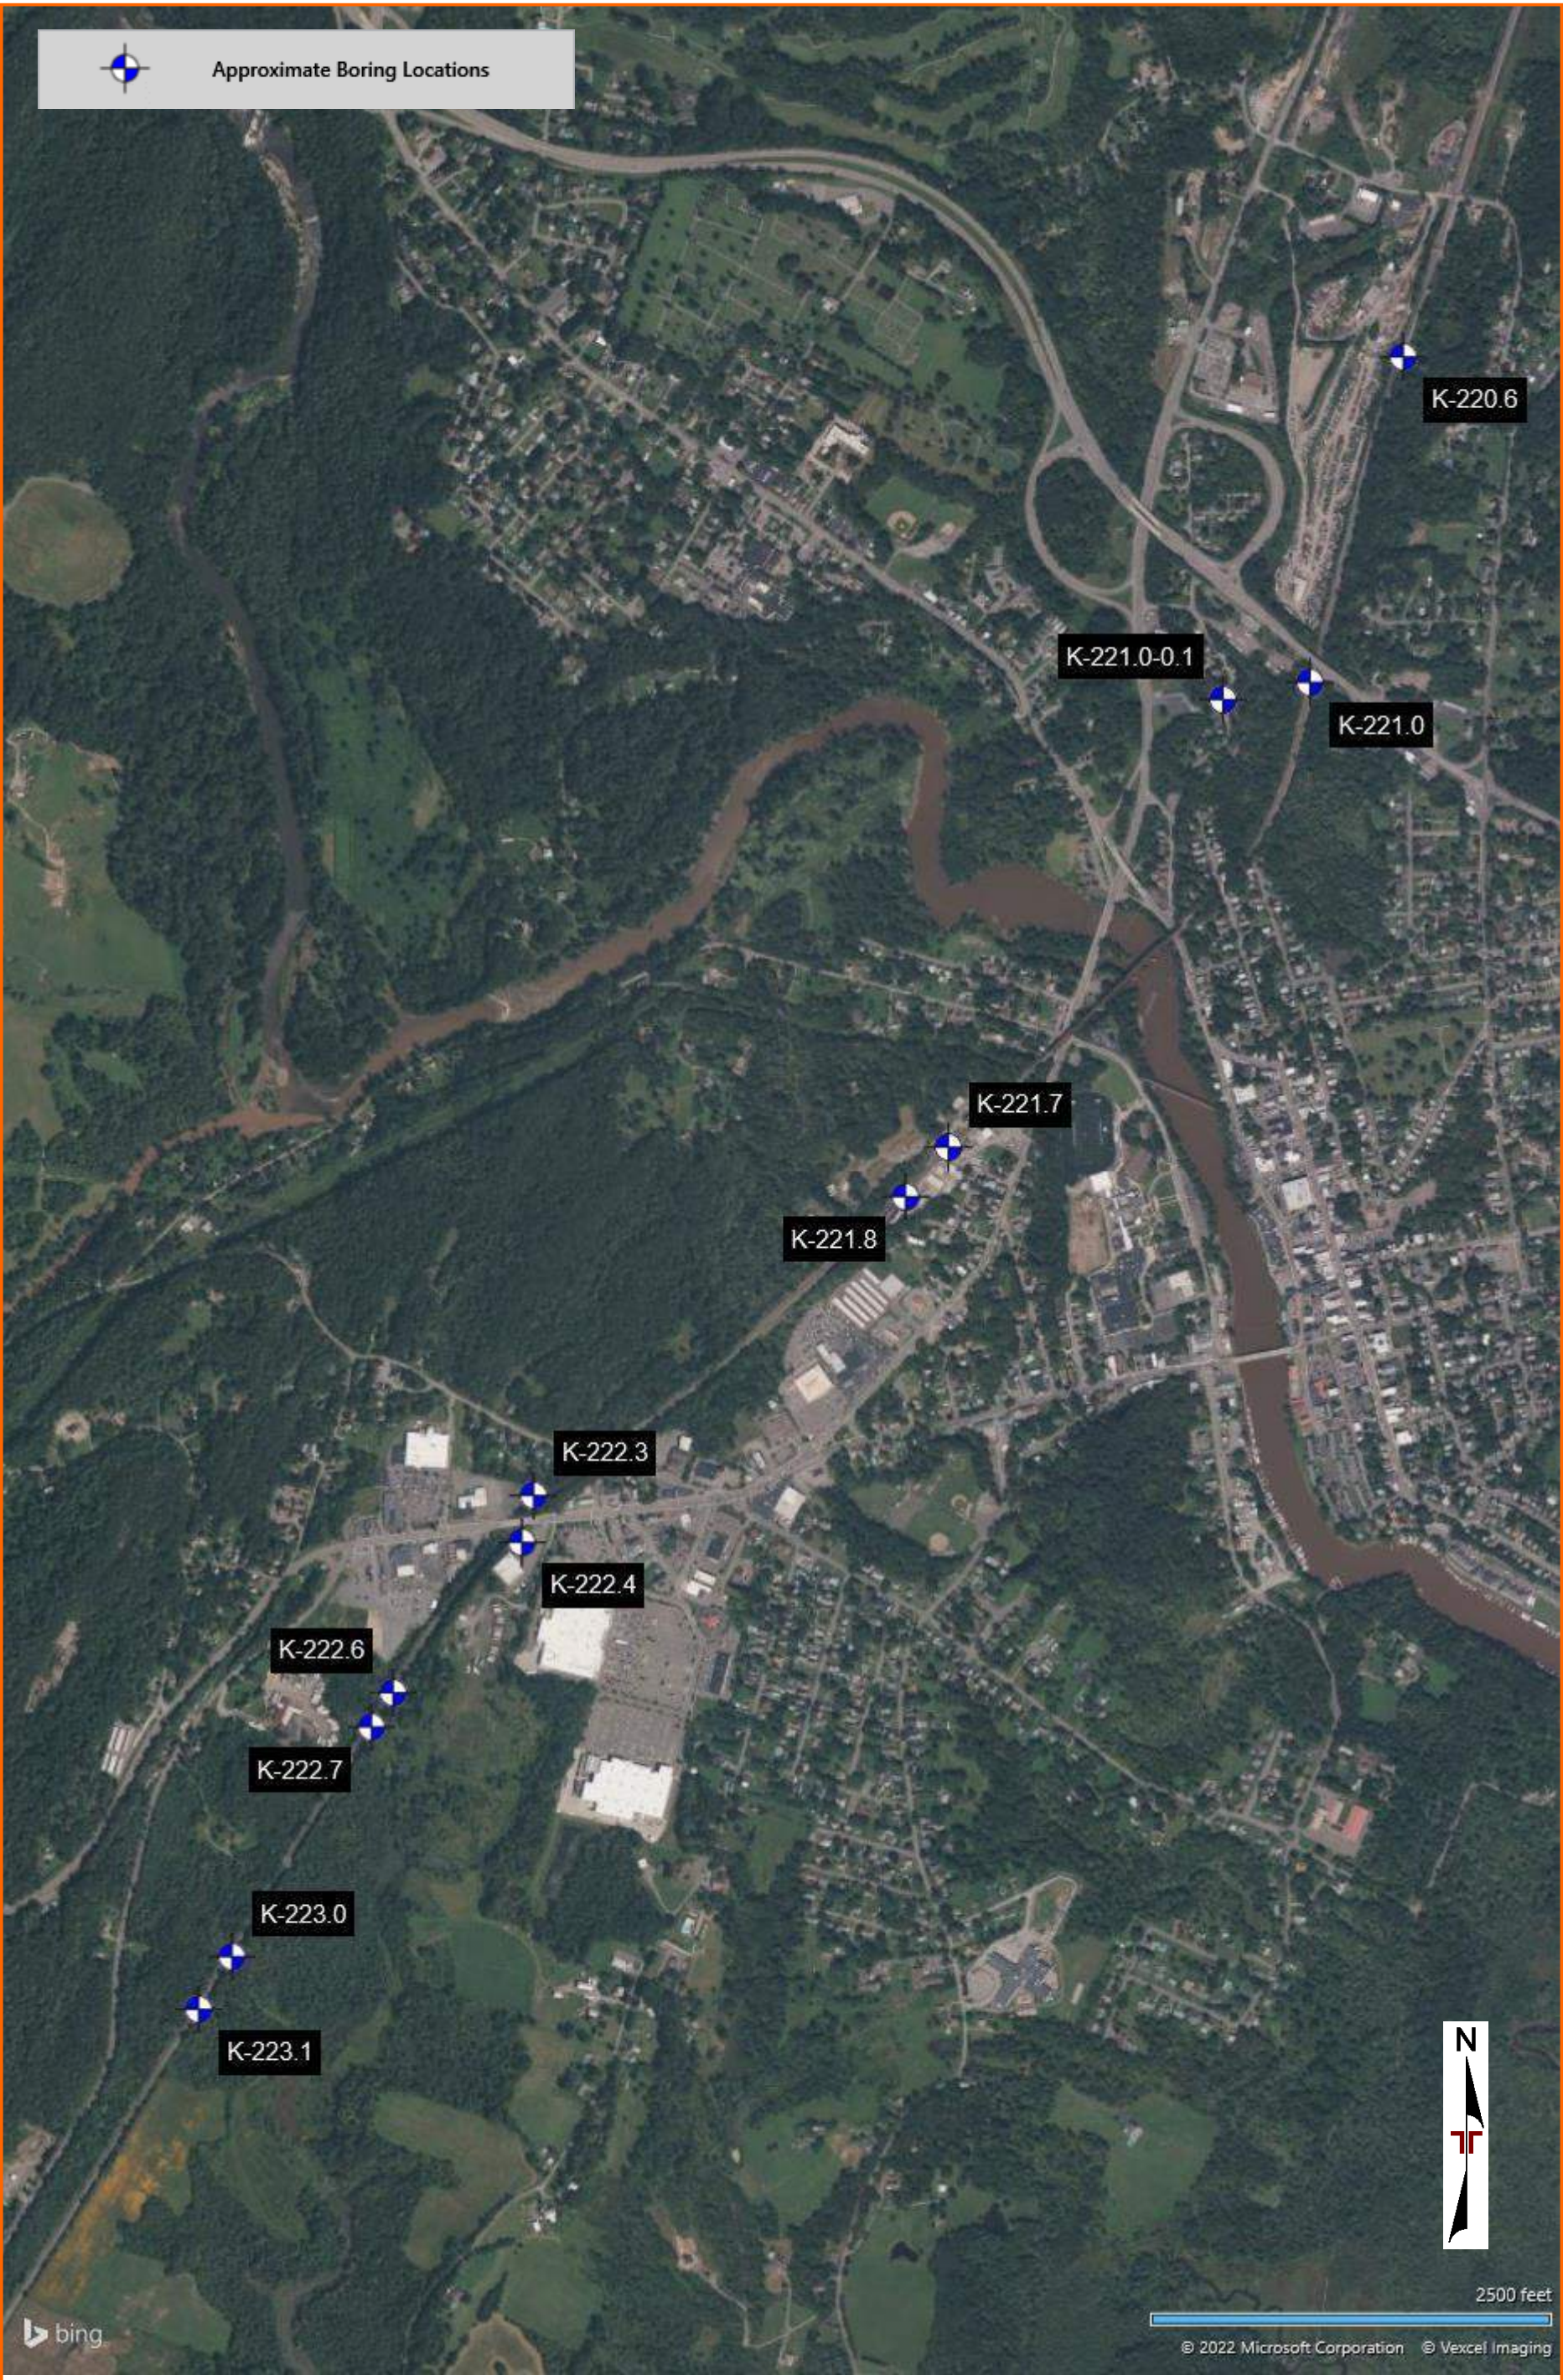

BORING LOG NO. K-223.0

Page 1 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan Latitude: 42.206914° Longitude: -73.890911° Surface Elev.: 118.72 (Ft.)	DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES
								LL-PL-PI	
	DEPTH ELEVATION (Ft.)								
	FILL - SOILS REMOVED VIA VACUUM EXTRACTION								
		5							
	6.5	112							
	FILL - SILT AND CLAY , with gravel, gray and brown, medium stiff to stiff		X	5		5-6-4 N=10			
			X	2		4-3-3-5 N=6			
	10.0	108.5							
	FILL - SANDY LEAN CLAY , gray and brown, soft		X	8		3-2-2-3 N=4	34.0	43-23-20	59
	15.0	103.5							
	FILL - SILT AND CLAY , gray and brown, medium stiff		X	12		2-2-3-5 N=5			
		20							
			X	16		WOH-2-5-6 N=7			
	25.0	93.5							

Stratification lines are approximate. In-situ, the transition may be gradual.
Rock core taken from offset boring due to broken core barrel. Coring terminated at 39' with approval from Jaren with Kiewit after pictures of rock core were sent to him.

Hammer Type: Automatic

Advancement Method:
4 1/4 HSA

See [Exploration and Testing Procedures](#) for a description of field and laboratory procedures used and additional data (if any).

Notes:

Logged by LC
Hammer Efficiency Summary:
Energy Transfer Ratio: 89.2% +/-2.4%
Hammer Efficiency Correction (CE):1.49
WOH = Weight of Hammer

Abandonment Method:
Backfilled with bentonite grout upon completion

See [Supporting Information](#) for explanation of symbols and abbreviations.

Elevations were provided by Kiewit.

WATER LEVEL OBSERVATIONS

No measurable groundwater prior to grouting

Terracon
30 Corporate Cir Ste 201
Albany, NY

Boring Started: 03-25-2022

Boring Completed: 03-28-2022

Drill Rig: Diedrich D-70

Driller: J. Raushcer

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

BORING LOG NO. K-223.0

Page 2 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS	PERCENT FINES
	Latitude: 42.206914° Longitude: -73.890911°								LL-PL-PI	
DEPTH ELEVATION (Ft.)										
	FILL - LEAN CLAY WITH SAND , gray and brown, stiff		22	2-6-6-7 N=12	33.4	46-26-20	85			
	30.0	88.5								
	FILL - SILTY SAND WITH GRAVEL , brown, medium dense		18	11-8-10-15 N=18						
	32.0	86.5								
	WEATHERED ROCK , gray		35	REC = 33% RQD = 0%	REC = 92% RQD = 69%					
34.0	84.5									
35.0	83.5									
	GRAYWACKE , highly weathered, very close fractured, very poor									
	35.0	83.5								
	GRAYWACKE , moderately weathered, with highly weathered veins, very close to moderate fractured, fair RQD, gray									
	39.0	79.5								
Boring Terminated at 39 Feet										

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

BORING LOG NO. K-223.1

Page 1 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (in.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS		PERCENT FINES
	Latitude: 42.206011° Longitude: -73.891683°								LL-PL-PI		
DEPTH			Surface Elev.: 123.08 (Ft.) ELEVATION (Ft.)								
	<u>FILL - SOILS REMOVED VIA VACUUM EXTRACTION</u>										
	6.0		117								
	<u>FILL - SILT AND CLAY</u> , brown, medium stiff										
	no recovery, pushed cobble during sampling from 8'-10'										
	10.0		113								
	<u>SILT AND CLAY (CL-ML)</u> , brown, stiff										
	15.0		108								
	<u>LEAN CLAY WITH SAND (CL)</u> , brown, stiff										
	20.0		103								
	<u>LEAN CLAY (CL)</u> , gray, soft										

Stratification lines are approximate. In-situ, the transition may be gradual.

Hammer Type: Automatic

Advancement Method:
4 1/4 HSA

See [Exploration and Testing Procedures](#) for a description of field and laboratory procedures used and additional data (if any).

Notes:

Logged by: MO
Hammer Efficiency Summary:
Energy Transfer Ratio: 77.4% +/-2.7%
Hammer Efficiency Correction (CE):1.29

Abandonment Method:
Backfilled with bentonite grout upon completion

See [Supporting Information](#) for explanation of symbols and abbreviations.

Elevations were provided by Kiewit.

WATER LEVEL OBSERVATIONS

No measurable groundwater prior to grouting

Terracon
30 Corporate Cir Ste 201
Albany, NY

Boring Started: 03-29-2022

Boring Completed: 03-29-2022

Drill Rig: CME 550

Driller: B. Duffy

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

BORING LOG NO. K-223.1

Page 2 of 2

PROJECT: Champlain-Hudson Power Express Package
7a

CLIENT: Kiewit Engineering (NY) Corp.

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

GRAPHIC LOG	LOCATION See Exploration Plan		DEPTH (Ft.)	WATER LEVEL OBSERVATIONS	SAMPLE TYPE	RECOVERY (In.)	FIELD TEST RESULTS	WATER CONTENT (%)	ATTERBERG LIMITS		PERCENT FINES
	Latitude: 42.206011° Longitude: -73.891683°								LL-PL-PI		
	DEPTH	ELEVATION (Ft.)									
	LEAN CLAY (CL) , gray, soft <i>(continued)</i>		30			16	2-1-2-3 N=3				
			35			24	1-2-1-2 N=3	33.9	33-20-13	98	
	WEATHERED ROCK , gray, very dense		35				50/1"				
	Boring Terminated at 40.1 Feet		40				50/1"				

Stratification lines are approximate. In-situ, the transition may be gradual.

Hammer Type: Automatic

Advancement Method:
4 1/4 HSA

See [Exploration and Testing Procedures](#) for a description of field and laboratory procedures used and additional data (if any).

Notes:

Logged by: MO
Hammer Efficiency Summary:
Energy Transfer Ratio: 77.4% +/-2.7%
Hammer Efficiency Correction (CE):1.29

Abandonment Method:
Backfilled with bentonite grout upon completion

See [Supporting Information](#) for explanation of symbols and abbreviations.

Elevations were provided by Kiewit.

WATER LEVEL OBSERVATIONS

No measurable groundwater prior to grouting

Terracon

30 Corporate Cir Ste 201
Albany, NY

Boring Started: 03-29-2022

Boring Completed: 03-29-2022

Drill Rig: CME 550


Driller: B. Duffy

Project No.: JB215256D

THIS BORING LOG IS NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GEO SMART LOG-NO WELL. JB215256D CHAMPLAIN-HUDSON GPU TERRACON DATATEMPLATE.GDT 5/20/22

ATTERBERG LIMITS RESULTS

ASTM D4318

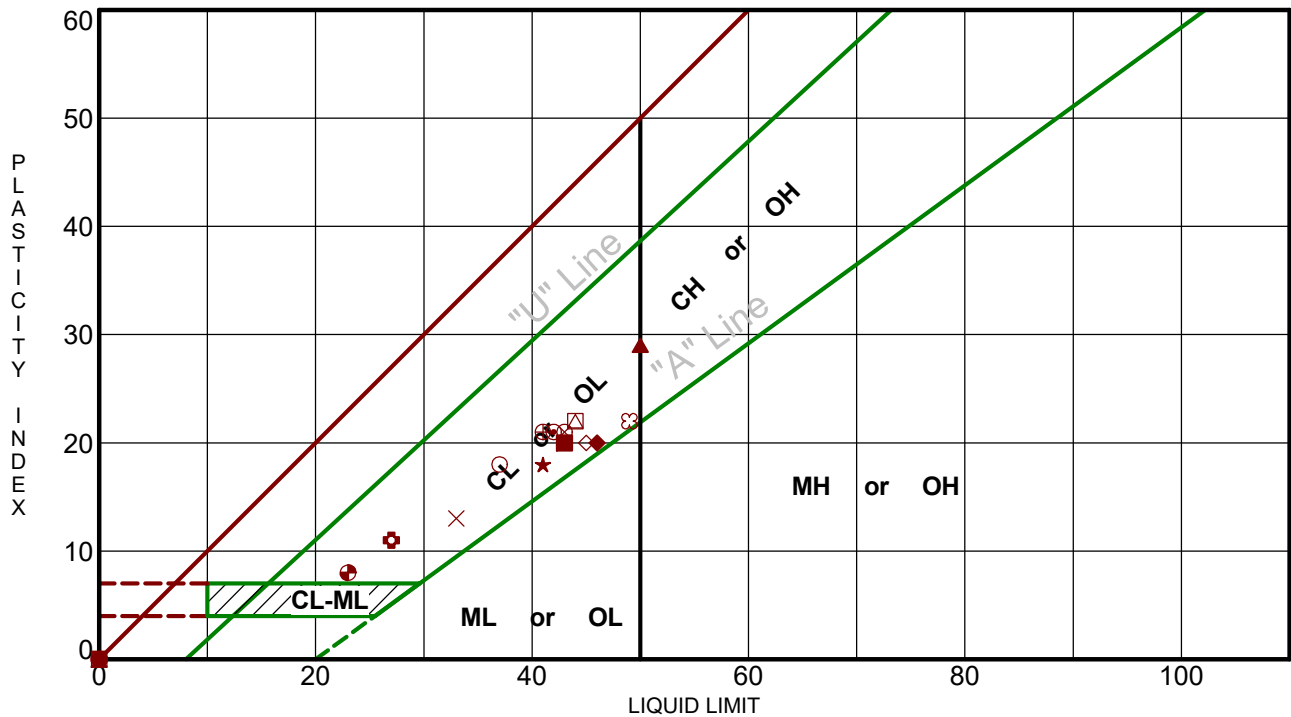

Boring ID	Depth (Ft)	LL	PL	PI	Fines	USCS	Description
● K-220.6	6 - 8	NP	NP	NP	22.1	GM	SILTY GRAVEL with SAND
▣ K-220.6	13 - 15	NP	NP	NP	11.9	SW-SM	WELL-GRADED SAND with SILT and GRAVEL
▲ K-221.0	8 - 10	50	21	29	73.4	CH	FAT CLAY with SAND
★ K-221.0	23 - 25	41	23	18	89.8	CL	LEAN CLAY
⊙ K-221.7	10 - 12	42	21	21	93.6	CL	LEAN CLAY
⊕ K-221.7	33 - 35	27	16	11	58.8	CL	SANDY LEAN CLAY
○ K-221.8	8 - 10	37	19	18	91.3	CL	LEAN CLAY
△ K-221.8	35 - 37	44	22	22	79.7	CL	LEAN CLAY with SAND
⊗ K-222.3	6 - 8	43	22	21	59.8	CL	SANDY LEAN CLAY
⊕ K-222.3	10 - 12	41	20	21	69.6	CL	SANDY LEAN CLAY
□ K-222.4	10 - 12	44	22	22	87.3	CL	LEAN CLAY
⊕ K-222.6	15 - 17	NP	NP	NP	6.5	GW-GM	WELL-GRADED GRAVEL with SILT and SAND
⊕ K-222.6	35 - 37	23	15	8	86.7	CL	LEAN CLAY
★ K-222.7	10 - 12	NP	NP	NP	25.3	GM	SILTY GRAVEL with SAND
⊗ K-222.7	25 - 27	49	27	22	76.3	CL	LEAN CLAY with SAND
■ K-223.0	10 - 12	43	23	20	58.5	CL	SANDY LEAN CLAY
◆ K-223.0	25 - 27	46	26	20	84.9	CL	LEAN CLAY with SAND
◇ K-223.1	15 - 17	45	25	20	71.3	CL	LEAN CLAY with SAND
× K-223.1	29 - 31	33	20	13	98.3	CL	LEAN CLAY

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY

Terracon
30 Corporate Cir Ste 201
Albany, NY


PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. ATTERBERG LIMITS JB215256D CHAMPLAIN-HUDSON GPJ TERRACON DATATEMPLATE.GDT 5/12/22

GRAIN SIZE DISTRIBUTION

ASTM D422 / ASTM C136

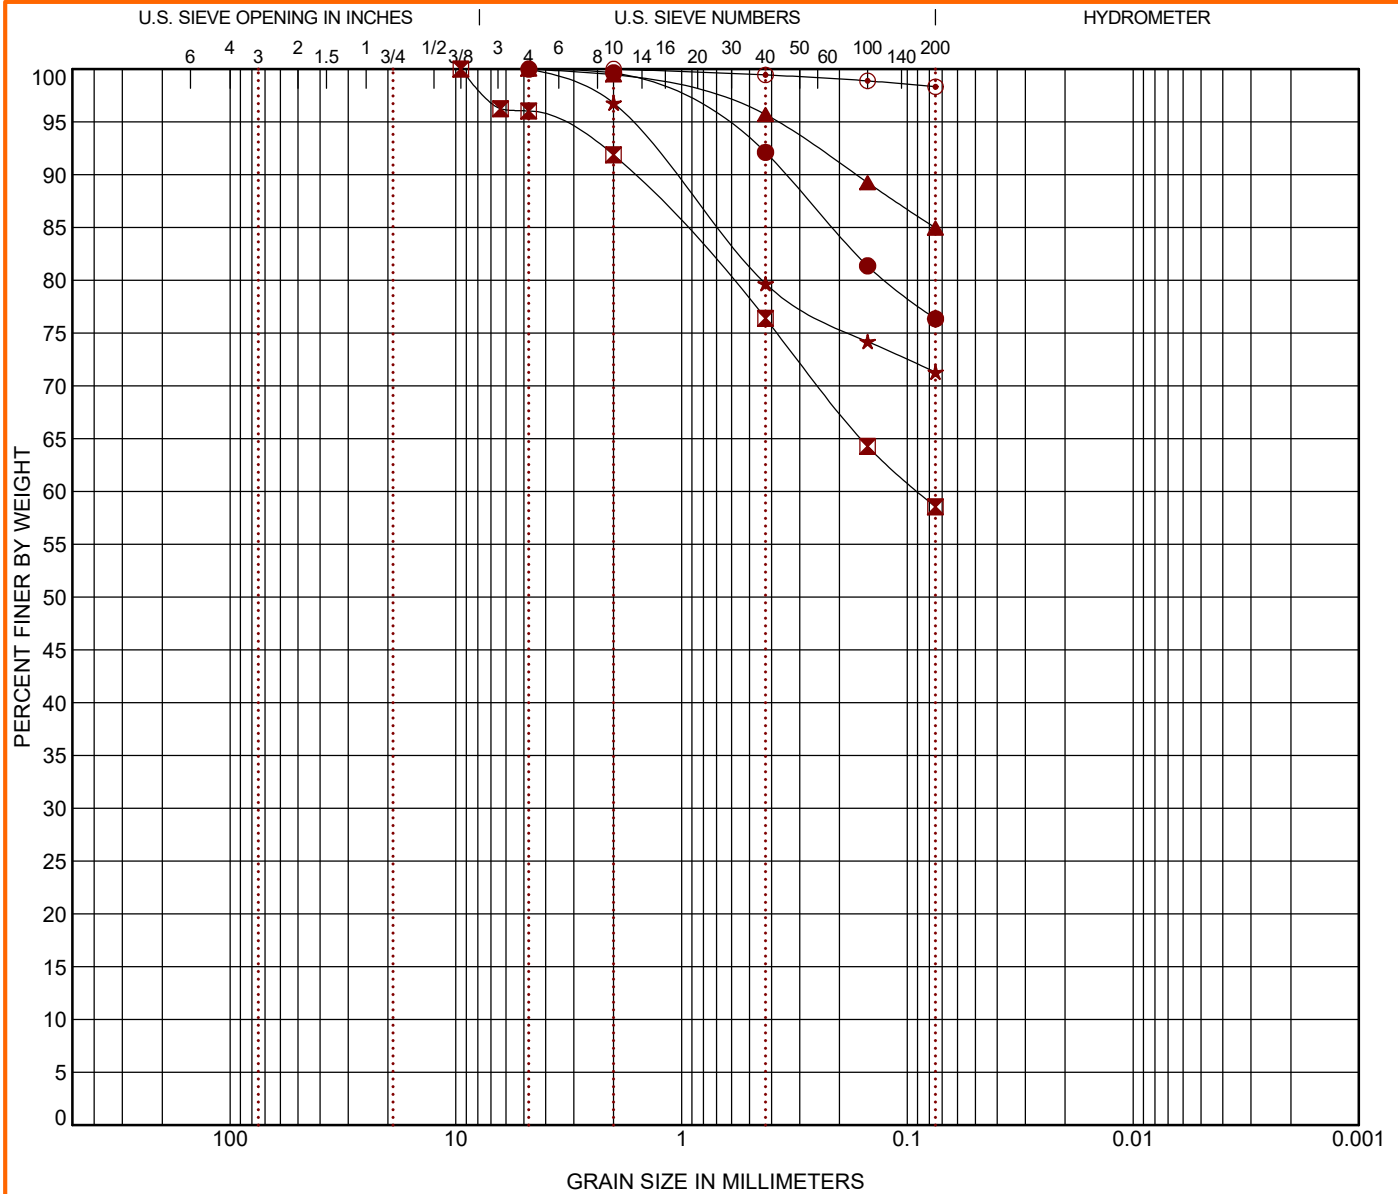

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Boring ID	Depth (Ft)	USCS Classification				WC (%)	LL	PL	PI	Cc	Cu
● K-222.7	25 - 27	LEAN CLAY with SAND (CL)				34.3	49	27	22		
☒ K-223.0	10 - 12	SANDY LEAN CLAY (CL)				34.0	43	23	20		
▲ K-223.0	25 - 27	LEAN CLAY with SAND (CL)				33.4	46	26	20		
★ K-223.1	15 - 17	LEAN CLAY with SAND (CL)				33.5	45	25	20		
⊙ K-223.1	29 - 31	LEAN CLAY (CL)				33.9	33	20	13		
Boring ID	Depth (Ft)	D ₁₀₀	D ₆₀	D ₃₀	D ₁₀	%Cobbles	%Gravel	%Sand	%Silt	%Fines	%Clay
● K-222.7	25 - 27	4.75				0.0	0.0	23.7		76.3	
☒ K-223.0	10 - 12	9.5	0.09			0.0	4.0	37.5		58.5	
▲ K-223.0	25 - 27	4.75				0.0	0.0	15.1		84.9	
★ K-223.1	15 - 17	4.75				0.0	0.0	28.7		71.3	
⊙ K-223.1	29 - 31	2				0.0	0.0	1.7		98.3	

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY



PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. GRAIN SIZE: USCS-2 JB215256D CHAMPLAIN-HUDSON_GPJ TERRACON_DATATEMPLATE.GDT 5/12/22

Summary of Laboratory Results

Sheet 1 of 1

BORING ID	Depth (Ft.)	Organic Content (%)
K-221.0-0.1	2-4	1.2
K-223.0	6.5-8	1.4

PROJECT: Champlain-Hudson Power Express
Package 7a

SITE: Champlain to Hudson HDD Crossings
Catskill, NY



PROJECT NUMBER: JB215256D

CLIENT: Kiewit Engineering (NY) Corp.

LABORATORY TESTS ARE NOT VALID IF SEPARATED FROM ORIGINAL REPORT. SMART LAB SUMMARY-PORTRAIT JB215256D CHAMPLAIN-HUDSON.GPJ TERRACON_DATA TEMPLATE.GDT 5/2/22

Client

Kiewit Engineering (NY) Corp
Lone Tree, CO

Project

Champlain-Hudson Power Express Project
JB215256

Date Received: 4/25/2022

Results from Corrosion Testing

Sample Location	K-221.0-0.1	K-223.0
Sample Depth (ft.)	4'-6'	8'-10'
pH Analysis, ASTM G 51	6.93	8.19
Water Soluble Sulfate (SO ₄), ASTM C 1580 (ppm)	5	10
Sulfides, AWWA 4500-S D, (mg/kg)	Nil	Nil
Chlorides, ASTM D 512, (ppm)	42	19
Red-Ox, ASTM G 200, (mV)	+465	+444
Total Salts, AWWA 2520 B, (mg/kg)	560	358
Resistivity (Saturated), ASTM G 57, (ohm-cm)	3690	8560


Analyzed By: Kyle Lemcke
Laboratory Supervisor

The tests were performed in general accordance with applicable ASTM and AWWA test methods. This report is exclusively for the use of the client indicated above and shall not be reproduced except in full without the written consent of our company. Test results transmitted herein are only applicable to the actual samples tested at the location(s) referenced and are not necessarily indicative of the properties of other apparently similar or identical materials.

Client	Project
Kiewit Engineering Corp	Champlain-Hudson Power Express Project

Project No. JB215256

ASTM D7012 Stress/ Strain Curve

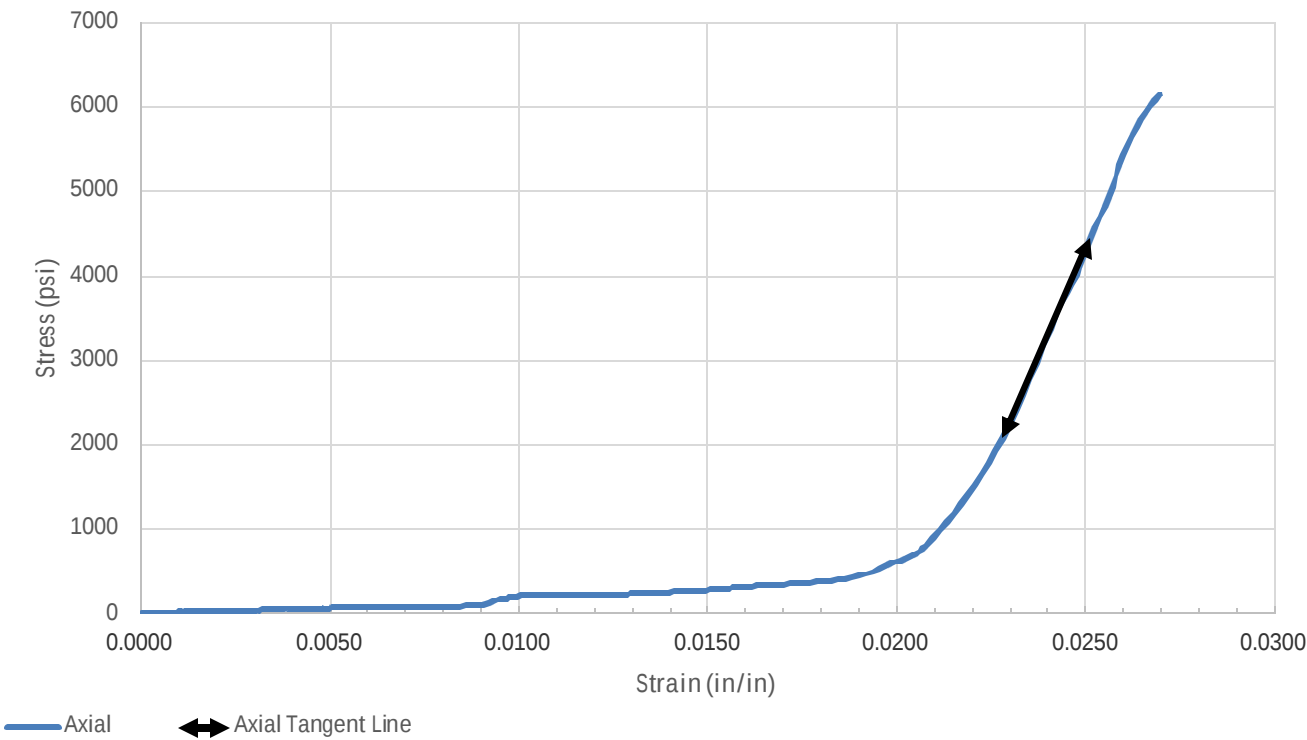

SAMPLE LOCATION			
Site:	Kiewit Engineering Corp.		
Description:	GRAYWACKE		
Boring:	K-223.0	Depth (feet):	35-39
SPECIMEN INFORMATION			
Sample No.:	Lab: 5070	Mass (g):	562.22
Length (in.):	4.1	Diameter (in.):	1.98
L/D Ratio:	2.071	Density (pcf):	169.660
TEST RESULTS			
Failure Load (lbs):		18930	
Failure Strain (in/in):		0.028	
Unconfined Compressive Strength (psi):		6,148	
Elastic Modulus, E, (ksi):		1018	
Time of Failure (min):		03:13	
Rate of Loading (in/sec):		0.04	
Moisture Content Post-break:		0.73%	



Client	Project
Kiewit Engineering Corp	Champlain-Hudson Power Express Project

Project No. JB215256

Equipment:	TICCS ID:
Calipers	W-44049
Scale	B-71466
Dial Indicator	C-70608
Compression (spherically seated)	C-48999

Samples were prepared and tested in accordance with ASTM D4543 and D7012. Deviations, if any, are noted below:
Notes:

Per ASTM D4543, this specimen has not met the requirements for perpendicularity, by exceeding 0.250°.
Per ASTM D4543, this specimen has not met the requirements for flatness, by exceeding 0.001 inches.
Per ASTM D4543, this specimen has not met the requirements for parallelism, by exceeding 0.25°.

According to ASTM D7012 Section 8.2.1, this specimen, although not meeting all requirements of ASTM D4543 is acceptable for testing. However, the results reported may differ from results obtained from a test specimen that meets the requirements of D4543.